

GP2U04

Smoke Sensor

■ Features



1. No requiring of sensitivity adjustment thanks to microcomputer
2. Reduced number of using devices
3. Compact package
4. 12V supply voltage

■ Applications

1. Air cleaners
2. Air checkers

■ Outline Dimensions

(Unit : mm)

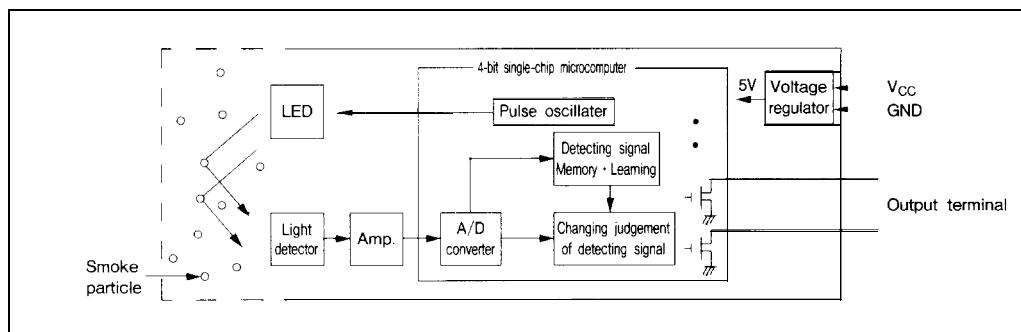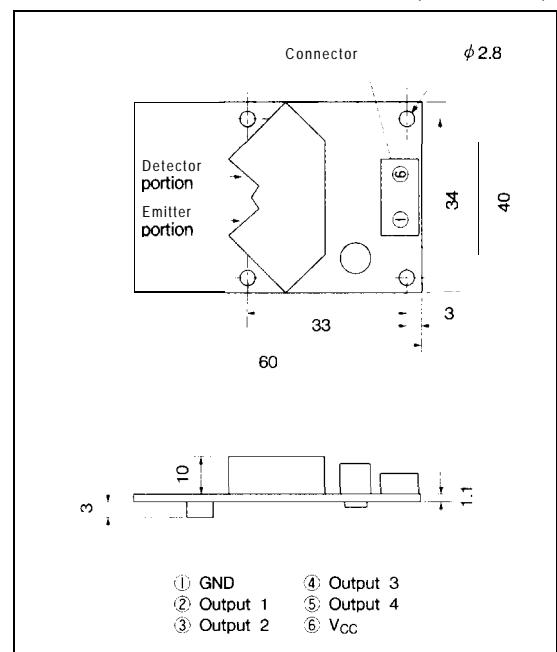

■ Absolute Maximum Ratings

(Ta = 25°C)

Parameter	Symbol	Rating	Unit
Supply voltage	V _{CC}	-0.3 to -16	V
*1Output terminal voltage	V _{out}	-0.3 to +15	V
*1Output terminal current	I _{out}	0 to -10	mA
Operating temperature	T _{opr}	0 to -60	°C
Storage temperature	T _{stg}	-30 to -80	°C

*1 Open drain output

■ Operating Supply Voltage

Parameter	Symbol	Rating	Unit
Supply voltage	V _{CC}	10 to 16	V

■ Electro-optical Characteristics

(Ta=25°C)

Parameter	Symbol	Condition	MIN.	TYP.	MAX.	Unit
* ² Smoke detecting sensitivity	P	By using Sharp's smoke measuring equipment	Table 1			
* ³ Output terminal 1	p _{out1}		0,25	—	—	mg/m ³
* ⁴ Output terminal 2	p _{out2}		—	0,25	—	mg/m ³
* ⁴ Output terminal 3	p _{out3}		0,3	0,5	0,7	mg/m ³
* ⁴ Output terminal 4	p _{out4}		—	1,0	—	mg/m ³
Dissipation current	I _{CC}	V _{CC} =12V		15	30	mA

*2 Smoke detecting sensitivity is set to 4 steps depending on smoke density. (Refer to Table 1)

*3 Output side Tr ON to OFF

*4 Output side Tr OFF to ON

■ Table 1 Smoke Detecting Sensitivity

Output terminal	Smoke density (mg/m ³)				
	Less than 0.25	0.25 to less than 0.5	0.5 to less than 1.0	1.0 or more	
1	ON	OFF	OFF	OFF	
2	OFF	ON	ON	ON	
3	OFF	OFF	ON	ON	
4	OFF	OFF	OFF	ON	

- Please refer to the chapter "Precautions for Use" (Page 78 to 93).