

RG5000E



USERS GUIDE



Miramar, Florida
Toll Free: 800-327-5060
Phone: 954-499-5400
Fax: 954-499-5454
www.amprobe.com

TABLE OF CONTENTS

I) Safety Precautions	
A) The Safe Way is the Only Way!	2
B) Refrigerant Gas Recovery & Containment	3
II) Important General Information	4
III) Operational Procedures	
A) Operating Your RG5000E	5
B) Self Purging Your RG5000E	6
C) Set- up Procedures	7,8,9
D) Purging the Non-condensable Gases	10
IV) Diagrams	
A) Parts List	11
B) Refrigerant Flow Diagram	12
C) Wiring Diagram	13
D) Installation of Upgrade Kit KT5001	14
Compressor Rebuild Kit	15
V) Care and Maintenance	16
VI) Trouble Shooting	17
VII) Warranty	18
VIII) Helpful hints for refrigerant recovery	19-20-21

Design specifications and material are subject to change without notice

This manual may not be reproduced in any way, shape or form without express written consent of Advanced Test Products.

THE SAFE WAY IS THE ONLY WAY!

**NOTE! IF YOU ARE NOT A QUALIFIED REFRIGERANT SERVICE TECHNICIAN,
DO NOT USE THIS EQUIPMENT**

1. The technician should always wear goggles and gloves when working on refrigeration systems.
2. Be sure that any room where you are working is thoroughly ventilated, especially if a leak is suspected. Refrigerant vapor is hazardous to your health and can cause death.
3. Always think before acting. Familiarity breeds carelessness and carelessness can be harmful to your health or, worse, result in death.
4. Read the Material Safety Data Sheets (MSDS) on all compounds with which you are likely to come in contact. Read MSDS on refrigerant and refrigerant oil. Obtain MSDS sheets from your refrigerant supplier.
5. Never use oxygen when testing for leaks. Any oil in contact with oxygen under pressure will form an explosive mixture.
6. Refrigerant systems are generally electrically driven and controlled. Be sure to disconnect the unit from the power source before servicing it.
7. Always store refrigerant containers in a cool, dry place.
8. Always open service and cylinder valves slowly. This allows quick control of the flow of gasses if there is any danger. Once it is determined that there is no danger, the valves may be opened fully.
9. Do not mix refrigerant in a system, a tank or anywhere else. Each type of refrigerant must have its own tank, filters, etc.
10. If moisture enters the refrigerant system, it is likely to cause considerable damage. Keep everything connected with the refrigeration system thoroughly dry and clean.
11. To reduce the risk of fire, avoid the use of extension cords as they may overheat. If you must use an extension cord it should be a minimum of 12AWG and not longer than 15 ft. This equipment should be used in locations with mechanical ventilation -providing at least four air changes per hour, or the equipment should be located at least 18" above the floor. Do not use this equipment in the vicinity of spilled or open containers of gasoline or any other flammable liquid.

REFRIGERANT GAS RECOVERY & CONTAINMENT

Safety comes first. Read all safety information for the safe handling of refrigerant including the Material Safety Data Sheet provided by your refrigerant supplier. Never operate unit in an explosive environment. Wear safety glasses and protective gloves. Work area must be well ventilated. This unit should only be operated by a qualified technician.

REFRIGERANT STORAGE CONTAINERS

*****HANDLE WITH CARE*****

CAUTION: Never use a standard disposable 30 lb. tank (the type of container in which virgin refrigerant is sold) to recover refrigerant. Use only DOT CFR Title 49 or UL approved storage containers for recovered refrigerant.











NOTE: Recovery cylinders are designed for different pressures.

DO NOT exceed the working pressure of each cylinder.

Safety codes recommend, that closed tanks not be filled over 80% of volume with liquid. The remaining 20% is called head pressure room.

NEVER TRANSPORT AN OVERFILLED CYLINDER

Refrigerant expands when it gets warm and may cause a tank to explode if overfilled.

CYLINDER TEMPERATURE	60°F	70°F	100°F	130°F	150°F
STARTING WITH CYLINDER 80% BY VOLUME					
SPACE OCCUPIED BY LIQUID	80%	81%	83%	90%	94%
STARTING WITH CYLINDER 90% BY VOLUME					
SPACE OCCUPIED BY LIQUID	90%	92%	96%	100%	

IMPORTANT GENERAL INFORMATION

BEFORE OPERATING THE RG5000E RECOVERY UNIT, READ FOLLOWING:

- 1) Always isolate large amounts of refrigerant and close off valves after use so if a leak should develop anywhere in the system the refrigerant does not escape.
- 2) Storage cylinders sometimes have valves that are not properly seated when manufactured. Keeping caps on these valves will guard against refrigerant leakage.
- 3) Always operate the unit on a flat level surface.
- 4) Your RG5000E has an internal pressure shut off switch. If the pressure inside the system should go above 400 psi, the system will automatically shut itself off.

CAUTION !

The 400 psi switch does not prevent tank overfill. If your system shuts off on high pressure and is connected to your tank, you may have overfilled your tank and created a very dangerous situation! Take immediate measures to relieve any high pressure and/or tank overfill.

- 5) **WARNING!** Never overfill storage tanks. Overfilling may cause tanks to explode.
- 6) Tanks and filters should be designated for one refrigerant only. Before using a tank previously used for another refrigerant, completely empty the tank, evacuate it, purge the tank using dry nitrogen, and re-evacuate it. Use only Promax storage tank part No. RGT30 or RGT50 with this refrigerant recovery equipment.
- 7) Special care should be taken when recovering from a burned-out system. Use two high acid capacity filters, in series. Alco type EK- 1 62-F or Sporlan type C-162-F are recommended. When you have finished recovering from the system, flush your RG5000E with a small amount of refrigerant oil and a small amount of clean refrigerant to purge off any foreign substances left in the unit.
- 8) Always empty refrigerant from the unit into a storage tank; see Self Purge/Auto Evacuate procedure. Liquid refrigerant left in the condenser may expand, causing damage to components.

OPERATING YOUR RG5000E

PROCEDURE FOR NORMAL SYSTEM RECOVERY


Inspect the **RG5000E** thoroughly to insure that it is in good operating condition.

2. Make sure all connections are correct and tight (see set-up diagram on page 6).
3. Open the liquid port of the recovery cylinder (always open valves slowly to check hoses and connections for leaks).
4. Make sure the Recover/Purge valve is set on Recover.
5. Open the output port of the **RG5000E**.
6. Open the liquid port on the manifold gauge set; opening the liquid port will remove the liquid from the system first, greatly reducing the recovery time (after the liquid has been removed, open the manifold vapor port to finish evacuating the system).
7. Connect your **RG5000E** to a 110 v. outlet.
 - a. Switch the main power switch to the **ON** position. You should hear the fan running.
 - b. Press the compressor start switch. This momentary switch will start the compressor, (It may be necessary, under certain circumstances, to press this switch more than once to start the compressor.)
8. Slowly open the input port on the **RG5000E**.
 - a. If the compressor starts to knock, slowly throttle back the input valve until the knocking stops.
 - b. If the input valve was throttled back, it should be fully opened once the liquid has been removed from the system (the manifold vapor port should also be opened at this time).
9. Run until minimum EPA required vacuum is achieved. a. Close the manifold vapor and liquid ports. b. Close the **RG5000E** input port. c. Shut unit off and proceed with the Self Purge procedure on the next page.


Always purge the RG5000E after each use (see Self Purge procedure on page 5). Failure to purge the remaining refrigerant from the RG5000E could result in the acidic degradation of internal components, ultimately causing premature failure of the unit.

1

SELF PURGE AUTO EVACUATE

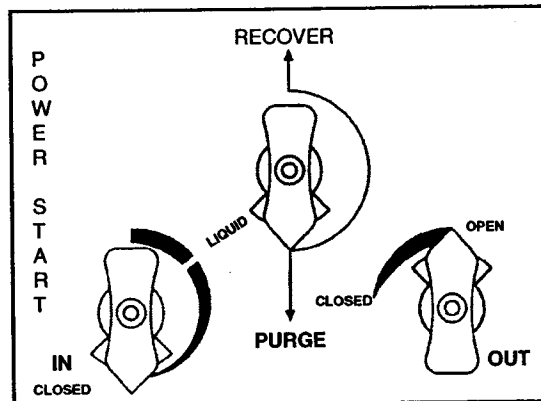


6




SET-UP DIAGRAM FOR REFRIGERANT RECOVERY

THIS METHOD IS THE FASTEST METHOD FOR RECOVERING VAPOR REFRIGERANT.

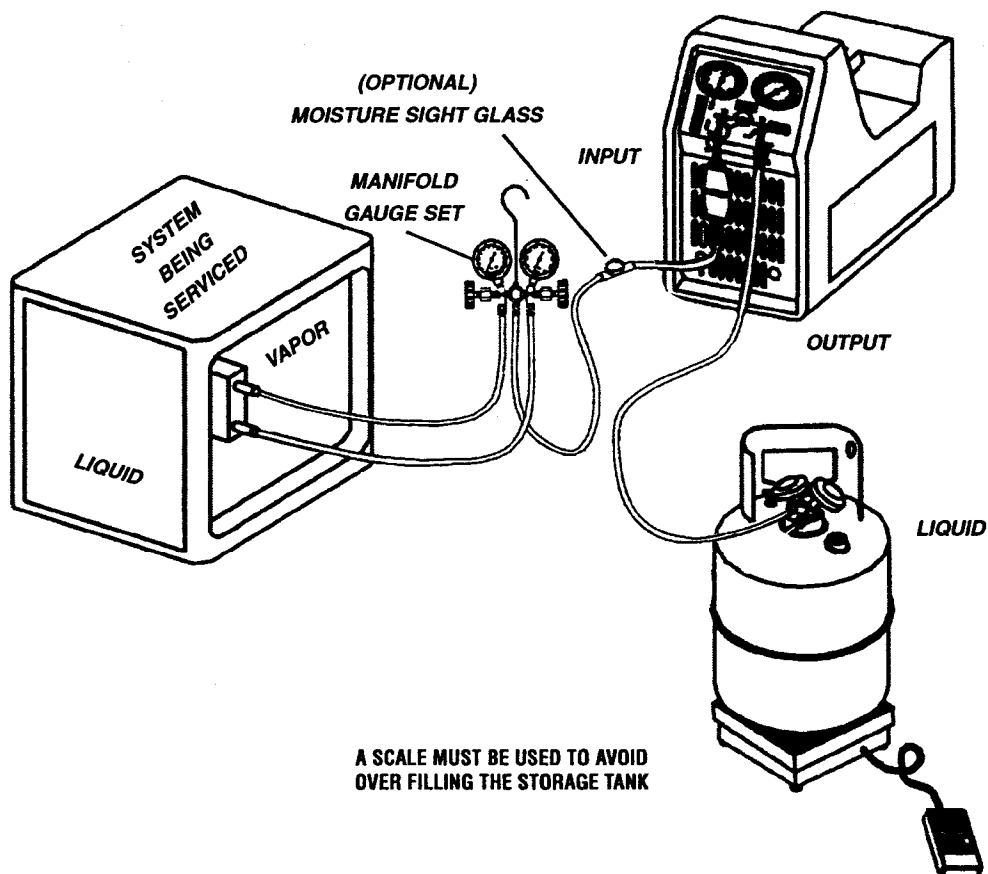

NORMAL RECOVERY

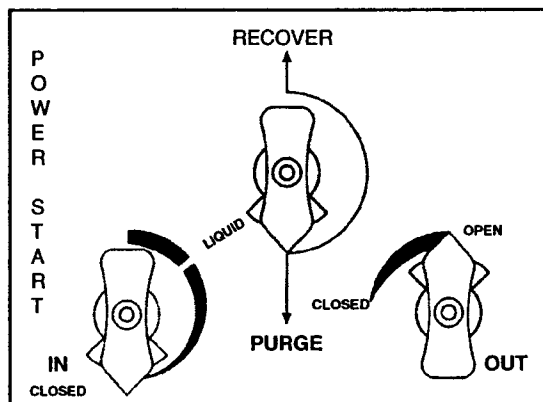

RG5000E REFRIGERANT RECOVERY ADDITIONAL INFORMATION

To achieve the deepest final vacuum, use the tank cooling method to lower the head pressure on the recovery tank. Repeat as necessary to achieve the desired vacuum level.

NOTE: If there is no liquid in the recovery tank, then the cooling method will not work. In this case, use an empty tank that has been fully evacuated to achieve the final vacuum level required.


To maximize recovery rates use the shortest possible length of 3/8" or larger hose. A hose no longer than 37 is recommend. Always remove all unnecessary hose core depressors and Schrader valves from port connections (using the proper valve core tool) for maximum throughput. Deformed rubber seals and core depressors in hoses and faulty or unnecessary Schrader valves can restrict flow by up to 90%.

If the tank pressure exceeds 300 psi, use the tank cooling procedure to reduce the tank pressure. When recovering large amounts of liquid, use the "PUSH/PULL" method of recovery (see diagram below).


CAUTION: When using the "PUSH/PULL" method, you must use a scale to prevent overfilling the storage tank. Once the "PUSH/PULL" siphon is started, it can continue and overfill the storage tank even if the tank is equipped with a float level sensor. The siphon can continue even when the machine is turned off. You must manually close the valves on the tank and the unit to prevent overfilling the recovery tank.

SET-UP DIAGRAM FOR "PUSH/PULL" METHOD

Push pull only works with large systems where the liquid is readily accessible. Do not use this method on systems less than 15 pounds as it may not work.

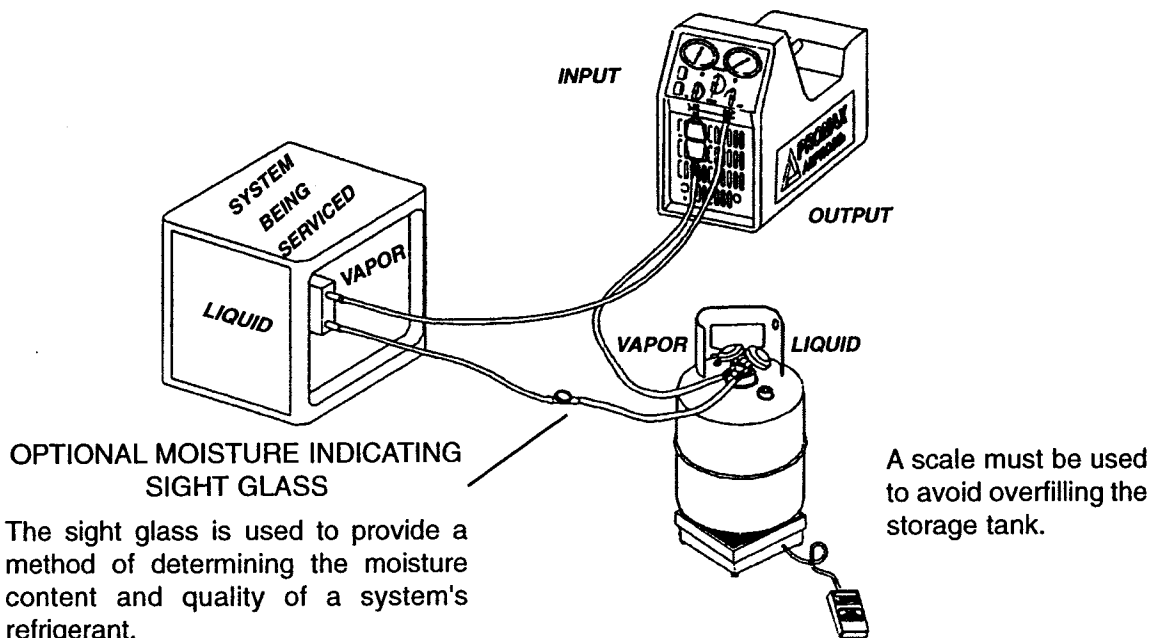

SET-UP DIAGRAM FOR TANK PRE OR SUB COOLING PROCEDURE

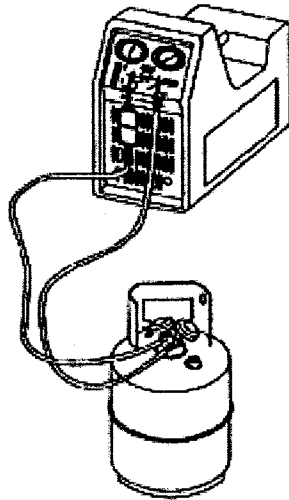


To start you must have a minimum of 5 lbs. of liquid refrigerant in the tank.

Throttle the output valve so that the output pressure is 100 psi greater than the input pressure, but never more than 450 psi.

Run until the tank is cold.

(Please see additional information on page 24 of this manual)

OPTIONAL RECOVERY / TANK PRE OR SUB COOLING FIXED HOSE SET UP

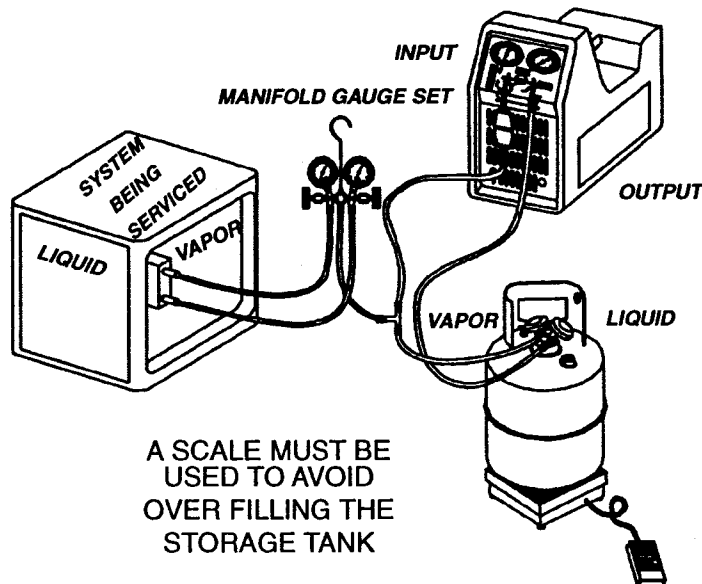

NORMAL RECOVER

Tank Vapor valve is closed.


TANK PRE OR SUB COOLING:

Tank Vapor valve is open and both Manifold Gauge Set valves are closed. Follow above procedure.

RG5000E RECOVERY PURGING THE NON-CONDENSABLE GASSES FROM IDENTIFIED REFRIGERANT IN A TANK

- 1) Allow the tank to sit undisturbed for 24 hours. (This allows the air to rise to the top.)
- 2) Connect a manifold to the tank and read the amount of pressure in the tank by looking at the output pressure gauge.
- 3) Determine the ambient temperature in the room.
- 4) Refer to a Refrigerant pressure/temperature chart. Find the temperature on the chart and look across to the corresponding pressure for the type of refrigerant in the tank. Determine how that relates to the reading on the gauge.
- 5) If the pressure reading is higher than the pressure shown on the chart, very slowly (so as not to cause turbulence inside the tank) crack open the vapor port valve. Watch the pressure on the gauge decrease. To prevent venting, add 4 - 5 psi to the pressure shown on the chart. When the gauge corresponds to that pressure, close the vapor port valve.
- 6) Allow the tank to sit for 10 minutes and check the pressure again.
- 7) Repeat the process again if necessary.


RG5000E PARTS LIST

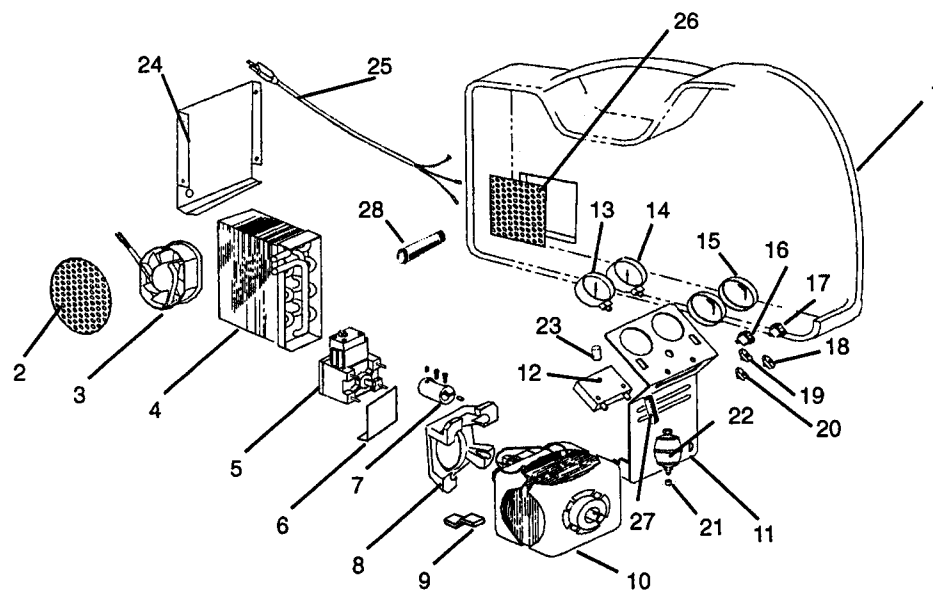

ITEM	DESCRIPTION	PART #
1	PLASTIC CASE	
2	FAN GRILL	
3	AXIAL FAN	
4	CONDENSER	
5	MOTOR	
6	COUPLER	
7	BELL HOUSING	
8	COMPRESSOR	
9	MANIFOLD	
10	INPUT GAUGE	
11	OUTPUT GAUGE	
12	GAUGE LENS	
13	ON/OFF SWITCH	
14	START SWITCH	
15	BLUE KNOB	
16	RED KNOB	
17	BLACK KNOB	
18	FRONT PANEL	
19	FILTER	
20	FLARE CAP	
21	CORD SET	
22	*SENSOR CORD	
23	*RELAY	
24	PRESSURE SW.	
25	CAPACITOR	

***OPTIONAL COMPONENTS
FOR KIT KYT5001**

REFRIGERANT FLOW DIAGRAM

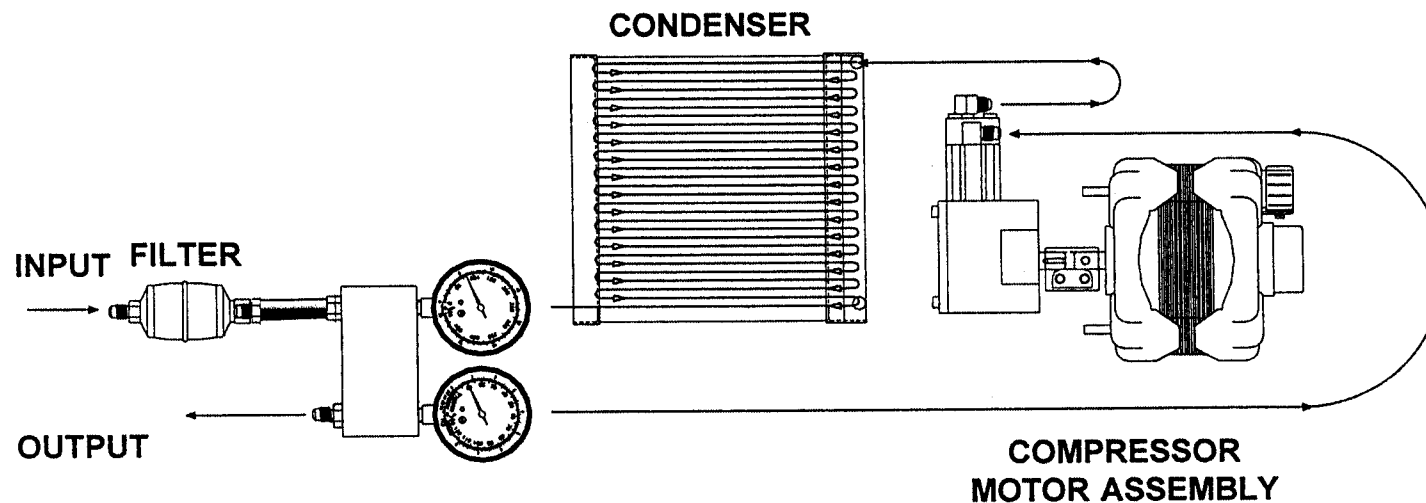


NOTE: A filter must always be used. Failure to use a filter will invalidate your warranty.

The use of a filter will greatly reduce the risk of damage to your RG5000E by preventing foreign material from entering the unit.

Special consideration for filtration must be given when you know you are servicing a machine that has "Burned Out". We recommend the use of two size 162 filter driers, in line, to be used for that job and that job only.

RG5000E WIRING DIAGRAM

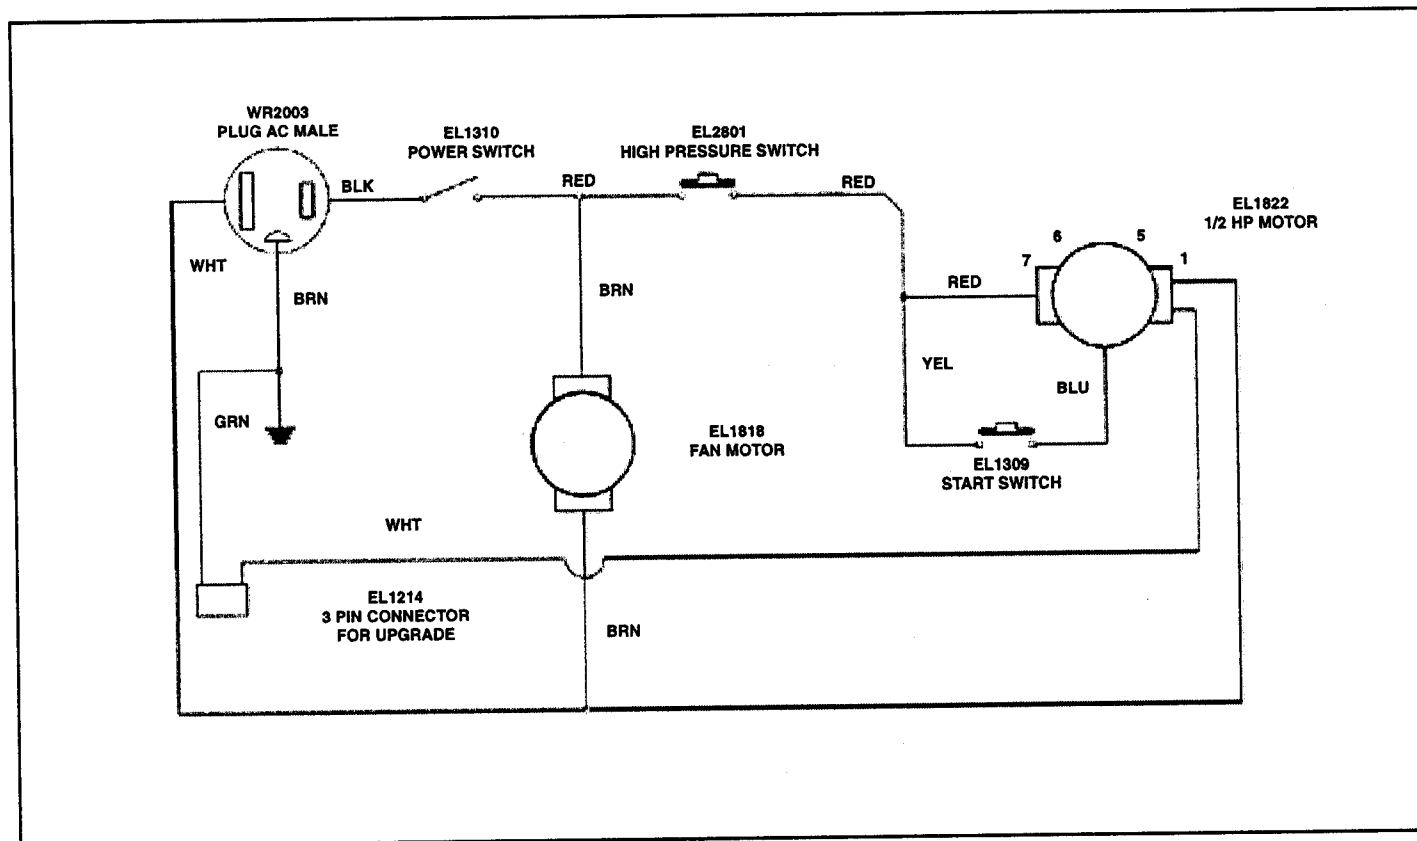

COMPRESSOR REPAIR KIT KT3305

THIS KIT INCLUDES:

QTY DESCRIPTION	PART#
2 SHAFT BEARING	SB1002
2 SHAFT SEAL	SB5203
2 #038 O-RING	SB2038
2 #026 O-RING	SB2026
2 SLIDE RING	SB3005
1 #115 O-RING	SB2115
1 PISTON SEAL	SB6001
1 INPUT VALVE	CP1009
1 OUTPUT VALVE	CP1010
2 VALVE SPRING	NB5605
1 #013 O-RING	SB2013
1 #027 O-RING	SB2027

REMOVAL:

REMOVE COMPRESSOR FROM RG5000E
REMOVE THE SEAL PLATES (CP1393).
REMOVE 4 CYLINDER HEAD BOLTS.
REMOVE CYLINDER, HEAD AND O-RING.
SLIDE CYLINDER STRAIGHT UP OFF OF
THE PISTON.
REMOVE THE PISTON SEAL, O-RING AND
2 SLIDE RINGS FROM THE PISTON.
REMOVE THE SEAL PLATES.
REMOVE THE CRANK SHAFT AND

INSTALLATION:

INSTALL #115 O-RING IN TOP PISTON
GROOVE. INSTALL PISTON SEAL OVER
#115 O-RING.
INSTALL NEW BEARINGS AND SEALS
INTO THE SEAL PLATES AND REPLACE
THE CIR-CLIPS.
REINSTALL CRANK SHAFT AND
85M COMPRESSOR SEAL PLATES ENSURING
THAT THE CRANK SHAFT IS ORIENTED
CORRECTLY.

PLACE ONE #026 O-RING INTO THE
GROOVE IN THE TOP OF THE
COMPRESSOR BODY, SLIDE THE
CYLINDER ONTO THE PISTON WHILE
HOLDING THE TWO SLIDE RINGS IN
PLACE (NOTE THAT THE BOTTOM OF THE
CYLINDER IS THE END THAT IS
RADIUSED, ON THE INSIDE THE SQUARE
END IS THE TOP)

PLACE THE OTHER #1026 O-RING INTO THE
VALVE PLATE AND REINSTALL THE CYLINDER
HEAD, TIGHTENING THE 4 BOLTS IN A CROSS
PATTERN. REINSTALL THE COMPRESSOR, PRES-
SURE UP THE MACHINE AND CHECK FOR LEAKS.

PISTON SEAL REPLACEMENT KIT KT3302

THIS KIT INCLUDES:


QTY	DESCRIPTION	PART#
2	#026 O-RING	SB2026
2	SLIDE RING SB3005	
1	#115 O-RING	SB2115
1	PISTON SEAL	SB6001

REMOVAL:

REMOVE COMPRESSOR FROM RG5000E
LOOSEN 4 CYLINDER HEAD BOLTS, REMOVE
CYLINDER, HEAD AND O-RING. SLIDE CYLINDER
STRAIGHT UP OFF OF THE PISTON. REMOVE THE
PISTON SEAL, O-RING AND 2 SLIDE RINGS FROM
THE PISTON. CLEAN THE PISTON, CYLINDER HEAD
AND CYLINDER, AND INSPECT FOR ANY FOREIGN
MATERIAL.

INSTALLATION:

INSTALL #115 O-RING IN TOP PISTON GROOVE.
INSTALL PISTON SEAL OVER #115 O-RING.
PLACE ONE #026 O-RING INTO THE GROOVE IN
THE TOP OF THE COMPRESSOR BODY. SLIDE
THE CYLINDER ONTO THE PISTON WHILE
HOLDING THE TWO SLIDE RINGS IN PLACE.
PLACE THE OTHER #026 O-RING INTO THE
VALVE PLATE AND REINSTALL THE CYLINDER
HEAD, TIGHTENING THE 4 BOLTS IN A CROSS
PATTERN. REINSTALL THE COMPRESSOR,
PRESSURE UP THE MACHINE AND CHECK FOR
LEAKS.

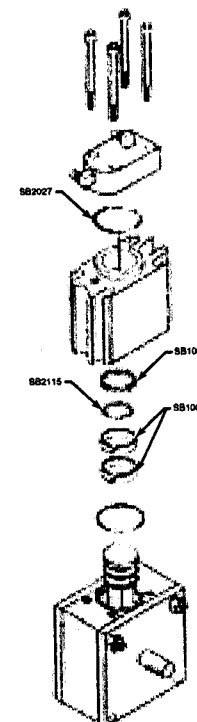


VALVE REPLACEMENT KIT KT3303

THIS KIT INCLUDES:

QTY	DESCRIPTION	PART#
1	#026 O-RING	S82026
1	INPUT VALVE	CP1009
1	OUTPUT VALVE	CP1010
2	VALVE SPRING	NB5605
1	#013 O-RING	S82013
1	#027 O-RING	S82027

INSTALLATION:

THE INPUT VALVE, CP1309, MUST BE PASSED THROUGH THE CONICAL HOLE, ON THE O-RING SIDE OF THE VALVE PLATE, CP1307, AND THE VALVE SPRING, NB5605, MUST THEN BE THREADED OVER IT UNTIL IT IS ALL BELOW THE "BUTTON". AT THE TOP OF THE VALVE, SECURING IT IN PLACE

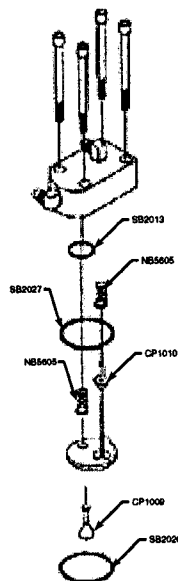


SHAFT SEAL REPLACEMENT KIT KT3306

THIS KIT INCLUDES:

QTY	DESCRIPTION	PART#
2	SHAFT BEARING	S81002
2	SHAFT SEALS	SB5203
2	#038 O-RING	SB2038

INSTALLATION:

CLEAN AND INSPECT SHAFT, REMOVE ANY BURRS OR SHARP EDGES. PLACE THE "O"RINGS INTO THE GROOVE ON THE SEAL PLATES. PLACE A FEW DROPS OF REFRIGERANT OIL ON THE ENDS OF THE SHAFT AND GENTLY SLIDE THE SEAL PLATES INTO PLACE. CARE MUST BE TAKEN TO AVOID DAMAGING THE SHAFT SEAL DURING INSTALLATION.

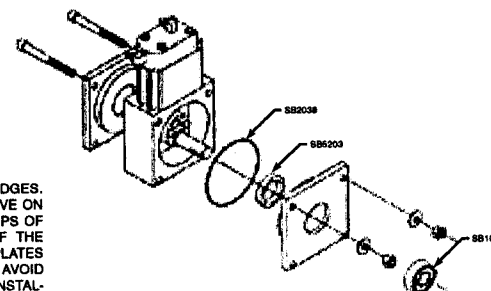

COMPRESSOR RE-BUILD KITS

For use on all oil-less models

Our team of experts are on hand to help you determine the correct kit for your particular needs.

For this or any other technical support please contact Promax Technical Support 1-800-327-5060

PROMAXTECHNICAL SUPPORT
1-800-327-5060

CARE AND MAINTENANCE OF YOUR RG5000E

A filter must always be used and should be replaced frequently. **Failure to use a filter will invalidate your warranty.** The use of a filter will greatly reduce the risk of damage to your **RG5000E** by preventing foreign material from entering the unit.

Special consideration for filtration must be given when you know the machine you are servicing has "burned out". We recommend the use of two size 162 filter driers, in line, to be used for that job and that job only. We also recommend that a clean filter be used for every service job. Each filter should be labeled and used exclusively for one type of refrigerant only.

Do not use this unit in the vicinity of spilled or open containers of gasoline or other combustible liquids

Avoid the use of extension cords. If you must use an extension cord it should be a minimum of 12 AWG and not longer than 15 ft. Not using an extension cord will greatly reduce the risk of fire.

Always purge the unit of any refrigerant left after completing a service job. Refrigerant left in the machine can expand and may cause damage to components.


If the unit is to be stored or not used for any length of time, we recommend that it be completely evacuated of any residual refrigerant and purged with dry nitrogen.

Whenever you perform any type of maintenance work on your **RG5000E**, insure that it is disconnected from the power supply before you begin.

TROUBLE SHOOTING YOUR RG5000E

SAFETY FIRST

READ AND UNDERSTAND ALL SAFETY INFORMATION
CONTAINED IN THIS MANUAL BEFORE SERVICING THE UNIT

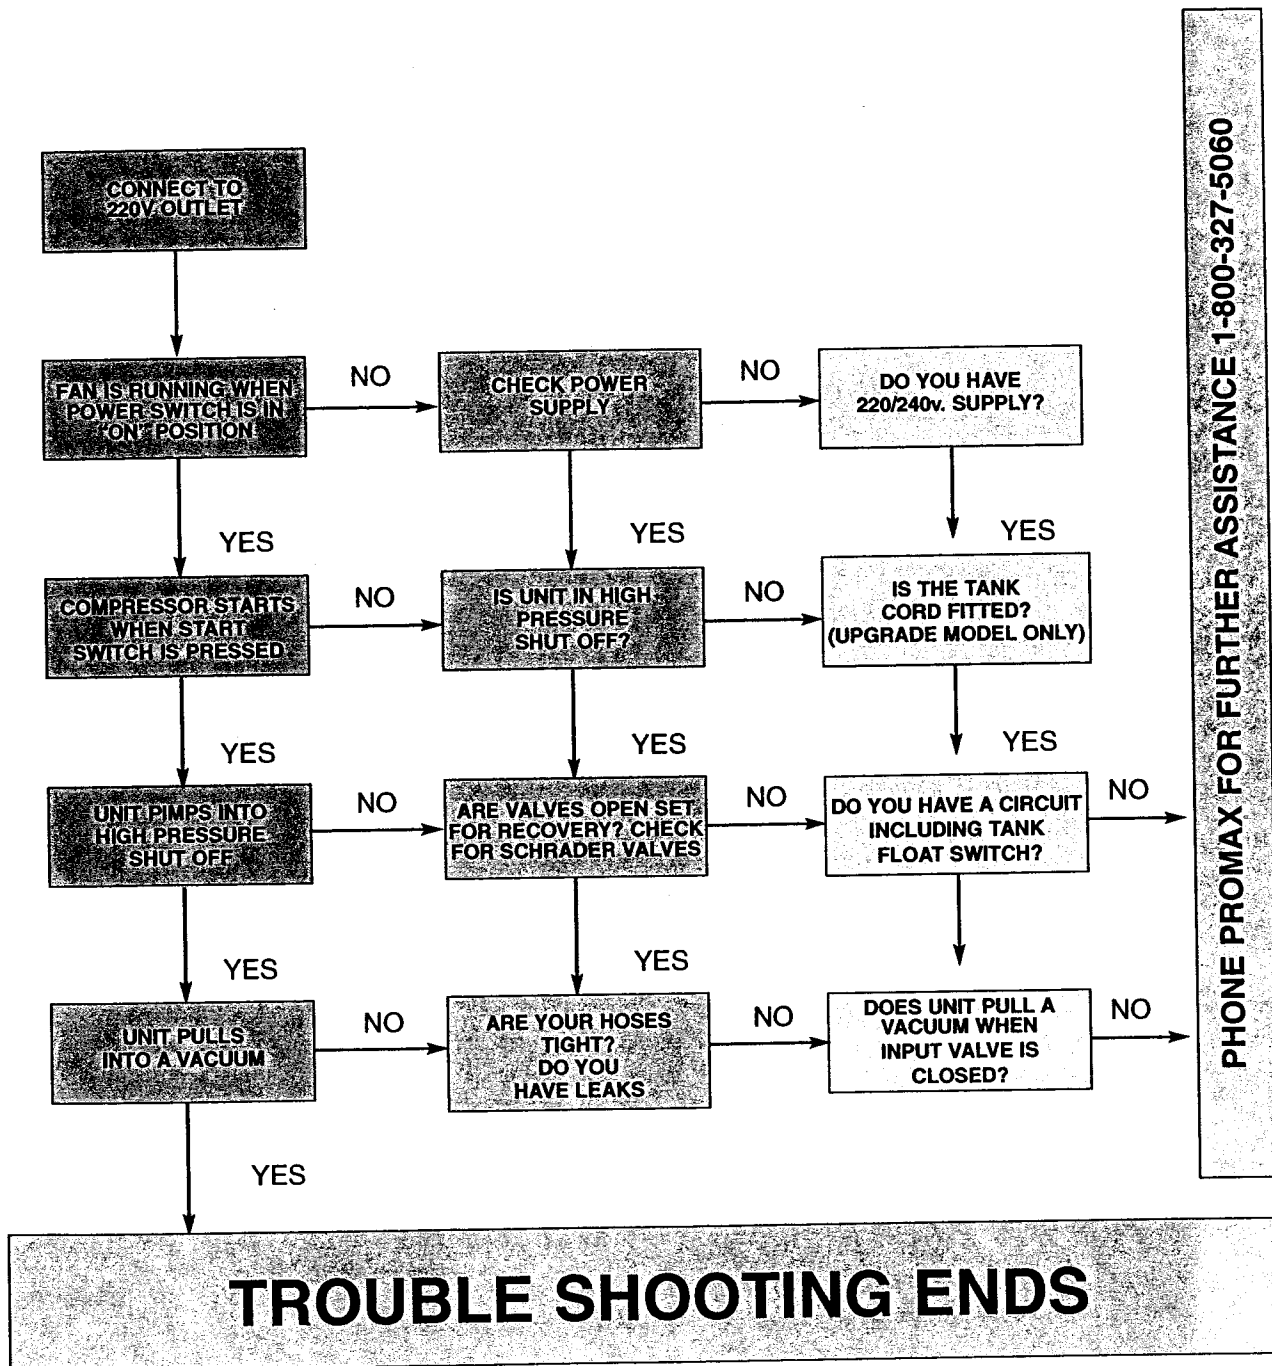

FULL ONE YEAR WARRANTY

MFG. # _____

PROMAX PRODUCTS ARE WARRANTED TO BE FREE FROM DEFECTS IN WORKMANSHIP AND MATERIALS FOR A PERIOD OF ONE YEAR FROM DATE OF PURCHASE.

THE FOLLOWING RESTRICTIONS APPLY:

- 1) THE WARRANTY APPLIES TO PRODUCTS IN NORMAL USE ONLY, AS DESCRIBED IN THE OPERATING MANUAL. THE PRODUCT MUST ALSO BE SERVICED AND MAINTAINED AS DESCRIBED THEREIN.
- 2) IF THE PRODUCT FAILS, IT WILL BE REPAIRED OR REPLACED AT THE OPTION OF **ADVANCED TEST PRODUCTS**.
- 3) ALL SHIPMENT / DELIVERY CHARGES ARE THE RESPONSIBILITY OF THE PURCHASER.
- 4) WARRANTY SERVICE CLAIMS ARE SUBJECT TO FACTORY INSPECTION FOR PRODUCT DEFECT(S). IF DURING THE WARRANTY EVALUATION IT IS DETERMINED THAT A FILTER HAS NOT BEEN USED OR THAT THE FILTER WAS NOT PROPERLY MAINTAINED OR THAT THE MACHINE HAS BEEN USED IN ANY WAY OTHER THAN THE PURPOSE FOR WHICH IT WAS DESIGNED, **PROMAX** RESERVES THE RIGHT TO VOID THE WARRANTY.
- 5) ALL WARRANTY CLAIMS MUST BE MADE WITHIN THE WARRANTY PERIOD. PROOF OF PURCHASE MUST BE SUPPLIED TO PROMAX AMPROBE. THIS WARRANTY IS NON-TRANSFERABLE.
- 6) PLEASE NOTE THAT THE WARRANTY DOES NOT APPLY IF THE PRODUCT OR PRODUCT PART IS DAMAGED BY ACCIDENT, MISUSE, TAMPERED WITH OR MODIFIED IN ANY WAY.
- 7) NORMAL WEAR ITEMS (SEALS, FILTERS, ETC.) ARE SPECIFICALLY EXCLUDED FROM WARRANTY UNLESS FOUND BY PROMAX AMPROBE TO BE DEFECTIVE.
- 8) THIS WARRANTY IS EXCLUSIVE AND SHALL BE IN LIEU OF ANY OTHER WARRANTY, EXPRESS OR IMPLIED, WHICH MAY BE AVAILABLE TO THE PURCHASER.

WARRANTY SERVICE:

This warranty is given by **ADVANCED TEST PRODUCTS, Inc.**

Miramar, Florida • Toll Free: 800-327-5060 • Phone: 954-499-5400 • Fax: 954-499-5454

Service under this warranty must be obtained by the following steps:

- 1) outside the U.S.A. contact your local Promax Distributor.
- 2) Inside the U.S.A. call 1-800-327-5060 or 954-499-5400 for a return material authorization (RMA) number.

HELPFUL HINTS FOR REFRIGERANT RECOVERY

Refrigerant recovery has come a long way in a few short years. On the surface it's simply the process of taking refrigerant out of a system and putting it into a tank. However, this simple process can quickly become problematic if a few items are overlooked. The following are some tips and pointers we've accumulated over the last few years that can save you time and make the process go smoother.

First you need to identify the refrigerant type and quantity in the system you are servicing. If you determine it's a burnout, you need a special tank (a tank that's identified as containing burnout or other unidentified gases), and you need to use extra filtration prior to recovery.

First you need to identify the refrigerant type and quantity in the system you are servicing. If you determine it's a burnout, you need a special tank (a tank that's identified as containing burnout or other unidentified gases), and you need to use extra filtration prior to recovery.

If, on the other hand, you know the gas in the system is relatively clean or new, then a new tank should be used. If you're planning on putting the refrigerant back into the same system after you have finished the service or if the refrigerant is going to be reclaimed, then use a tank that has the same refrigerant in it. A word of caution about the Environmental Protection Agency (EPA): If you use a variety of refrigerant gasses in your service work - as evidenced by your refrigerant purchases - and you only own one tank, you are asking for trouble. You would be well advised to own at least one tank for every refrigerant type serviced,, plus an extra for burnouts and other unknowns.

PLANNING AHEAD


Knowing the quantity of refrigerant is important for planning storage requirements, as well as planning for the actual recovery. For instance, any system with more than 5lbs. of refrigerant is likely to have areas where the liquid can get trapped.

The key to a quick recovery procedure is to get the liquid out first, and then get the remaining vapor out. However most systems are not "recovery friendly." That is they don't have access ports at their lowest points. If some units you're servicing are on maintenance contracts, you would save significant time by installing access ports at all of the lowest points in the system, where liquid is likely to accumulate.

Since most systems don't have these ports you need to be prepared to boil off the trapped liquid with a heat gun, when ever it's found. An indicator of trapped liquid in a system is frost or condensation forming on the plumbing or components where the liquid is trapped. The trapped liquid may be in an area that is not visible. In all cases trapped liquid in a system during recovery causes the recovery process to slow down, regardless of the size or type of machine (see diagram).

If you are unable to locate the trapped liquid (but you know it's there, because the recovery job is taking "forever", turn on the system compressor (if it's operable) for a few seconds. This will get the refrigerant causes the recovery process to slow down, regardless of the size or type of machine (see diagram).

If you are unable to locate the trapped liquid (but you know it's there, because the recovery job is taking "forever", turn on the system compressor (if it's operable) for a few seconds. This will get the refrigerant moving to another part of the system and in the process pick up enough heat to boil off.

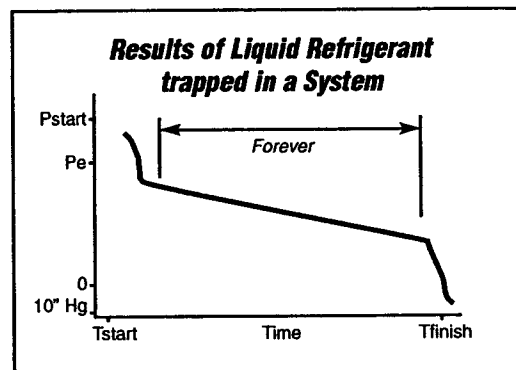

HOSES AND VALVES

Hoses and Schraeder valves have a large impact on recovery speed. In general, the larger the hose, the less friction on the flow of refrigerant, the quicker the recovery time. Many contractors are now using 3/8" lines for the input to the recovery machine, even if those lines originate out of 1/4" fittings.

Schraeder valves must be removed from the connection prior to an expedient recovery. Most wholesalers sell a tool for removing these cores, while keeping the connection sealed. The core depressor, in the end of the hose, should also be removed. These two items can turn a 20 minute job into one that goes on for hours. So, be sure to remove Schraeder valves and core depressors before every recovery job.

Another hose consideration is the little rubber grommet at the end of the hose that makes a seal with the flare fitting. We've seen these seals so worn and deformed that when the hose is connected to the flare fitting the grommet virtually seals off the connection.

Hoses and Valves

Hoses and Schraeder valves have a large impact on recovery speed. In general, the larger the hose, the less friction on the flow of refrigerant, the quicker the recovery time. Many contractors are now using 3/8" lines for the input to the recovery machine, even if those lines originate out of 1/4" fittings.

Schraeder valves must be removed from the connection prior to an expedient recovery. Most wholesalers sell a tool for removing these cores, while keeping the connection sealed. The core depressor, in the end of the hose, should also be removed. These two items can turn a 20 minute job into one that goes on for hours. So, be sure to remove Schraeder valves and core depressors before every recovery job.

Another hose consideration is the little rubber grommet at the end of the hose that makes a seat with the flare fitting. We've seen these seals so worm and deformed that when the hose is connected to the flare fitting the grommet virtually seals off the the connection. This is probably never noticed in charging, because the pressure opens the grommet, but during recovery (or with suction) the deformed grommet severely restricts the flow of refrigerant.

Refrigerant Recycling

Current regulations state that used refrigerant shall not be sold, or used in a different owner's equipment, unless the refrigerant has been laboratory analyzed and found to meet the requirements of ARI 700 (latest edition). As a result, recycling and verifying ARI 700 conformance isn't economically justified in most cases. It's still a great idea to do as much cleaning of refrigerant going back into the same system (or owners system) as possible. We recommend using the largest, high-acid capacity filter that are economically feasible. Put these filters on the suction or inlet side of the recovery unit. Change filters often.

The recovery of large amounts of liquid refrigerant can sometimes carry with it large quantities of oil, if the system being serviced doesn't have an adequate oil separator installed. If this recovered refrigerant isn't going to be liquid charged back into the same system, you might want to separate the refrigerant from the oil in order to measure the oil (to know how much oil to charge back into the system). However refrigerant sent back for reclaim does not need to have the oil removed. One of the simplest and most cost effective ways to achieve this is to use a 30 or 50 lb. tank in line with your recovery machine. Connect the the system to the liquid port of the tank then from the vapor port of the tank connect to the input of your recovery machine a second tank, for storing refrigerant, should then be connected to the output of the recovery machine. If you encounter large amounts of liquid you will need to put a band heater around the first tank.

When the recovery job is complete the oil can be removed, from the first tank, by applying a small amount of pressure, using nitrogen, to one of the ports and expressing the oil from the other. If you are going to remove the oil from the vapor port you will need to turn the tank upside down. Always wear safety glasses when performing this operation as the oil may be acidic and could cause severe burning.

Keeping the Did Out

During the recovery process your recovery machine can be exposed to debris that can, potentially, damage it. Including brazing spatter and copper and brass slithers. Further contamination can be introduced from the refrigerant storage tanks. To prolong the life of your recovery machine always use an in-line filter.

Whenever you are charging a system from a recovery cylinder it is a good idea to use an in-line filter to protect the system from contamination. Again, change your in-line filters often.

Getting the Liquid Out (See diagram on page 7 of this manual)

Push-pull is a method of removing bulk liquid from a system using the pressure differential created by the recovery machine. Push-pull will generally not work on smaller systems because there is no bulk liquid reservoir to create a siphon from.

Push-pull is mostly used on systems with a receiver tank or those with greater than 20 lbs. of refrigerant, or when transferring from one tank to another. The rate of liquid transfer is very much dependent on hose size, with larger hoses providing much better throughput.

Another trick is to chill the tank, if it's partially filled, prior or during recovery. This operation will lower the pressure in the storage tank and therefore speed up recovery.

There must be a minimum of 5 lbs of liquid refrigerant in the tank you wish to chill. This operation can be performed prior to or during the recovery. See the two set up diagrams and procedures on page 8 of this manual.

There is nothing magic here, you are simply using your recovery machine to make a refrigerator where the tank is the evaporator. By throttling the output valve, you're effectively creating a capillary tube or an expansion device, but you need to adjust the back pressure to suit the conditions and the refrigerant. Five to ten minutes of chilling can produce some very dramatic tank cooling, depending on the conditions. If there are any non condensibles; in the tank this process will not work. Also the greater the quantity of refrigerant in the tank the longer the process will take.