

# Plug-in module SIRAX SV 824

## Isolating switch amplifier

Output with relay contacts

CE 0102 Ex II (1) G

### Application

The isolating switch amplifier **SIRAX SV 824** (Fig. 1) is available in two-channel version and is used for transferring binary signals from fail-safe circuits to non-fail-safe circuits.

The amplifier input may be either a sensor conforming to DIN EN 50 227 or a mechanical contact. Input and output signals are electrically insulated. Output signals available are relay contacts.

Yellow LED's on the front of the unit signal energised output relays. The direction of action of the output can be configured with the aid of switches which are also located on the front of the unit.

Provision is made for monitoring the input with respect to open and short-circuits. Should one of these faults occur, the output relay of the channel concerned resets and the fault is signalled by the red LED on the front of the unit. The monitoring circuit is enabled by a switch (e.g. for use with mechanical transmitter contacts).

The instrument fulfils all the important requirements and regulations concerning electromagnetic compatibility **EMC** and **Safety** (IEC 1010 resp. EN 61 010). It was developed and is manufactured and tested in strict accordance with the **quality assurance standard** ISO 9001.

Production QA is also certified according to guideline 94/9/EG.

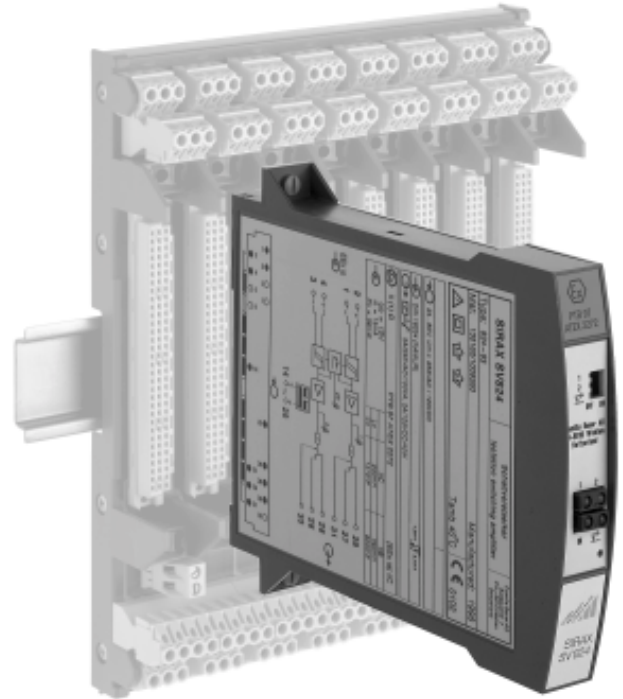


Fig. 1. Plug-in module SIRAX SV 824 for plugging onto backplane BP 902.

### Features / Benefits

- **Isolating switch amplifier plugs onto backplane** (mechanically latched by fasteners), **all electrical connections made to the backplane and not to the SIRAX SV 824** / Thus no wiring when replacing devices
- **Two channels according to DIN EN 50 227** (substitute for DIN 19 234:1990-06)
- **Output relays**
- **Electrical isolation between input, output and power supply according to IEC 1010 resp. EN 61 010**
- **AC/DC power supply / Universal**
- **In type of protection "Intrinsic safety" [EEx ia] IIC** (see "Table 4: Data on explosion protection")
- **Indication of the switching status by LED's**
- **Configurable input circuit monitor for detecting open and short-circuits**
- **Switch for setting the direction of action**

### Technical data

#### Signal inputs $\rightarrow$ (for channels I and II)

Type:	Binary signals, preferably from contactless sensors acc. to DIN EN 50 227, in type of protection "Intrinsic safety" EEx ia IIC
Number:	2 (S1 and S2) signal inputs S1 and S2 galvanically connected

#### Operating data

Open-circuit voltage:	Approx. 8.5 V DC
Internal resistance:	Approx. 1.1 k $\Omega$
Short-circuit current:	Approx. 8 mA
Switching level:	Off I $\leq$ 1.2 mA, On I $\geq$ 2.1 mA
Hysteresis:	0.2 mA
Line resistance:	Max. 50 $\Omega$


# Plug-in module SIRAX SV 824

## Isolating switch amplifier

### Output contacts

Output A1 and A2: Output contacts for channels I and II galvanically isolated

Table 1: Version of the output contacts **A1** and **A2**

Symbol	Material	Contact rating
	Gold flashed silver alloy	AC: $\leq 2 \text{ A} / 250 \text{ V}$ (100 VA) DC: $\leq 2 \text{ A} / 5 \dots 125 \text{ V}$ (40 W)

Relay approved by UL, CSA, SEV, VDE, SEMKO, ÖVE, EI, BSI, FIMKO

Mechanical life:  $> 5 \cdot 10^6$  operations

Switching delay: Approx. 50 ms

Direction of action of the output contacts

**A1** and **A2**: Adjustable by switch

### Maximum switching frequency

Input-relay output:  $\leq 10 \text{ Hz}$

### Signal input monitoring

Behaviour: Circuit break and shorting are signalled by the red LED and the output of the corresponding channel is disabled

Pick-up level according to DIN EN 50 227: Short-circuit  $I > \text{approx. } 6.3 \text{ mA}$   
Open-circuit  $I < \text{approx. } 0.15 \text{ mA}$

Effectiveness of input monitoring: Enabled or disabled by switch 

If the amplifier is a contact instead of an active sensor and the input circuit has to be monitored, two resistors must be fitted close to the contact as shown in Fig. 2.

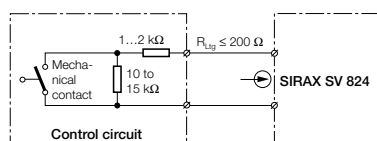


Fig. 2. Input contact circuit.

### Power supply H

AC/DC module (DC and 45...400 Hz)

Table 2: Nominal voltages and tolerances

Nominal voltage $U_N$	Tolerance
24... 60 V DC / AC	DC $-15 \dots +33\%$ AC $\pm 15\%$
85...230 V AC	$\pm 10\%$
85...110 V DC	$-15 \dots +10\%$

Power input:  $\leq 1.4 \text{ W}$  resp.  $\leq 2.7 \text{ VA}$

### Electrical isolation:

Signal inputs to output contacts and power supply

### Regulations

Electromagnetic compatibility: The standards DIN EN 50 081-2 and DIN EN 50 082-2 are observed

Intrinsically safe: Acc. to EN 50 020: 1994

Protection (acc. to IEC 529 resp. EN 60 529): Housing IP 40  
Terminals IP 00

Electrical standards: Acc. to IEC 1010 resp. EN 61 010

Operating voltages:  $< 300 \text{ V}$  between all circuits

Contamination level: 2

Overvoltage category: Output contacts and signal inputs II, power supply III

Double insulation: – Power supply to signal inputs and output contacts

– Signal inputs to outputs

– Output contacts to each other

Test voltage: Signal inputs to output contacts 2.3 kV, 50 Hz, 1 min.

Signal inputs to power supply 3.7 kV, 50 Hz, 1 min.

Output contacts to power supply 3.7 kV, 50 Hz, 1 min.

Output contact 1 to output contact 2 2.3 kV, 50 Hz, 1 min.

### Ambient conditions

Climatic rating: Climate class 3Z acc. to VDI/VDE 3540

Commissioning temperature:  $-10$  to  $+55 \text{ }^\circ\text{C}$

Operating temperature:	-25 to +55 °C, <b>Ex* -20</b> to +55 °C	Designation:	SIRAX SV 824
Storage temperature:	-40 to +70 °C	Mounting position:	Any
Relative humidity of annual mean:	≤ 75%	Electrical connections:	96-pin connector acc. to DIN 41 612, pattern C. Layout see Section "Electrical connections"
<b>Installation data</b>			
Housing:	Isolating switch amplifier in housing B17 for plugging onto backplane BP 902. Refer to Section "Dimensional drawing" for dimensions	Coding:	SIRAX SV 824 supplied already coded. The rack is coded by the user by fitting the coding inserts supplied
Material of housing:	Lexan 940 (polycarbonate), flammability class V-0 acc. to UL 94, self-extinguishing, non-dripping, free of halogen	Weight:	Approx. 160 g

*\* The data of the EC-Type Examination Certificate for backplane SIRAX BP 902 with admission PTB 97 ATEX 2113 should be noted!*

## Standard version

When ordering, it is only necessary to quote the **Order No.:**

Table 3: Instrument in [EEx ia] IIC version, (signal inputs intrinsically safe)

Description	Power supply (nominal voltage $U_N$ )	Order No.
Two-channel <b>isolating switch amplifier</b> Signal inputs in type of protection "Intrinsic safety" EEx ia IIC*	24 ... 60 V DC/AC	130 162
	85 ... 110 V DC 85 ... 230 V AC	130 170

\* Max. values see "Table 4: Data on explosion protection".

**Basic configuration:** Switch 1 in position "ON"  
Switch 2 in position "ON"  
Switch 3 in position "ON"

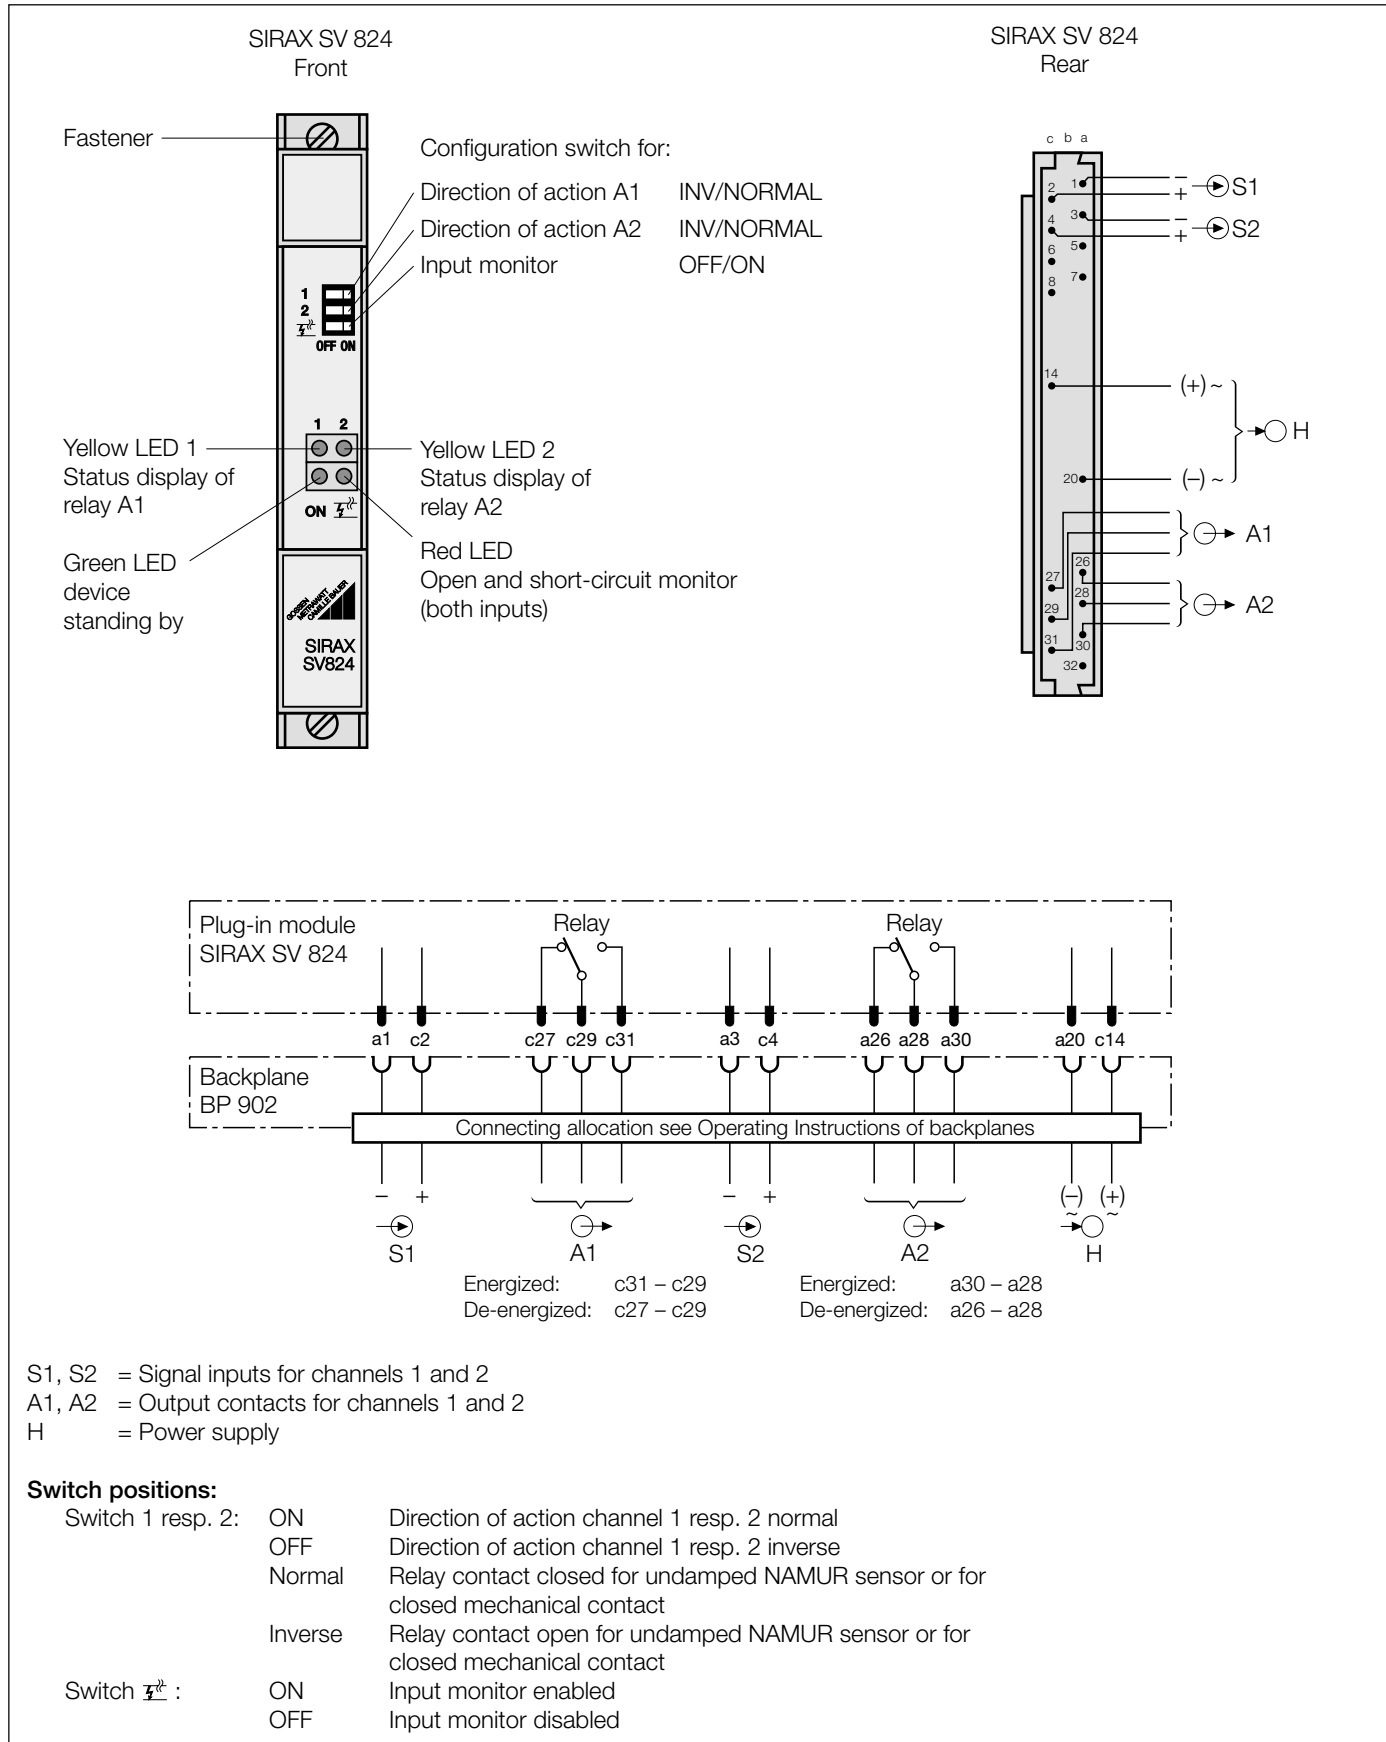
**Table 4: Data on explosion protection**  **II (1) G**

Type	Type of protection	Signal input	Type examination certificate	Mounting location of the instrument									
824 – 633 824 – 634	[EEx ia] IIC	$U_o = 12\text{ V}$ $I_o = 13\text{ mA}$ $P_o = 39\text{ mW}$ linear characteristic <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <td></td> <td>IIC</td> <td>IIB</td> </tr> <tr> <td><math>L_o</math></td> <td>200 mH</td> <td>730 mH</td> </tr> <tr> <td><math>C_o</math></td> <td>1.41 <math>\mu\text{F}</math></td> <td>9 <math>\mu\text{F}</math></td> </tr> </table>		IIC	IIB	$L_o$	200 mH	730 mH	$C_o$	1.41 $\mu\text{F}$	9 $\mu\text{F}$	PTB 97 ATEX 2272	<b>Outside</b> the hazardous area
	IIC	IIB											
$L_o$	200 mH	730 mH											
$C_o$	1.41 $\mu\text{F}$	9 $\mu\text{F}$											

# Plug-in module SIRAX SV 824

## Isolating switch amplifier

### Electrical connections

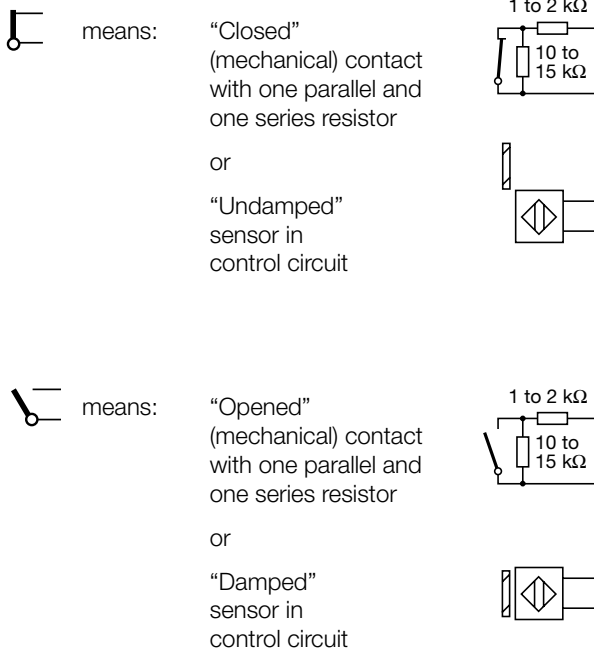


## Operating sense

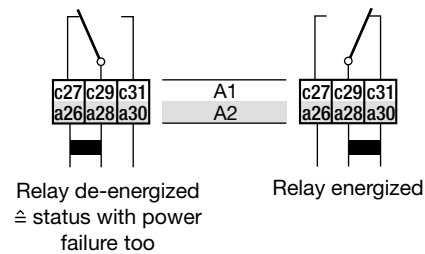
The statuses of outputs A1 and A2 and the LED's 1, 2 and  $\overline{1}$  for the different operating senses and input signals are given in Table 5.

## Explanation to the statuses of the signal inputs, contact outputs and LED displays

### Signal inputs S1 and S2



### Output contacts A1 and A2


















### LED displays LED 1, LED 2 and LED $\overline{1}$

⊗ means: "OFF" ( $\hat{=}$  status with power failure too)

● means: "ON"

Table 5: Function behaviour to connection of **sensors according to DIN EN 50 227 or mechanical contacts with one parallel and one series resistor**

Control circuit	Signal inputs S1 and S2 	LED display (red) Status	Output contacts A1 and A2 Status 	LED displays (yellow) LED 1 and LED 2 Status	Configuration switches	
					 Position *	 Position
 Normal operation		⊗		●	<input type="checkbox"/>	<input type="checkbox"/>
				⊗	<input type="checkbox"/>	<input type="checkbox"/>
				●	<input type="checkbox"/>	<input type="checkbox"/>
				●	<input type="checkbox"/>	<input type="checkbox"/>
 Open-circuit / short-circuit	(1)	●		⊗	<input type="checkbox"/>	(1)

(1) No influence

\* Where mechanical contacts are used **without a parallel and series resistor**, the switch « $\overline{1}$ » for monitoring the input must be switched to "OFF" (to the left ). The settings for the logic are the same as for "normal operation".

If only one channel of a dual-channel version is being used, a resistor (1 ... 15 kΩ) must be connected across the input which is not in use. This excludes any spurious operation in the red alarm LED.

# Plug-in module SIRAX SV 824

## Isolating switch amplifier

**Table 6: Accessories and spare parts**

Description	Order No.
<b>Coding comb with 12 sets of codes</b> (for coding the backplane BP 902)	107 971
<b>Operating Instructions SV 824-6 B d-f-e</b>	130 188

### Standard accessories

- 1 Operating Instructions for SIRAX SV 824, in three languages:  
German, French, English
- 1 Coding comb with 12 sets of codes
- 1 Type Examination Certificate

### Dimensional drawing

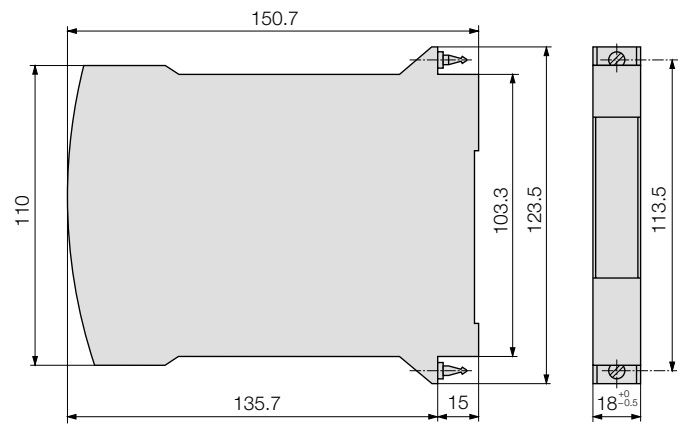


Fig. 3. SIRAX SV 824 in housing B17.



# Plug-in module SIRAX SV 824

## Isolating switch amplifier

---

Printed in Switzerland • Subject to change without notice • Edition 04.99 • Data sheet No. SV 824-6 Le

Camille Bauer Ltd

Aargauerstrasse 7  
CH-5610 Wohlen/Switzerland  
Phone +41 56 618 21 11  
Fax +41 56 618 24 58  
Telex 827 901 cbm ch

GOSSEN  
METRAWATT  
CAMILLE BAUER

