

INSTRUCTION MANUAL



KEPCO An ISO 9001 Company.

CA 33-R
COVER

ENCLOSURES AND HARDWARE SYSTEMS

DESCRIPTION. The Kepco Model CA 33-R RoHS-compliant Cover (see Figure 1) is supplied for use with Kepco Series RKW 30 Watt power supplies. The cover is installed by first removing two screws (M3 X 8) from the RKW power supply (see Figure 1). Then slide the cover onto the power supply, matching the tabs as shown in Detail A, and secure with screws previously removed. This screw must not be overtightened (max. torque 10 in.- lbs (1.1 N x m).


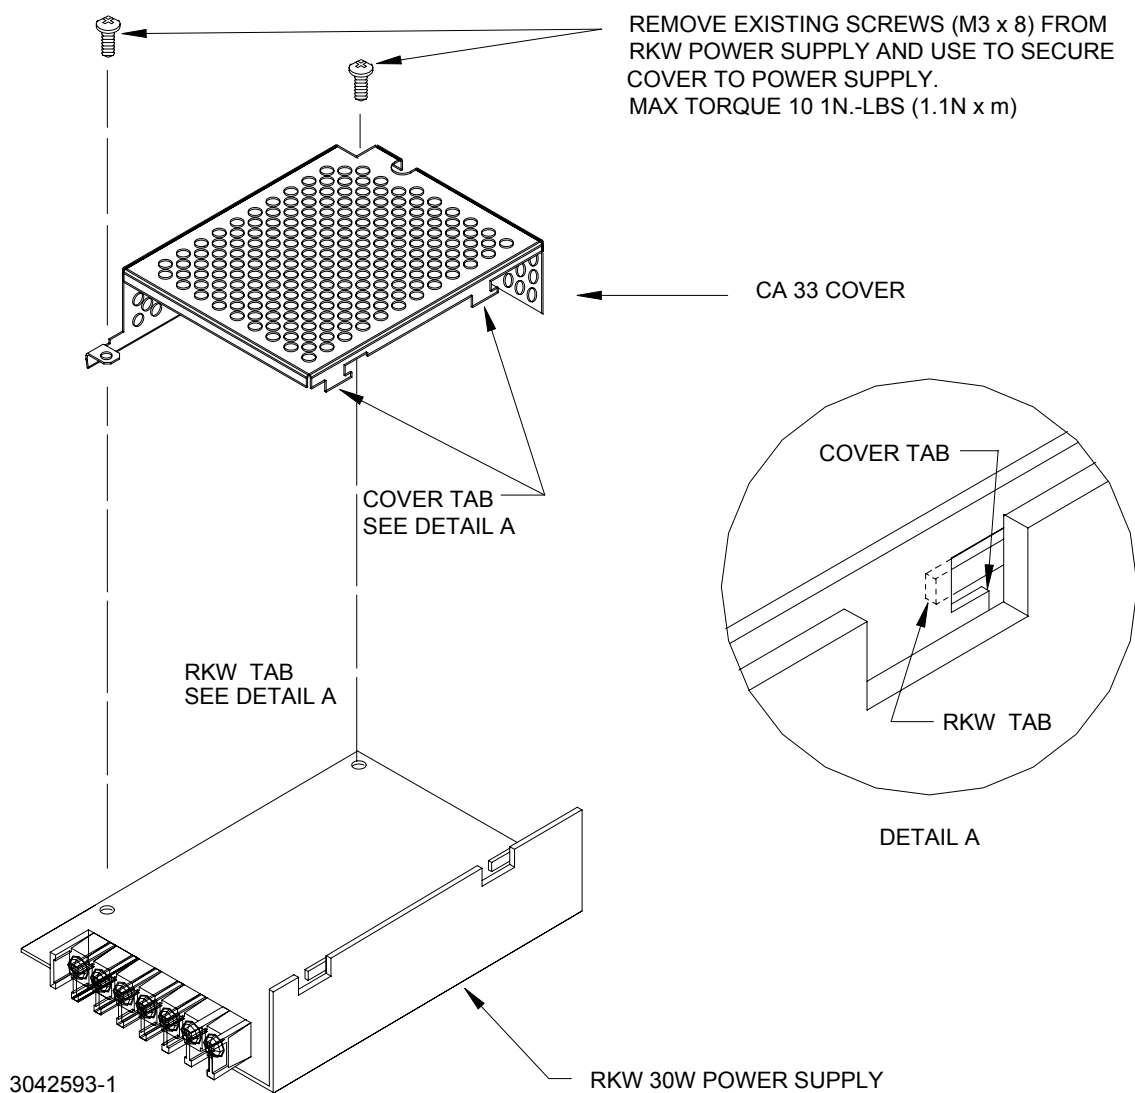


FIGURE 1. CA 33-R COVER INSTALLATION

KEPCO, INC. ● 131-38 SANFORD AVENUE ● FLUSHING, NY. 11352 U.S.A. ● TEL (718) 461-7000 ● FAX (718) 767-1102
<http://www.kepcopower.com> ● email: hq@kepcopower.com

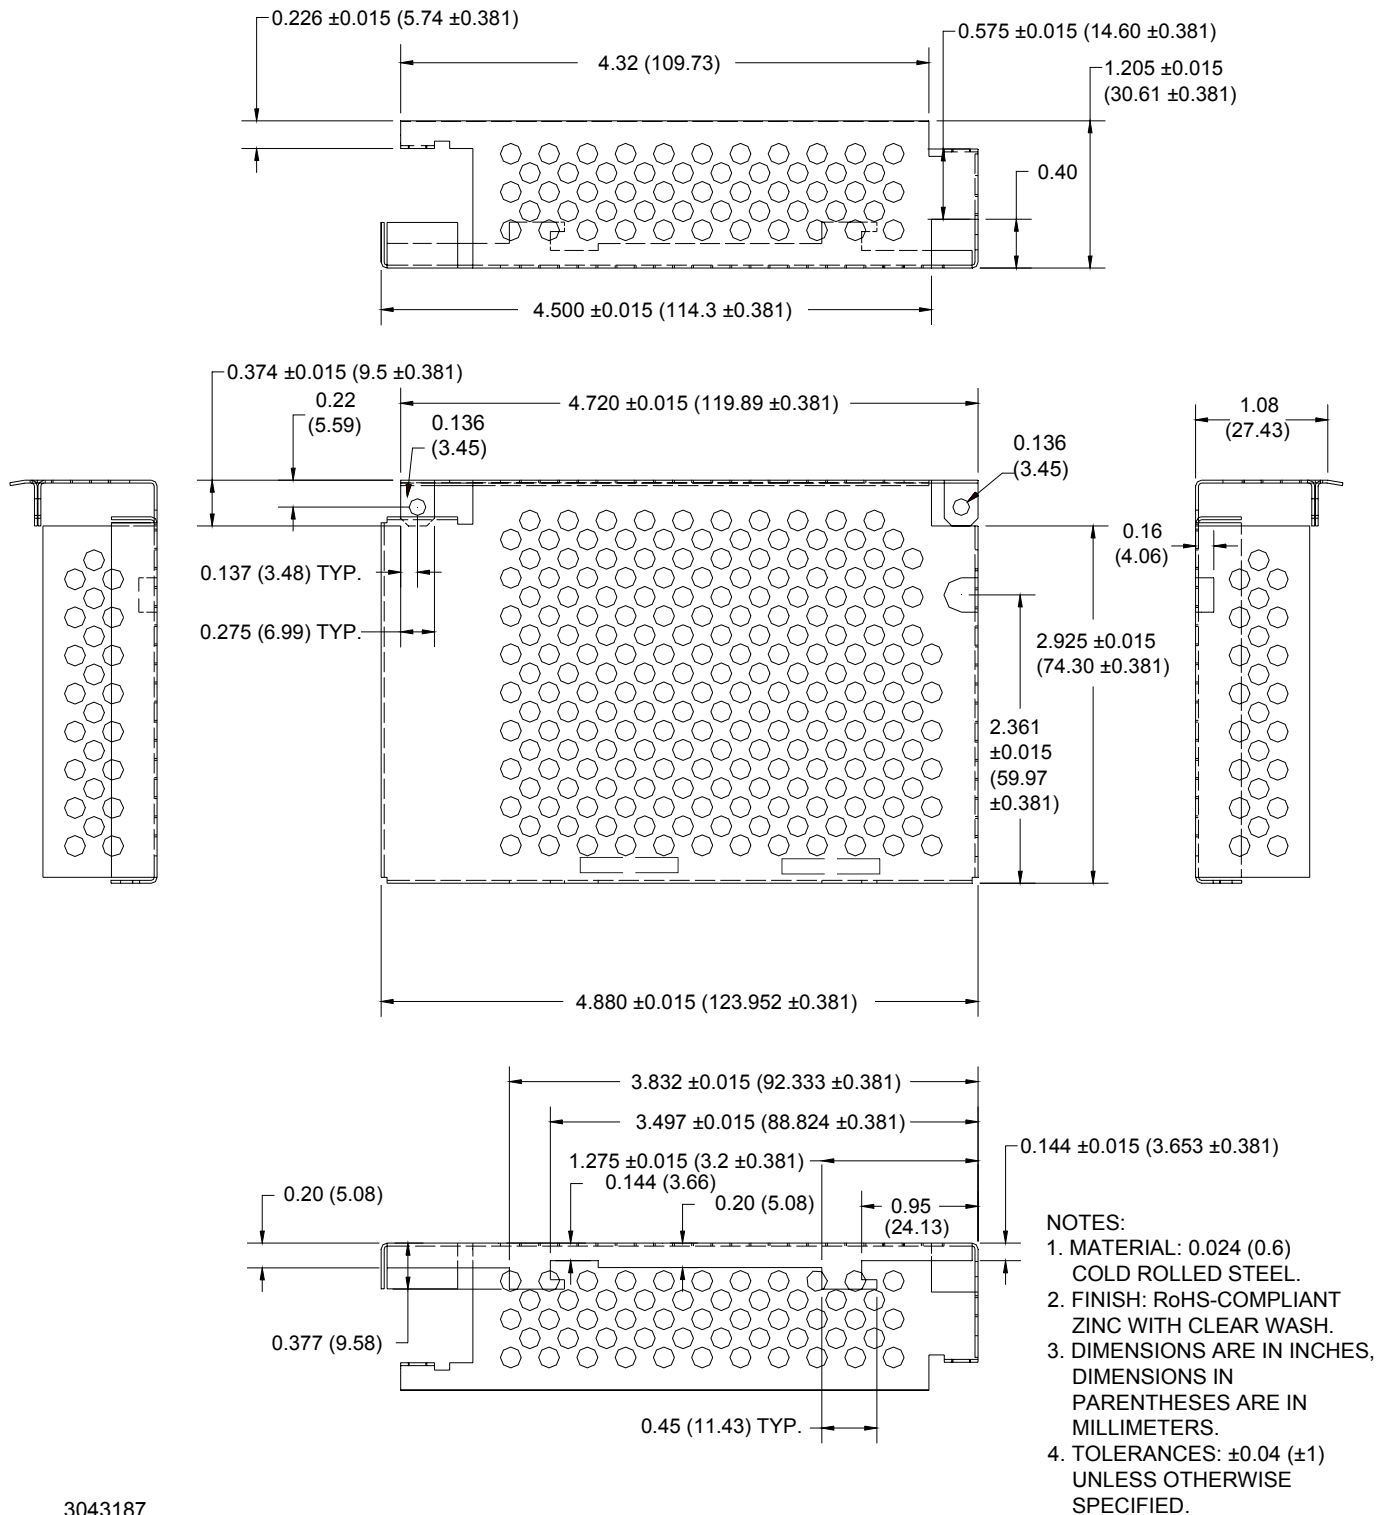

3043187

FIGURE 2. CA 33-R OUTLINE DIMENSIONS