# **Startup** Manual

# **Model PR300 Power and Energy Meter** <Installation>

Thank you for purchasing the PR300.

This manual describes the installation and wiring procedures of the PR300. The electronic manuals are also provided on the accompanying CD in addition to this manual. Read them along with this manual. To ensure correct use, be sure to read the PR300 Power and Energy Meter User's Manual (IM 77C01E01-01E) thoroughly before beginning opera-

#### Printed manuals (Electronic manuals [PDF files] are also provided on the accompanying CD.)

Model PR300 Power and Energy Meter Startup Manual <Installation>

IM 77C01E01-02E (This manual)

Model PR300 Power and Energy Meter Startup Manual <Initial Setup Operations>: IM 77C01E01-03E

#### Electronic manuals (PDF files)

Model PR300 Power and Energy Meter User's Manual

IM 77C01E01-01E

Model PR300 Power and Energy Meter Communication Interface User's Manual: IM 77C01F01-10F

Please keep this manual for future reference.



IM 77C01E01-02E

Yokogawa Electric Corporation

## Yokogawa Electric Corporation

Network Solutions Business Division 2-9-32, Naka-cho Musashino-shi, Tokyo 180-8750 Japan Phone: +81-422-52-7179 Facsimile: +81-422-52-6619

Record the parameter settings of the PR300 on MEMO column in Appendix 4, "Parameter List" of the user's manual (IM 77C01E01-01E) provided on the accompanying CD.

Note that in the case of a failure, the parameter settings set to the failed product cannot be restored.

# **Checking the Package**

Verify the package as explained below before starting to use the product. Should the delivered product be wrong or the package be missing any item, contact the vendor from which you purchased the product.

# **Checking the Model and Suffix Codes**

The PR300 bears a nameplate. Confirm that "MODEL" and "SUFFIX" (suffix codes) shown on the nameplate agree with those of the product or-


Model	Suffix Codes					Description			
PR300	-0					-6		-0	Power and Energy Meter
Phase and wire system	-3 -4 -5								Universal three-phase three-wire system (single-phase two-wire, single-phase three-wire, and three-phase three-wire systems) Universal three-phase four-wire system (single-phase two-wire, single-phase three-wire, three-phase three-wire, and three-phase four-wire systems) Three-phase four-wire system (2.5 element) *1
Input voltage input current	/	1		Ī		Ī	Ī		Universal voltage input *2 (150 V, 300 V, 600 V) / 1 A Universal voltage input *2 (150 V, 300 V, 600 V) / 5 A
Additional inpand output fu		ion	1 2 3						digital input     digital input, 1 analog output     digital input, 1 pulse output     digital input, 1 pulse output     digital input, 1 analog output, 1 pulse output
Communication 0 0 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1			Ī		RS-485 communication RS-485 communication, Ethernet communication *3*				
Optional measuring function 0 3							None  Demand measurement (1 demand alarm output)		
Power supply -6						-6		Ī	100-240 V AC ±10% (50/60 Hz) or 130-300 V DC ±15%
Phase indication format AR									A, B, and C indications R, S, and T indications
								-0	Always 0
*1 Can be used only when the voltage is in a state of equilibrium.									

- Set the voltage range (150 V, 300 V, or 600 V) according to the rated input voltage to be measured

#### Serial Number (NO.)

Also inform this number shown in "NO." on the nameplate when contacting the vendor from which you purchased the PR300.

#### Checking the Accessories

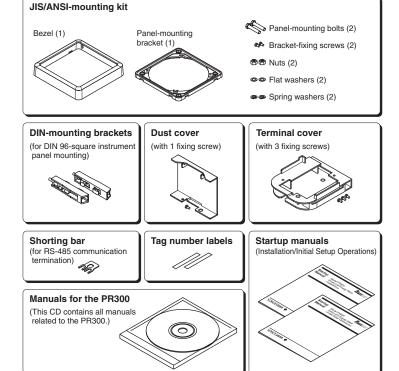

# **Safety Precautions**



## **WARNING**

- Install the PR300 in the secondary side of the exsting
- Provide spacing of 50 mm or more between the products.



#### NOTE

- Do not install the PR300 in the following types of environments, as they may cause the PR300 to malfunction or fail. Avoid sites:
  - exposed to significant shock or vibration; where corrosive gases are present; where large amounts of dust are present; exposed to water; exposed to direct sunlight; outside; at altitudes above 2000 m.
- The PR300 mounting position is for vertical panels only.



#### **WARNING**

- As there is a danger of electric shock, turn off the power supply and check that the cables to be connected are not conducting electricity before carring out the wiring procedure.
- For safety, be sure to install a circuit breaker switch that conforms to IEC 60947 near the PR300 so as to be operated easily, and clearly indicate that the device is used to de-energize the PR300.
- The wiring procedure for the PR300 should be carried out by a qualified person (an electrician etc.) with knowledge of electrical matters and who has actual experience.
- Install a current transformer (CT) inside a panel when using a conduit for wiring.
- If the voltage is below 600 V AC, it is possible to connect the PR300 directly without using a voltage transformer (VT) and if the current is below 5 A AC, it is possible to do so without using a current transformer (CT). However, in order to use the PR300 safely, the use of VT and CT is recommended. Use the UL-approved CT for the PR300.
- Perform wiring for the voltage and current input in the same
- Check the following before turning on the power. Using the PR300 beyond the stated specifications may cause it to heat up and burn out.
- Check that the power supply voltage, input voltage, and input current values to be applied to the PR300 agree with its specifications.
- Check that the external wiring is connected to the terminals in accordance with the specifications.
- Do not touch the screws in locations (a) to (f) shown in the wiring diagrams. They are an essential part of the structure of the PR300. Loosening or tightening them may result in a malfunction or failure of the PR300.
- Be sure to attach the terminal cover to prevent electric shock (refer to Chapter 3, "Attaching the Dust Cover and Terminal Cover").



#### NOTE

# When attaching the terminal cover


· Since the terminal cover of PR300 has the structure of preventing electric shock, the terminal cover cannot be attached after completing all wiring. Refer to Chapter 3, "Attaching the Dust Cover and Terminal Cover" before wiring.

Carry out the wiring referring to the diagrams in Sections 2.1 to 2.6. The wiring for voltage input, current input, and power supply is M4 screw terminal connection. For other wiring it is M3 screw terminal connection. The connector for connecting to the Ethernet is RJ45.

Use strand wires for the wiring. Wiring cables with a nominal cross-sectional area of 1.25 mm<sup>2</sup> or thicker are recommended for voltage/current input and power supply; cables with a nominal cross-sectional area of 0.5 mm<sup>2</sup> or thicker are recommended for other signals. Durable good-contact ring tongue crimping terminals are recommended to use.

# Ring tongue terminal

Applicable terminals		A (mm)	F (mm)	B (mm)
M4	4.4 max.	7.0 max.	7.8 max.	
М3	3.3 max.	5.8 max	6.7 max.	4.7 max.




al	Applicable terminals	Recommended tightening torque	Applicable wire size
-			1041 000 3
I	M4	1.2 N•m	1.04 to 2.63 mm <sup>2</sup>
	M3	0.6 N•m	0.25 to 1.65 mm <sup>2</sup>

# 1. Installation


## 1.1 Installation with the ANSI 4-inch Round Form


The PR300 can be installed so that it handles ANSI 4-inch round form or JIS 110-square instruments panel cutouts by attaching the "JIS/ANSImounting kit" accessory.

# 1.1.1 External Dimensions

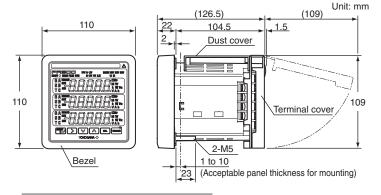

# Panel Cutout Dimensions

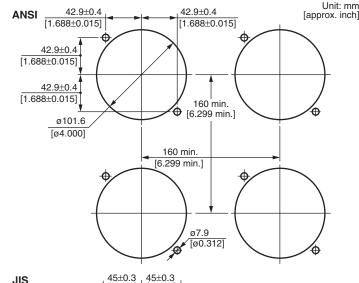

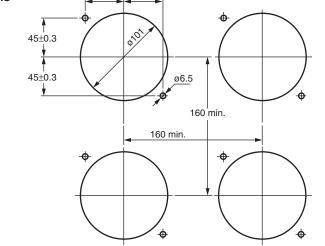


Normal Allowable Deviation=+(Value of JIS B 0401-1999 tolerance grade IT18) / 2

#### 1.1.3 Mounting Method


## 1 Set the direction of the panel-mounting bracket.


The diagram below shows the front of the bracket (the side into which the panel-mounting bolt is inserted). Rotating the bracket 90° makes the bracket compatible with either ANSI or JIS panel cutouts. Set the bracket to either the ANSI or JIS mark according to which type of panel you are installing, as shown in the diagram.

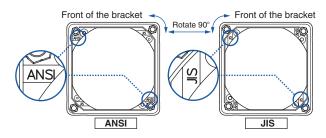

- 2 Insert two panel-mounting bolts into the front of the panel-mounting bracket as shown in the diagram.
- Fix the panel-mounting bracket securely to the back of the PR300 with two bracket-fixing screws as shown in the diagram.

  (recommended tightening torque: 0.4 N•m)
- 4 Attach the bezel from the front of the PR300.




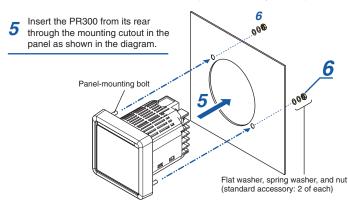


Secure the PR300's panel-mounting bolts by tightening them with the washers and nuts. (recommended tightening torque: 2.0 N•m)

# 1.2 Installation with the DIN 96-square Instrument Size

#### 1.2.1 External Dimensions

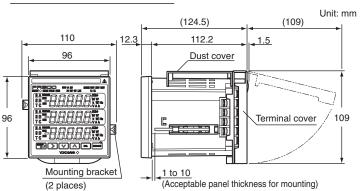


#### 1.2.2 Panel Cutout Dimensions

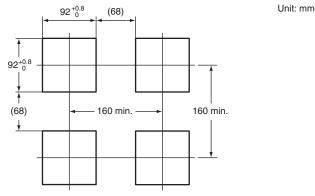


Normal Allowable Deviation= $\pm$ (Value of JIS B 0401-1999 tolerance grade IT18) / 2

# 1.2.3 Mounting Method

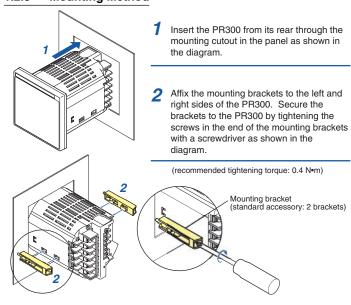


# 2. Wiring


# 2.1 Single-phase two-wire system

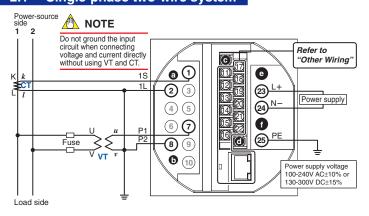


# 2.2 Single-phase three-wire system

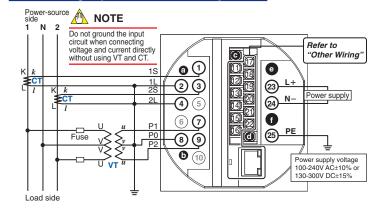


# 2.3 Three-phase three-wire system

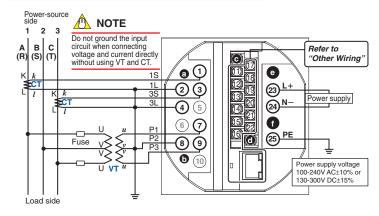


# 2.4 Three-phase four-wire system

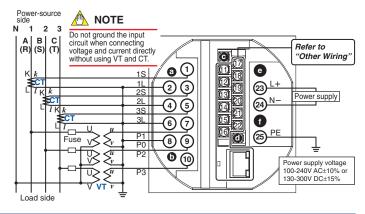

#### 2.5 Three-phase four-wire system (2.5 element)

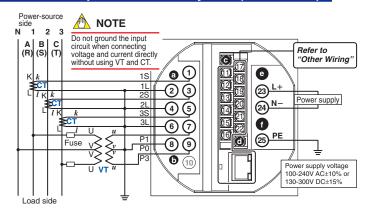

# 2.6 Other Wiring

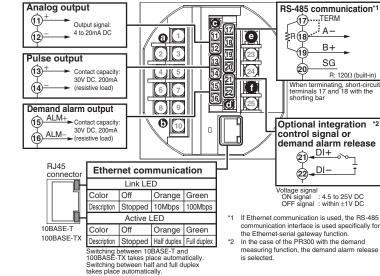

# 3. Attaching the Dust Cover and Terminal Cover




# **WARNING**

As there is a danger of electric shock, do not attach the dust cover and terminal cover while the wires are live.

- · Attach the dust cover before attaching the terminal cover.
- The recommended tightening torque for the screws for attaching the dust cover and terminal cover is 0.4N•m.


## 3.1 Attaching the Dust Cover

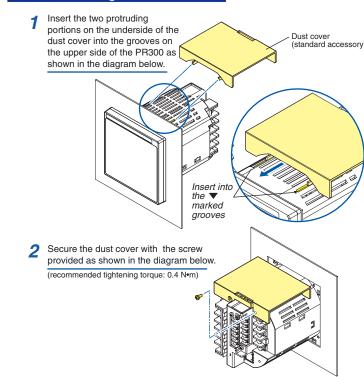



# 3.2 Attaching the Terminal Cover

Complete the wiring to the terminals 2, 4, 6, 8, 23, 24, and 25, then secure the terminal cover in the open state shown in the diagram below with the two screws provided.

Complete the wiring to other terminals with the terminal cover open shown in the diagram below.







IM 77C01E01-02E 1st Edition Apr.28, 2006-00