

---

**User's  
Manual**

**WX83  
AddObserver Runtime**

---

---

## Foreword

Thank you for purchasing the AddObserver Runtime. This user's manual contains useful information about the functions and operating procedures of this software. The AddObserver Runtime includes the software, AddObserver Panel. To ensure proper use of the instrument, please read this manual thoroughly before beginning operation. After reading the manual, keep it in a convenient location for quick reference in the event a question arises.

## Notes

- The contents of this manual are subject to change without prior notice as a result of improvements in the software's performance and functions.
- Every effort has been made in the preparation of this manual to ensure the accuracy of its contents. However, should you have any questions or find any errors, please contact your nearest YOKOGAWA.
- Copying or reproduction of all or any part of the contents of this manual without the permission of Yokogawa Electric Corporation is strictly prohibited.
- This software may not be used concurrently on multiple PCs. Use by more than one user is also prohibited.
- This software may not be forwarded to any third party.
- Yokogawa Electric Corporation does not warrant this product after it has been opened, unless there are physical defects in the original setup disk or this document.
- YOKOGAWA will not accept responsibility for any damage caused directly or indirectly as a result of using this software.
- The license number will not be reissued. Please keep the licence number in a safe place.

## Trademarks

- DAQWORX, DAQLOGGER, and DAQEXPLORER are registered trademarks or trademarks of Yokogawa Electric Corporation.
- Microsoft and Windows are registered trademarks or trademarks of Microsoft Corporation in the United States and/or other countries.
- Adobe and Acrobat are registered trademarks or trademarks of Adobe Systems Incorporated.
- Company and product names that appear in this manual are registered trademarks or trademarks of their respective holders.
- The company and product names used in this manual are not accompanied by the registered trademark or trademark symbols (® and ™).

## Revisions

- 1st Edition: July 2003
- 2nd Edition: August 2005
- 3rd Edition: March 2006
- 4th Edition: June 2007

---

# Terms and Conditions of the Software License

## **NOTICE - PLEASE READ CAREFULLY BEFORE USE**

Thank you very much for purchasing this medium containing a software program and related documentation provided by Yokogawa Electric Corporation (hereinafter called "Yokogawa"), and the program contained, embedded, inserted or used in the medium (hereinafter called the "Yokogawa Software Program").

By opening this package or plastic wrapping (hereinafter called "Package") enclosing the Yokogawa Software Program, you acknowledge that you understand and agree to the "Terms and Conditions of the Software License" (hereinafter called "Terms and Conditions") which is written in the documentation and separately attached. Accordingly, the Terms and Conditions bind you.

The Yokogawa Software Program and its related documentation including ownership of copyright shall remain the exclusive property of Yokogawa or those third parties from whom sublicensed software in the Yokogawa Software Program is licensed.

Yokogawa hereby grants you permission to use the Yokogawa Software Program on the conditions that you agree to the Terms and Conditions before you open the Package and/or install it in or onto a computer.

IF YOU DO NOT AGREE TO THE TERMS AND CONDITIONS, YOU CANNOT OPEN THE PACKAGE, AND MUST IMMEDIATELY RETURN IT TO YOKOGAWA OR ITS DESIGNATED PARTY.

## **Terms and Conditions of the Software License**

Yokogawa Electric Corporation, a Japanese corporation (hereinafter called "Yokogawa"), grants permission to use this Yokogawa Software Program (hereinafter called the "Licensed Software") to the Licensee on the conditions that the Licensee agrees to the terms and conditions stipulated in Article 1 hereof.

You, as the Licensee (hereinafter called "Licensee"), shall agree to the following terms and conditions for the software license (hereinafter called the "Agreement") based on the use intended for the Licensed Software.

Please note that Yokogawa grants the Licensee permission to use the Licensed Software under the terms and conditions herein and in no event shall Yokogawa intend to sell or transfer the Licensed Software to the Licensee.

Licensed Software Name: AddObserver Runtime (Model WX83)

Number of License: 1

### **Article 1 (Scope Covered by these Terms and Conditions)**

- 1.1 The terms and conditions stipulated herein shall be applied to any Licensee who purchases the Licensed Software on the condition that the Licensee consents to agree to the terms and conditions stipulated herein.
- 1.2 The "Licensed Software" herein shall mean and include all applicable programs and documentation, without limitation, all proprietary technology, algorithms, and know-how such as a factor, invariant or process contained therein.

### **Article 2 (Grant of License)**

- 2.1 Yokogawa grants the Licensee, for the purpose of single use, non-exclusive and non-transferable license of the Licensed Software with the license fee separately agreed upon by both parties.
- 2.2 The Licensee is, unless otherwise agreed in writing by Yokogawa, not entitled to copy, change, sell, distribute, transfer, or sublicense the Licensed Software.
- 2.3 The Licensed Software shall not be copied in whole or in part except for keeping one (1) copy for back-up purposes. The Licensee shall secure or supervise the copy of the Licensed Software by the Licensee itself with great, strict, and due care.
- 2.4 In no event shall the Licensee dump, reverse assemble, reverse compile, or reverse engineer the Licensed Software so that the Licensee may translate the Licensed Software into other programs or change it into a man-readable form from the source code of the Licensed Software. Unless otherwise separately agreed by Yokogawa, Yokogawa shall not provide the Licensee the source code for the Licensed Software.
- 2.5 The Licensed Software and its related documentation shall be the proprietary property or trade secret of Yokogawa or a third party which grants Yokogawa the rights. In no event shall the Licensee be transferred, leased, sublicensed, or assigned any rights relating to the Licensed Software.
- 2.6 Yokogawa may use or add copy protection in or onto the Licensed Software. In no event shall the Licensee remove or attempt to remove such copy protection.
- 2.7 The Licensed Software may include a software program licensed for re-use by a third party (hereinafter called "Third Party Software", which may include any software program from affiliates of Yokogawa made or coded by themselves.) In the case that Yokogawa is granted permission to sublicense to third parties by any licensors (sub-licensor) of the Third Party Software pursuant to different terms and conditions than those stipulated in this Agreement, the Licensee shall observe such terms and conditions of which Yokogawa notifies the Licensee in writing separately.
- 2.8 In no event shall the Licensee modify, remove or delete a copyright notice of Yokogawa and its licensor contained in the Licensed Software, including any copy thereof.

### **Article 3 (Restriction of Specific Use)**

- 3.1 The Licensed Software shall not be intended specifically to be designed, developed, constructed, manufactured, distributed or maintained for the purpose of the following events:
  - a) Operation of any aviation, vessel, or support of those operations from the ground;
  - b) Operation of nuclear products and/or facilities;
  - c) Operation of nuclear weapons and/or chemical weapons and/or biological weapons; or
  - d) Operation of medical instrumentation directly utilized for humankind or the human body.
- 3.2 Even if the Licensee uses the Licensed Software for the purposes in the preceding Paragraph 3.1, Yokogawa has no liability to or responsibility for any demand or damage arising out of the use or operations of the Licensed Software, and the Licensee agrees, on its own responsibility, to solve and settle the claims and damages and to defend, indemnify or hold Yokogawa totally harmless, from or against any liabilities, losses, damages and expenses (including fees for recalling the Products and reasonable attorney's fees and court costs), or claims arising out of and related to the above-said claims and damages.

### **Article 4 (Warranty)**

- 4.1 The Licensee shall agree that the Licensed Software shall be provided to the Licensee on an "as is" basis when delivered. If defect(s), such as damage to the medium of the Licensed Software, attributable to Yokogawa is found, Yokogawa agrees to replace, free of charge, any Licensed Software on condition that the defective Licensed Software shall be returned to Yokogawa's specified authorized service facility within seven (7) days after opening the Package at the Licensee's expense. As the Licensed Software is provided to the Licensee on an "as is" basis when delivered, in no event shall Yokogawa warrant that any information on or in the Licensed Software, including without limitation, data on computer programs and program listings, be completely accurate, correct, reliable, or the most updated.
- 4.2 Notwithstanding the preceding Paragraph 4.1, when third party software is included in the Licensed Software, the warranty period and terms and conditions that apply shall be those established by the provider of the third party software.

- 4.3 When Yokogawa decides in its own judgement that it is necessary, Yokogawa may from time to time provide the Licensee with Revision upgrades and Version upgrades separately specified by Yokogawa (hereinafter called "Updates").
- 4.4 Notwithstanding the preceding Paragraph 4.3, in no event shall Yokogawa provide Updates where the Licensee or any third party conducted renovation or improvement of the Licensed Software.
- 4.5 THE FOREGOING WARRANTIES ARE EXCLUSIVE AND IN LIEU OF ALL OTHER WARRANTIES OF QUALITY AND PERFORMANCE, WRITTEN, ORAL, OR IMPLIED, AND ALL OTHER WARRANTIES INCLUDING ANY IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE ARE HEREBY DISCLAIMED BY YOKOGAWA AND ALL THIRD PARTIES LICENSING THIRD PARTY SOFTWARE TO YOKOGAWA.
- 4.6 Correction of nonconformity in the manner and for the period of time provided above shall be the Licensee's sole and exclusive remedy for any failure of Yokogawa to comply with its obligations and shall constitute fulfillment of all liabilities of Yokogawa and any third party licensing the Third Party Software to Yokogawa (including any liability for direct, indirect, special, incidental or consequential damages) whether in warranty, contract, tort (including negligence but excluding willful conduct or gross negligence by Yokogawa) or otherwise with respect to or arising out of the use of the Licensed Software.

**Article 5 (Infringement)**

- 5.1 If and when any third party should demand injunction, initiate a law suit, or demand compensation for damages against the Licensee under patent right (including utility model right, design patent, and trade mark), copy right, and any other rights relating to any of the Licensed Software, the Licensee shall notify Yokogawa in writing to that effect without delay.
- 5.2 In the case of the preceding Paragraph 5.1, the Licensee shall assign to Yokogawa all of the rights to defend the Licensee and to negotiate with the claiming party. Furthermore, the Licensee shall provide Yokogawa with necessary information or any other assistance for Yokogawa's defense and negotiation. If and when such a claim should be attributable to Yokogawa, subject to the written notice to Yokogawa stated in the preceding Paragraph 5.1, Yokogawa shall defend the Licensee and negotiate with the claiming party at Yokogawa's cost and expense and be responsible for the final settlement or judgment granted to the claiming party in the preceding Paragraph 5.1.
- 5.3 When any assertion or allegation of the infringement of the third party's rights defined in Paragraph 5.1 is made, or when at Yokogawa's judgment there is possibility of such assertion or allegation, Yokogawa will, at its own discretion, take any of the following countermeasures at Yokogawa's cost and expense.
  - a) To acquire the necessary right from a third party which has lawful ownership of the right so that the Licensee will be able to continue to use the Licensed Software;
  - b) To replace the Licensed Software with an alternative one which avoids the infringement; or
  - c) To remodel the Licensed Software so that the Licensed Software can avoid the infringement of such third party's right.
- 5.4 If and when Yokogawa fails to take either of the countermeasures as set forth in the preceding subparagraphs of Paragraph 5.3, Yokogawa shall indemnify the Licensee only by paying back the price amount of the Licensed Software which Yokogawa has received from the Licensee. THE FOREGOING PARAGRAPHS STATE THE ENTIRE LIABILITY OF YOKOGAWA AND ANY THIRD PARTY LICENSING THIRD PARTY SOFTWARE TO YOKOGAWA WITH RESPECT TO INFRINGEMENT OF THE INTELLECTUAL PROPERTY RIGHTS INCLUDING BUT NOT LIMITED TO, PATENT AND COPYRIGHT.

**Article 6 (Liabilities)**

- 6.1 If and when the Licensee should incur any damage relating to or arising out of the Licensed Software or service that Yokogawa has provided to the Licensee under the conditions herein due to a reason attributable to Yokogawa, Yokogawa shall take actions in accordance with this Agreement. However, in no event shall Yokogawa be liable or responsible for any special, incidental, consequential and/or indirect damage, whether in contract, warranty, tort, negligence, strict liability, or otherwise, including, without limitation, loss of operational profit or revenue, loss of use of the Licensed Software, or any associated products or equipment, cost of capital, loss or cost of interruption of the Licensee's business, substitute equipment, facilities or services, downtime costs, delays, and loss of business information, or claims of customers of Licensee or other third parties for such or other damages. Even if Yokogawa is liable or responsible for the damages attributable to Yokogawa and to the extent of this Article 6, Yokogawa's liability for the Licensee's damage shall not exceed the price amount of the Licensed Software or service fee which Yokogawa has received. Please note that Yokogawa shall be released or discharged from part or all of the liability under this Agreement if the Licensee modifies, remodels, combines with other software or products, or causes any deviation from the basic specifications or functional specifications, without Yokogawa's prior written consent.
- 6.2 All causes of action against Yokogawa arising out of or relating to this Agreement or the performance or breach hereof shall expire unless Yokogawa is notified of the claim within one (1) year of its occurrence.
- 6.3 In no event, regardless of cause, shall Yokogawa assume responsibility for or be liable for penalties or penalty clauses in any contracts between the Licensee and its customers.

**Article 7 (Limit of Export)**

Unless otherwise agreed by Yokogawa, the Licensee shall not directly or indirectly export or transfer the Licensed Software to any countries other than those where Yokogawa permits export in advance.

**Article 8 (Term)**

This Agreement shall become effective on the date when the Licensee receives the Licensed Software and continues in effect unless or until terminated as provided herein, or the Licensee ceases using the Licensed Software by itself or with Yokogawa's thirty (30) days prior written notice to the Licensee.

**Article 9 (Injunction for Use)**

During the term of this Agreement, Yokogawa may, at its own discretion, demand injunction against the Licensee in case that Yokogawa deems that the Licensed Software is used improperly or under severer environments other than those where Yokogawa has first approved, or any other condition which Yokogawa may not permit.

**Article 10 (Termination)**

Yokogawa, at its sole discretion, may terminate this Agreement without any notice or reminder to the Licensee if the Licensee violates or fails to perform this Agreement. However, Articles 5, 6, and 11 shall survive even after the termination.

**Article 11 (Jurisdiction)**

Any dispute, controversies, or differences between the parties hereto as to interpretation or execution of this Agreement shall be resolved amicably through negotiation between the parties upon the basis of mutual trust. Should the parties fail to agree within ninety (90) days after notice from one of the parties to the other, both parties hereby irrevocably submit to the exclusive jurisdiction of the Tokyo District Court (main office) in Japan for settlement of the dispute.

**Article 12 (Governing Law)**

This Agreement shall be governed by and construed in accordance with the laws of Japan. The Licensee expressly agrees to waive absolutely and irrevocably and to the fullest extent permissible under applicable law any rights against the laws of Japan which it may have pursuant to the Licensee's local law.

**Article 13 (Severability)**

In the event that any provision hereof is declared or found to be illegal by any court or tribunal of competent jurisdiction, such provision shall be null and void with respect to the jurisdiction of that court or tribunal and all the remaining provisions hereof shall remain in full force and effect.

---

# Overview of This Manual

## Structure of This Manual

This manual consists of three chapters and an index as shown below.

Chapter	Title	Description
1	<b>Before Using the Software</b>	Gives an overview of the AddObserver Runtime. Also provides a list of PC system requirements and instructions for installing the software.
2	<b>Monitoring with AddObserver Panel</b>	Explains how to use a panel to monitor measured data, how to configure label displays, and how to display trend graphs.
3	<b>Responding to Error Messages</b>	Lists each error message and their corrective actions, and explains how to check the version of the AddObserver Panel.
<b>Index</b>		An alphabetical index.

## Scope of This Manual

This manual explains the basic operations of the software when operated on Windows 2000, Windows XP, and Windows Vista. For specific information on your operating system please refer to the user's guide that came with it.

## Conventions Used in This Manual

- **Units**

K: Denotes *1024*. Example: 100 KB

M: Denotes *1024 K*. Example: 100 MB

- **Bolded Items**

Items set in boldface mainly refer to on-screen interface elements such as menus, commands, dialog boxes, and buttons, or keys on the keyboard.

- **Headings Used for Descriptions of Operations**

The following headings are used to distinguish procedural instructions from other information given in chapters 1 through 3.

***Operating Procedure*** This subsection contains the operating procedure used to carry out the function described in the current chapter. All procedures are written for inexperienced users. Experienced users may not need to carry out all the steps.

- **Note**

Calls attention to information that is important for proper operation of the software.

# Contents


Foreword .....	i
Terms and Conditions of the Software License .....	ii
Overview of This Manual .....	iv
<b>Chapter 1 Before Using the Software</b>	
1.1 Overview of the AddObserver Runtime .....	1-1
1.2 System Requirements and Supported Monitor Servers .....	1-7
1.3 Connecting to the Monitor Server .....	1-9
<b>Chapter 2 Monitoring with AddObserver Panel</b>	
2.1 Starting AddObserver Panel .....	2-1
2.2 Opening the Panel, Connecting to the Monitor Server, and Checking the Communication Status .....	2-2
2.3 Switching Label Displays .....	2-4
2.4 Pausing and Resuming the Panel Display .....	2-5
2.5 Disconnecting/Reconnecting the Monitor Server .....	2-6
2.6 Restricting Operation of Out Objects .....	2-7
2.7 Changing the Trend Graph, Extended Trend Graph, and X-Y Graph Display Method ....	2-8
2.8 Operating the Tab Display .....	2-14
2.9 Operating a Numeric Out Object .....	2-15
2.10 Operating the Selectable Out Object .....	2-16
2.11 Operating Temperature Controller Parts .....	2-17
2.12 Playing, Stopping, and Acknowledging Alarm Sounds .....	2-19
2.13 Closing the Panel .....	2-20
2.14 Exiting AddObserver Panel .....	2-21
<b>Chapter 3 Responding to Error Messages</b>	
3.1 Error Messages and Their Corrective Actions .....	3-1
3.2 Checking the Version of the AddObserver Panel .....	3-2

## Index

# 1.1 Overview of the AddObserver Runtime

## AddObserver Runtime

AddObserver Runtime Package is a monitoring application that connects with monitor servers from YOKOGAWA'S DAQ32 Plus, DAQEXPLORER, DAQLOGGER, MXLOGGER, GateCONTROL and GateEye, and displays the acquired measurement data on user-created monitor screens. The monitoring screen (panel) can be custom-ordered through one of our representatives.

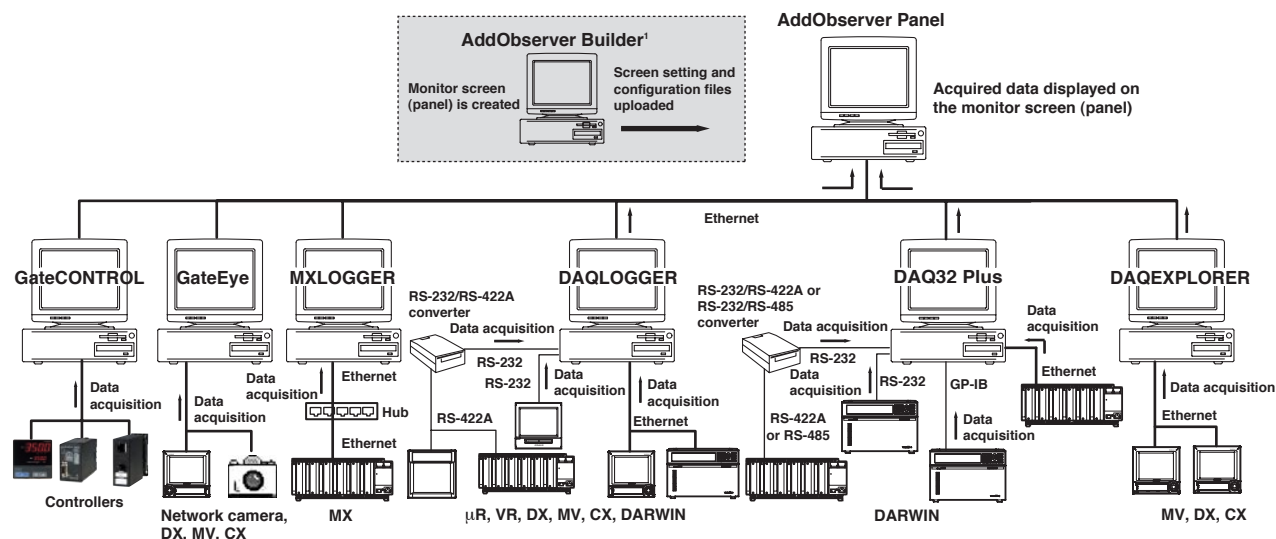


<sup>1</sup> The AddObserver Runtime Package does not include the software, AddObserver Builder. Please inquire with one of our representatives for more information on AddObserver Builder, the development tool for creating monitor screens.

The software's main functions are as follows:

- Reads in the setting files (with extension .gob) and configuration files (with extension .cob) for the monitor screen (panel) created by our representative, and allows you to monitor measurement data acquired on the DAQ32 Plus, DAQEXPLORER, DAQLOGGER, MXLOGGER, or GateCONTROL and Screen data on the GateEye.
- Allows you to switch to labels to display channel numbers, tag numbers, and tag comments.
- Displays data from multiple monitor servers (DAQ32 Plus, DAQEXPLORER, or DAQLOGGER), GateCONTROL and GateEye on a single panel.
- Able to connect with up to 16 servers simultaneously.
- Displays up to 16 screens.

## An Example of a Panel and Its Objects

- **Example Panel**

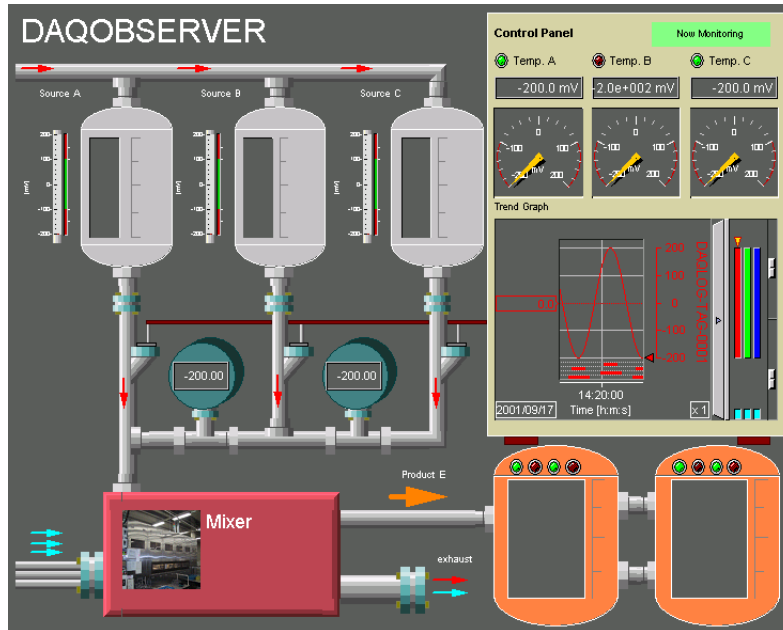

- **Panel Objects**

A panel is made up of objects that display such information as measured data, waveforms, and alarms.

- **Value Rectangle**

Displays the value of a specified channel in a rectangle whose top and bottom sides correspond to the maximum and minimum values for that channel.




- **Indicator**

Displays the specified alarm. Blinks red during an alarm, and lights green when no alarm is occurring. Remains black if no alarms are specified.




- **Digital**

Displays the value of the specified channel in digital format.



- **Bar Meter**

Displays the value of the specified channel in bar format.






- **Analog Meter**

Displays the value of the specified channel on an analog dial.



- **Thermometer**

Displays the value of the specified channel on a thermometer.



- **Meter Set**

Meter sets consist of a tag, four indicators, and a meter object. Tags display the tag name of the specified channel. Indicators display alarms 1 through 4 on the specified channel in order from left to right. Meter objects display the value of the specified channel in digital, analog, bar, or thermometer formats.


- **Digital Meter Set**

A meter set with a digital meter.



- **Bar Meter Set**

A meter set with a bar meter.




- **Analog Meter Set**

A meter set with an analog dial.



- **Thermometer Set**

A meter set with a thermometer.




## 1.1 Overview of the AddObserver Runtime Package

---

- **Trend Graph**

Displays waveforms for the specified channels.

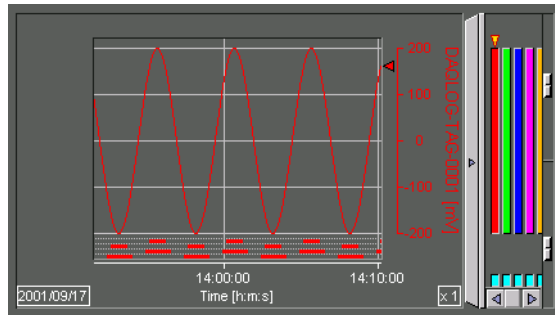

- **Picture**

A user-specified bitmapped image.



- **Button**


Performs one of the following functions that is assigned to the button.

- Acknowledge the alarm occurrence and stop the alarm sound.
- Show the monitor window that is assigned to the button.
- Hide the monitor window that is assigned to the button.



- **Monitor**

Arranges the GateEye images.

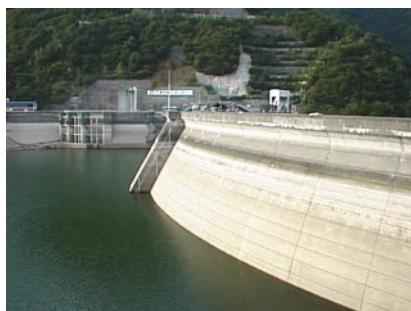

- **Numeric Out**

Sends numerical values to the I/O Channel host.

Displays the values from the channels corresponding to output channels.



• **Selectable Out**



Selects strings to which numerical values are registered and sends them to the I/O Channel host.

Converts values from channels corresponding to output channels to character strings registered on the builder and displays them.




• **Temperature Controller Parts**

Displays the screens of the temperature controller parts to which controllers were assigned.

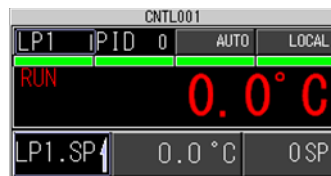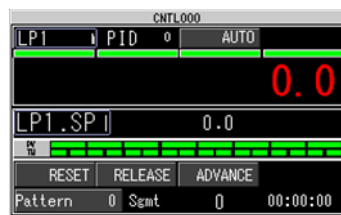

• **Extended Trend Graph**

The extended trend graph displays up to 1600 of the same FIFO channels.

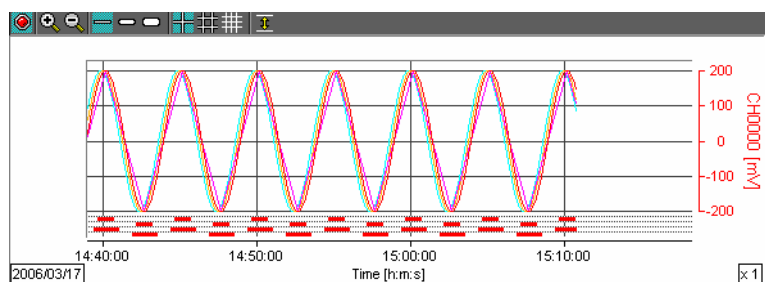

• **Extended Indicator**


Blinks in the color specified for alarms in AddObserver when an alarm occurs on one of the several assigned channels (alarms). If an alarm occurred in the past, the outline of the extended indicator blinks in red. If you click the indicator, just the outline returns to normal.



## 1.1 Overview of the AddObserver Runtime Package

- **X-Y Graph**

The X-Y graph displays waveforms from up to 32 channels each on the X and Y axes. Only the number of data specified on AddObserver Builder are displayed as waveforms. The operation of the graph is the same as that of the trend and extended trend graph.

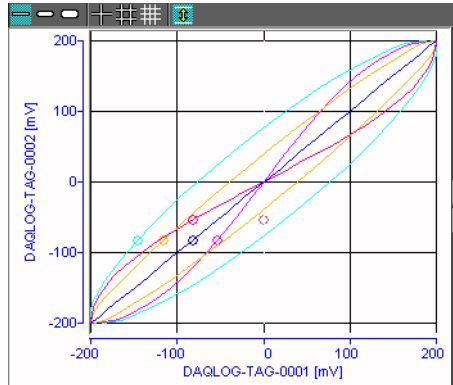

- **Alarm Summary**

Up to 100 past alarms can be displayed in specified channel range.

The figure shows a window titled 'Alarm Summary' displaying a list of 12 alarms. Each entry includes a status icon (green for Off, red for On), a direction arrow (up for High, down for Low), a timestamp, a tag name, and a limit level.

Status	Direction	Timestamp	Tag Name	Limit Level	State
Green	Up	2006/03/17 15:15:45.000	DAQLOG-TAG-0003	L1 H	Off
Green	Up	2006/03/17 15:16:05.000	DAQLOG-TAG-0001	L3 H	Off
Green	Up	2006/03/17 15:16:05.000	DAQLOG-TAG-0002	L3 H	Off
Green	Up	2006/03/17 15:16:05.000	DAQLOG-TAG-0003	L3 H	Off
Red	Down	2006/03/17 15:16:55.000	DAQLOG-TAG-0001	L4 L	On
Red	Down	2006/03/17 15:16:55.000	DAQLOG-TAG-0002	L4 L	On
Red	Down	2006/03/17 15:16:55.000	DAQLOG-TAG-0003	L4 L	On
Red	Down	2006/03/17 15:17:10.000	DAQLOG-TAG-0001	L2 L	On
Red	Down	2006/03/17 15:17:10.000	DAQLOG-TAG-0002	L2 L	On
Red	Down	2006/03/17 15:17:10.000	DAQLOG-TAG-0003	L2 L	On
Red	Down	2006/03/17 15:17:15.000	DAQLOG-TAG-0004	L4 L	On

## 1.2 System Requirements and Supported Monitor Servers

### PC System Requirements

- **Operating System (OS)**

Run DAQWORX under any of the following operating systems.

- Windows 2000 Professional SP4
- Windows XP Home Edition SP2
- Windows XP Professional SP2 (excluding Windows XP Professional x64 Edition)
- Windows Vista Home Premium (excluding the 64-bit edition)
- Windows Vista Business (excluding the 64-bit edition)

The language displayed by the software under different language versions of the OS are as follows.

OS Language	Software Language
Japanese	Japanese
Other	English

- **PC**

A PC that runs one of the OS above, and that meets the following CPU and memory requirements.

**When Using Windows 2000 or Windows XP**

Pentium 4, 1.6 GHz or faster

512 MB or more of memory

**When Using Windows Vista**

Pentium 4, 3 GHz or faster

2 GB or more of memory

- **Hard Disk**

Free disk space: 200 MB or more

- **CD-ROM Drive (for Use during Installation)**

- **Mouse**

A mouse supported by the OS.

- **Monitor**

**When Using Windows 2000 or Windows XP**

A monitor supported by the OS of 1024 × 768 dpi or higher and 65,536 colors or more.

**When Using Windows Vista**

A video card recommended for use with Vista and a monitor supported by the OS of 1024 × 768 dpi or higher and 65,536 colors or more.

- **Communications Interface**

An Ethernet port supported by your operating system. Also, TCP/IP must be installed.

**Note**

- Do not use the time zone settings in the Windows Autoexec.bat file. If you see lines such as *TZ-GTM0* in your Autoexec.bat file, deactivate them by inserting a REM command in front.
- This software will not support data acquired after the year 2038.

## 1.2 System Requirements and Supported Monitor Servers

---

### Supported Monitor Servers

AddObserver Panel can connect to the following five monitor servers.

- DAQ32 Plus
- DAQEXPLORER (R2.03 or later)
- DAQLOGGER
- MXLOGGER
- GateCONTROL
- GateEye

#### **Note**

---

- The AddObserver can connect with up to 16 monitor servers simultaneously.
  - To maximize connection speeds, we recommend that you reduce the traffic on the network when using the DAQ32 Plus and DAQLOGGER, and make sure that you are running the latest version of the software.
-

## 1.3 Connecting to the Monitor Server

To use the functions of this software, it is necessary to connect to either the DAQ32 Plus, DAQEXPLORER, DAQLOGGER, or MXLOGGER monitor server and GateEye. Connect to the server you will be using, then proceed to chapter 2, “Using the AddObserver Panel.”

### ***Operating Procedure***

#### **For DAQ32 Plus**

1. Start DAQ32 Plus. For details, see section 2.1, “Launcher Software” in the DAQ32 Plus User’s Manual (IM DP320-61E).
2. Start the logger software. For details, see section 5.1, “Operating Logger Software” in the DAQ32 Plus User’s Manual (IM DP320-61E).
3. Start the monitor server. For details, see section 5.16, “Using the Monitor Server” in the DAQ32 Plus User’s Manual (IM DP320-61E).

#### **For DAQEXPLORER**

Start DAQEXPLORER R2.03 or later (DAQ Desktop). For details, see section 2.1, “Starting and Exiting the DAQ Desktop” in the DAQEXPLORER User’s Manual (IM 04L02A01-62E).

#### **For DAQLOGGER**

1. Start the DAQLOGGER. For details, see section 2.3, “Starting DAQLOGGER” in the DAQLOGGER User’s Manual (IM 04D05C01-62E).
2. Start the monitor server. For details, see section 2.12, “Setting Up the Monitor Server” in the DAQLOGGER User’s Manual (IM 04D05C01-62E).

#### **For MXLOGGER**

1. Start the MXLOGGER. For details, see the MXLOGGER User’s Manual (IM WX103-01E).
2. Start the monitor server. For details, see the MXLOGGER User’s Manual (IM WX103-01E).

#### **For GateCONTROL**

Start the GateCONTROL. For details, see the GateCONTROL User’s Manual (IM WX1-07E).

#### **For GateEye**


Start the GateEye. For details, see the GateEye User’s Manual (IM WX1-01E).

## 2.1 Starting AddObserver Panel

### Operating Procedure

Select **Start > Programs > YOKOGAWA DAQWORX > AddObserver Runtime > Panel**.

AddObserver Panel starts, and the Panel screen is displayed.

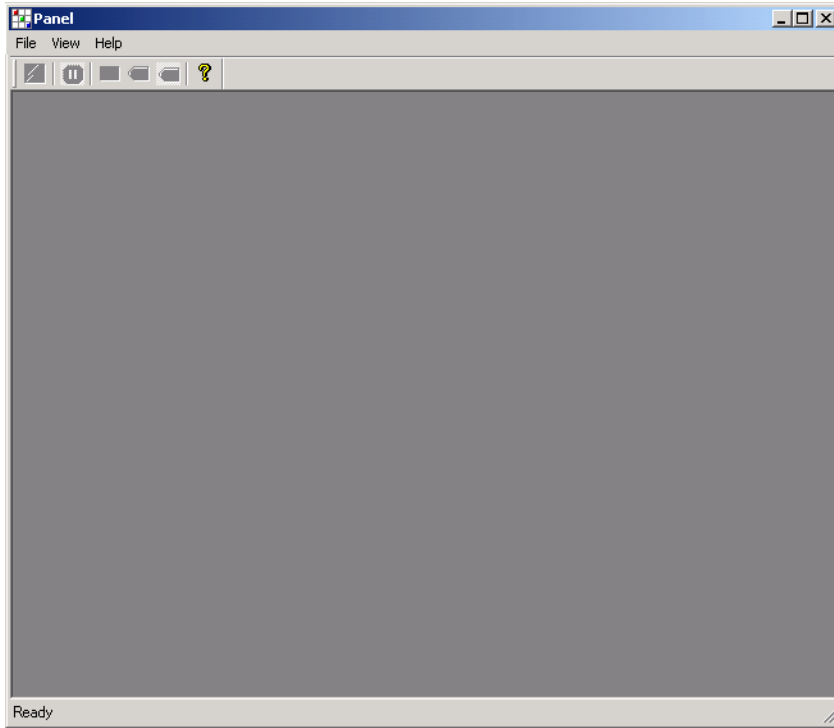

### Note


When installing AddObserver Panel from the AddObserver, select **Start > Programs > YOKOGAWA DAQWORX > AddObserver > Panel**.




## 2.2 Opening the Panel, Connecting to the Monitor Server, and Checking the Communication Status

### Opening the Panel Operating Procedure

1. Choose **File > Open**.



The **Open** dialog box is displayed.

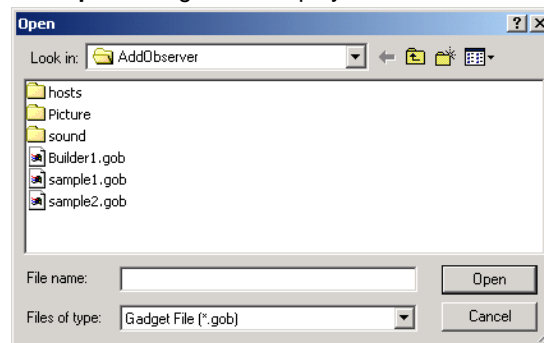


2. In the **Look in** list, select the location of the desired file, then in the **Files of type** list select Gadget File (\*.gob), and finally, in the **File name** box type or select the name of the desired file.

#### Note

- A maximum of 16 panels can be opened at the same time.
- If you open a panel on which a monitor window was added and created using ADDOBSERVER Builder, the sub windows are also opened at the same time. However, the sub windows set to hide are not opened.
- There are two file types associated with this software, .gob and .cob. Only the .gob files can be opened by the panel. The .gob and .cob files exist as a pair. If you delete a .cob file or change its name, the corresponding .gob file will become unreadable.

3. Click **Open**. The selected panel opens.

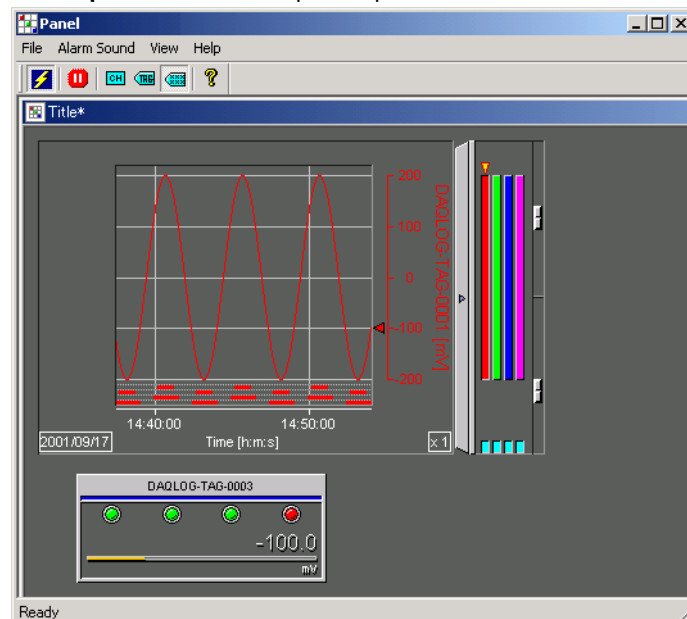

### Connecting to the Monitor Server

If you have already established a connection to the monitor server, the software automatically accesses the connection when you open a panel.


**Note**

- To establish a connection ahead of time, follow the instructions in section 1.4, "Connecting to the Monitor Server" before opening a panel.
- The measured data displayed in the panel is linked to the objects used when the panel was created with the development tool. If the measured data transmitted to the monitor server on the DAQ32 Plus, DAQEXPLORER, DAQLOGGER, MXLOGGER, GateCONTROL, or GateEye changes, the measured data displayed in the panel also changes.


### Checking the Communication Status

#### Operating Procedure

Choose **View > Comm. Status**.



The Communication Status window is displayed.

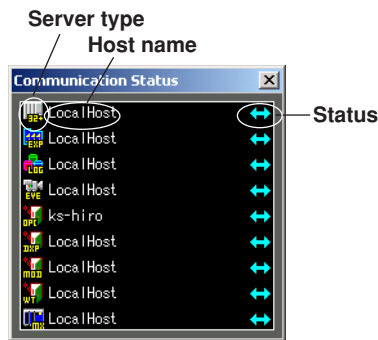

The contents of the Communication Status windows consist of the following three items.

• **Server Type**

- DAQ32 Plus monitor server
- DAQEXPLORER monitor server
- DAQLOGGER monitor server
- MXLOGGER monitor server
- GateCONTROL
- GateEye
- Failed or unrecognized connection

• **Host Name**

The name of the connected host.

• **Status**



- (Red) Connection failed.
- (Yellow) Connection not complete. Attempting to connect.
- (Blue) Connection successful.

## 2.3 Switching Label Displays

You can switch a label to display the channel number, tag number, or tag comment.

### *Operating Procedure*

Select **Channel No.**, **Tag No.**, or **Tag Comment** from the **View** menu, or click the **Channel No.**, **Tag No.**, or **Tag Comment** buttons on the toolbar. The label displays will change accordingly.

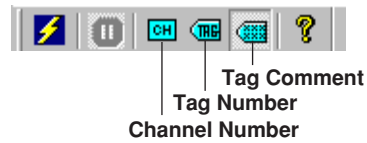

### **Note**

The View menu's Channel No., Tag No., and Tag Comment commands are only available when a panel is open.


## 2.4 Pausing and Resuming the Panel Display

Pause and resume the display update during monitoring.

### Pausing the Panel Display

#### *Operating Procedure*

Select **File > Pause**, or click the **Pause** button on the toolbar. The panel's display pauses.





Pause button

### Resuming the Panel Display

#### *Operating Procedure*

While the display update is paused, select **File > Pause**, or click the **Pause** button on the toolbar. The panel's display resumes.



Pause button

#### **Note**

You can change the display format for trend graphs, extended trend graphs, and X-Y graphs while the panel display is paused. For details, see section 2.7.



---

## 2.5 Disconnecting/Reconnecting the Monitor Server

### Disconnecting from the Monitor Server

#### *Operating Procedure*

Select **File > Disconnect**, or click the **Connect/Disconnect** button on the toolbar.




Connect/Disconnect button

### Reconnecting to the Monitor Server

#### *Operating Procedure*

While the server is disconnected, select **File > Connect**, or click the **Connect/Disconnect** button on the toolbar.



Connect/Disconnect button

---

#### **Note**

You can change the display format for trend graphs, extended trend graphs, and X-Y graphs while the monitor server is disconnected. For details, see section 2.7.

---

## 2.6 Restricting Operation of Out Objects

Out objects can only be operated by users who can log in at or above the protection level specified for the object (0, 1, 2, 3), and is disabled for users who cannot login.

If the protection level is 0, operation is not restricted.

A protection level can be set for the following objects.

- Temperature controller parts
- Numeric out objects
- Selectable out objects


Protection is enabled when the panel file specified by the user in AddObserver is opened. The user name and password are entered, and login succeeds only if there is a match. If another user is logged in, usage is restricted to the protection level of any user logging in thereafter. The panel file is restricted by the protection level of the user from login to logout, or of any subsequent user from that user's login to logout. When no users are logged in, only objects of protection level 0 can be operated.

### Logging In Operating Procedure

1. From the Protect menu, choose Login.




2. Enter the user name and password in the dialog box and click the Login button.



### Logging Out Operating Procedure

1. From the Protect menu, choose Logout.



## 2.7 Changing the Trend Graph, Extended Trend Graph, and X-Y Graph Display Method

When a graph (Trend Graph, Extended Trend Graph, or X-Y Graph) is included in the panel, the graph's display format can be changed in the following instances (when the graph display change toolbar is displayed).

- When the panel display is paused (section 2.4)
- When the monitor server is disconnected (section 2.5)

The following is a description of the main display items. Items not explained herein are the same as for the DAQ32 Plus, DAQEXPLORER, DAQLOGGER, MXLOGGER, or GateEye. Refer to the respective user's manual for those items.

### Graph Display Setting Toolbar Items


- Alarm <sup>2</sup>
- Zoom In<sup>2</sup>/Zoom Out<sup>2</sup>
- User Zone<sup>1</sup>/Edit Zone<sup>1</sup>/Full Zone<sup>1</sup>/Slide Zone<sup>1</sup>/Auto Zone<sup>1</sup>/Multi-Axes Zone<sup>1</sup>
- Normal Line/Medium Line/Thick Line
- Grid density (three types)
- Clip
- Grid color/Background color/Curtain <sup>1</sup>/Scroll bar <sup>1</sup>
  - 1 Trend Graph only
  - 2 Trend Graph and Extended Trend Graph only

### Note

The extended trend graph can display 1600 channels, but the speed of the display update may decrease as the number of display channels increases.

### Operating Procedure


1. Pause the panel display or disconnect the monitor server (for details, see section 2.4 or 2.5). The trend graph display icons are displayed.

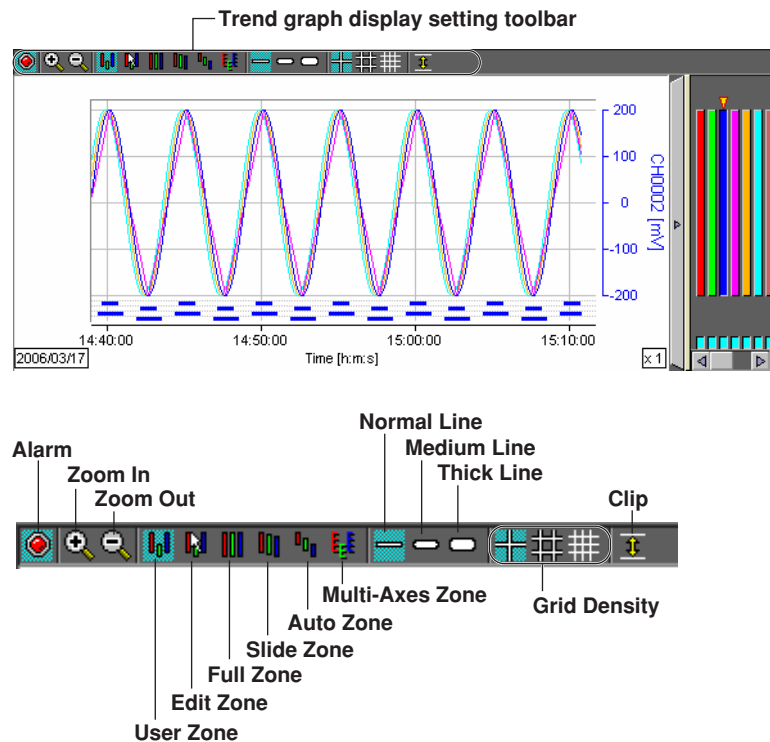

• **Displaying Alarms**

You can turn alarm displays ON and OFF.


- Click the **Alarm** button on the toolbar. The alarm status (tag) for each channel is displayed. However, no alarms will be displayed if the data being read has no alarm data.

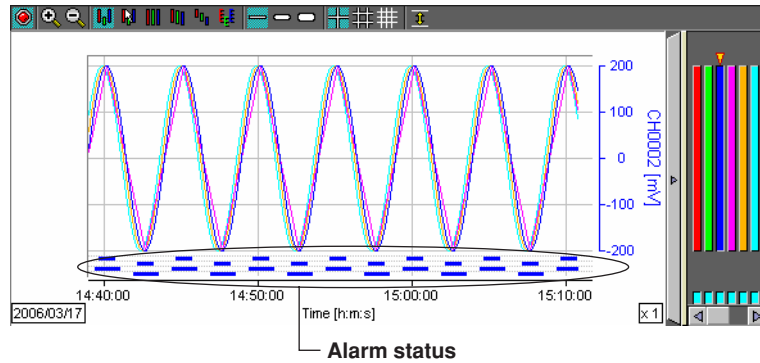


• **Zooming In and Out on the Time Axis**

You can adjust the time axis of the displayed waveform.

- Click the **Zoom In** or **Zoom Out** button on the toolbar. The waveform is zoomed in and out along the time axis (horizontally).

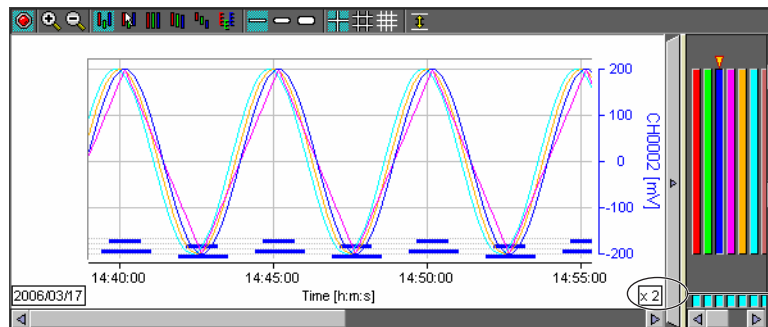

2 X Magnification

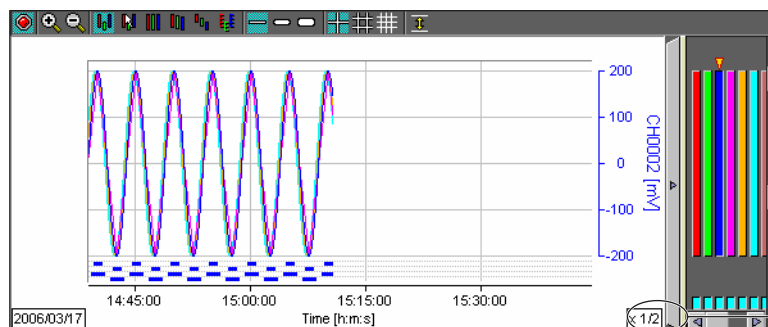

1/2 X Magnification

**Note**

- There are five zoom in levels: 1, 2, 5, 10, and 20.
- There are nine zoom out levels: 1/1000, 1/500, 1/200, 1/100, 1/50, 1/20, 1/10, 1/5, and 1/2. However, since the displayable zoom factor varies depending on the number of pixels in the area of the displayed waveform, the zoom factor changes with the size of the panel screen.
- Depending on the zoom factor, the date and time format is automatically switched (for example, MM/DD HH:MM or HH:MM:SS etc.)



## 2.6 Changing the Trend Graph Display Method


- **Selecting a Y-Axis Display Zone**

You can change the waveform display method.

2. Click **User Zone**, **Edit Zone**, **Full Zone**, **Slide Zone**, **Auto Zone**, or **Multi-Axes Zone** on the toolbar.


### User Zone

Set the y-axis as a user zone. This causes the zone to be uneditable using the panel.

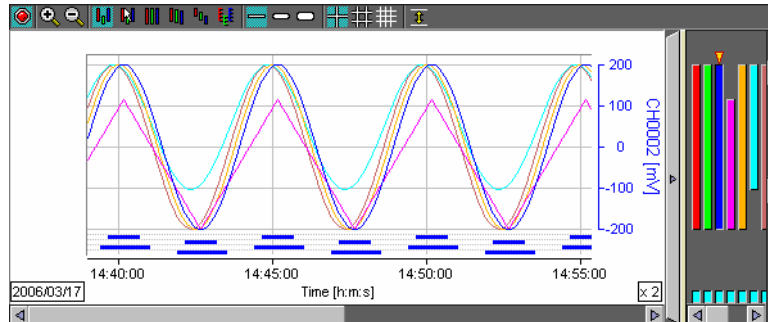


### Edit Zone

Set the y-axis as an editable zone. The zone can be edited in the trend graph's zone display area. In the zone display area, drag the handle on the upper or lower edge of the zone bar to change the zone.

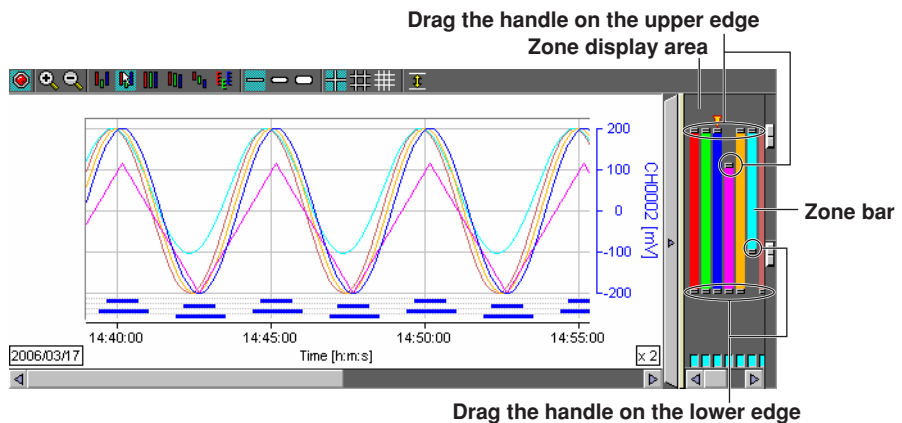


### Full Zone

Assigns the zone to all the currently displayed waveforms.

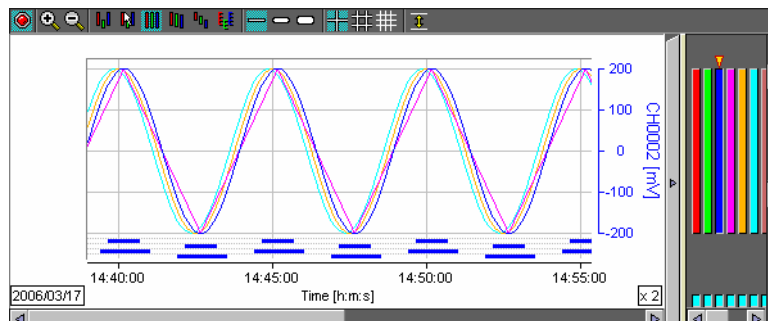


**Slide Zone**

Unifies the widths of each waveform's zone, then staggers the starting position of each zone.

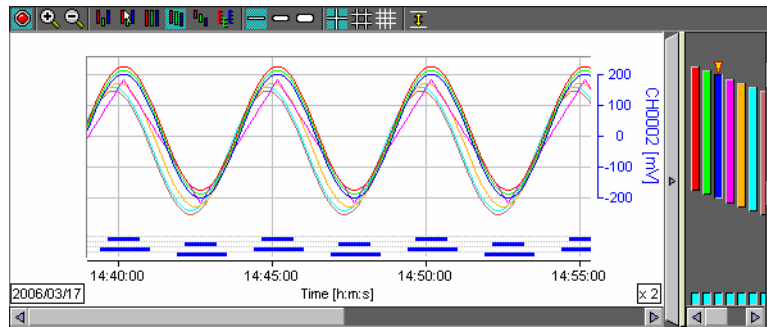


**Auto Zone**

Accounts for the number of displayed waveforms and divides up their waveform display areas equally.

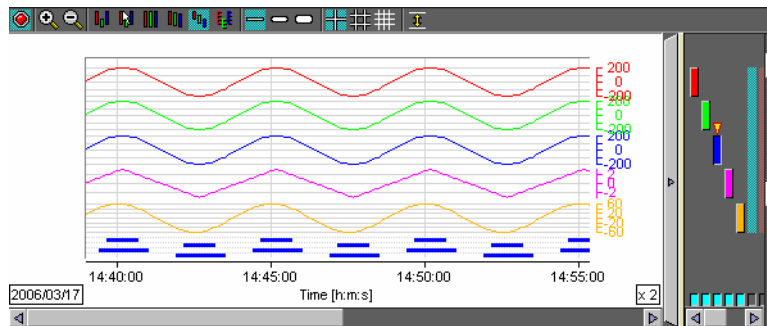

**Multi-Axes Zone**

Displays multiple y-axes (scales). By dragging the zone bar/y-axis of the waveforms whose Waveform Display ON/OFF Boxes are ON, you can turn the y-axis display ON and OFF.

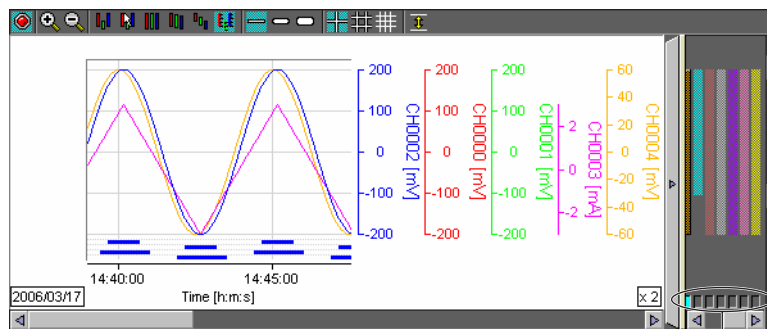



Click the waveform display ON/OFF button

## 2.6 Changing the Trend Graph Display Method

- **Changing the Line Thickness**


You can change the line thickness of the displayed waveform. The default setting is Normal Line.

2. Click the **Normal Line**, **Medium Line**, or **Thick Line** button on the toolbar.

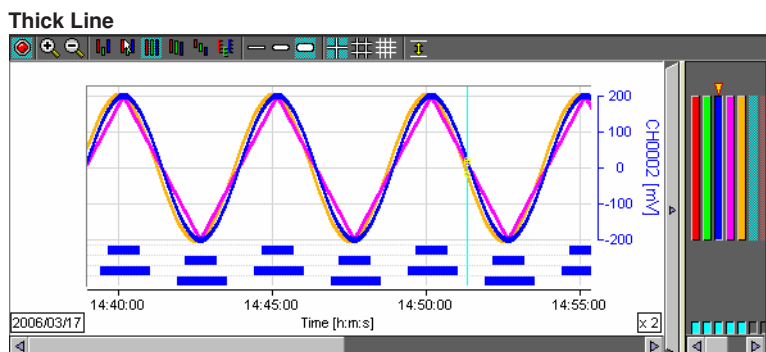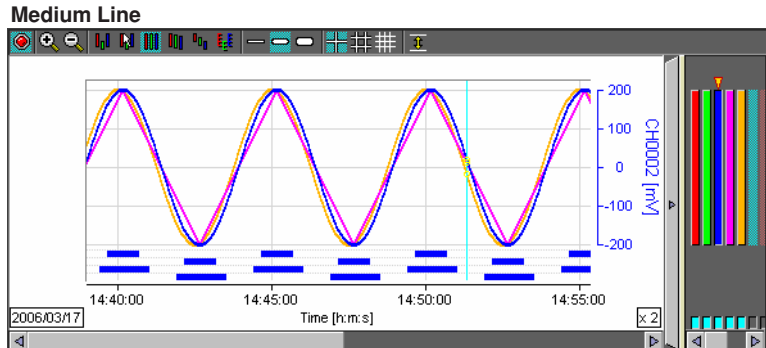

- **Changing the Grid Display**


You can select one of three grid types.

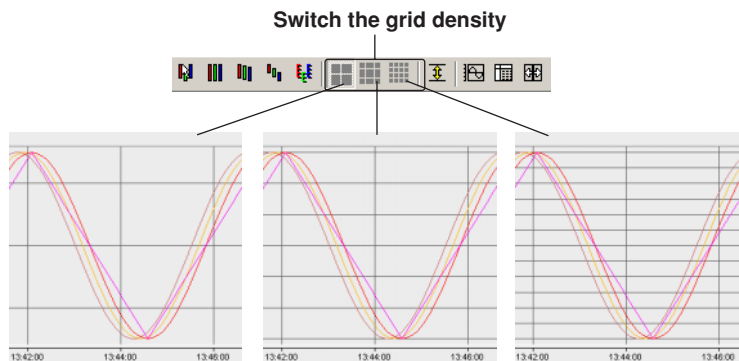

- **Applying a Display Limit (Clip)**

You can specify how waveforms outside of the display range are displayed.


2. Click the **Clip** button on the toolbar.

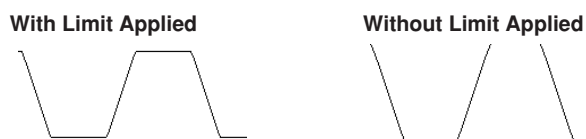

The displayed area of the waveform along the y-axis is limited by the specified minimum and maximum range values. Measured values lower than the minimum are displayed at the minimum value of the scale, and values higher than the maximum are displayed at the maximum value of the scale.

• **Grid Color/Background Color/Curtain/Scroll Bar**

The grid color, background color, and curtain can be adjusted while connected to the monitor server or while the panel display is not paused. The scroll bar is only available when disconnected from the monitor server or when the panel display update is paused.

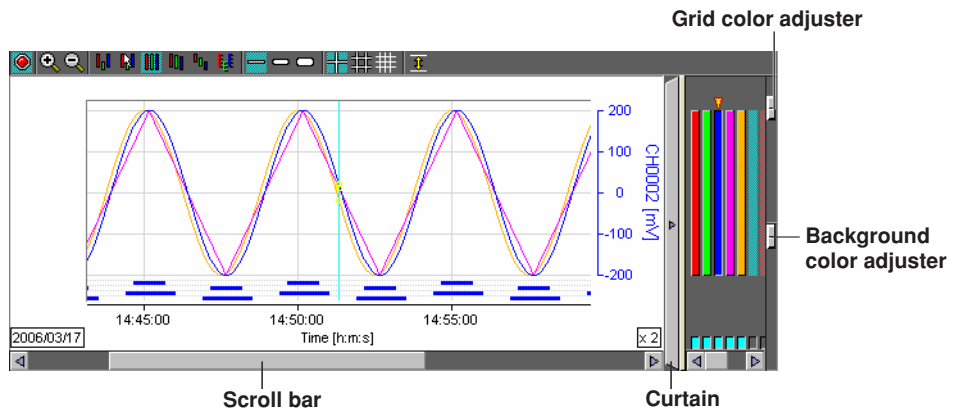

**Grid Color Adjuster**

Adjusts the brightness of the grid.

**Background Color Adjuster**

Adjusts the brightness of the background.

**Curtain**


Hides or reveals the zone display area.

**Scroll Bar**

Adjusts the position of the displayed waveforms.

**Changing the X-Y Graph Display Method**

If the X-Y graph's Clip property is turned ON (blue) in AddObserver, the X-Y graph displays the most recent data position.

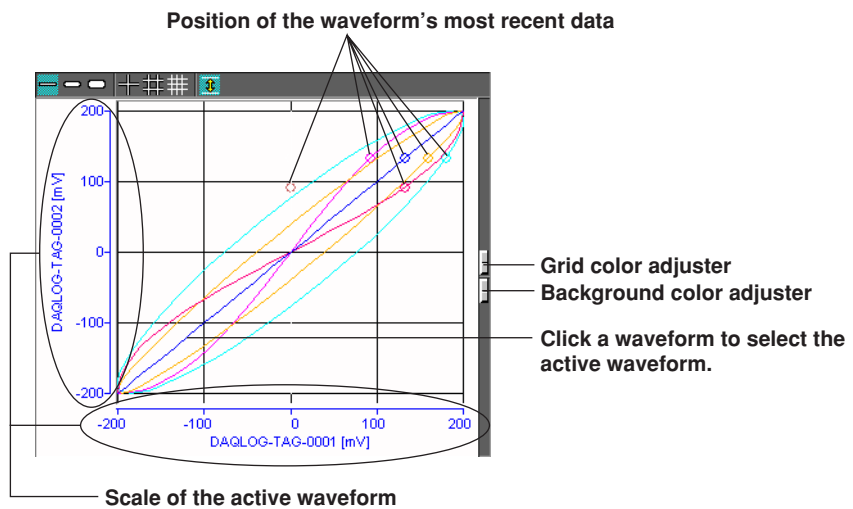


**Note**

The time for display updating may increase since more time is required for plotting waveforms of thicker lines.

## 2.8 Operating the Tab Display

The objects that have been set to tab display on ADDOBSERVER Builder are displayed as follows:

Select a tab to switch the display    Scroll when all the tabs cannot be displayed

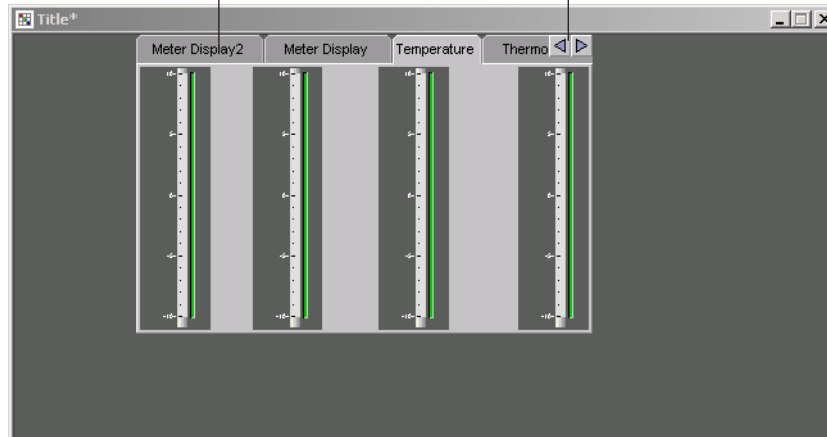


## 2.9 Operating a Numeric Out Object

The numeric out object sends numerical values to the I/O Channel host.  
The numeric out object displays the values from the channels corresponding to output channels.

### Operating Procedure

1. If you click a numeric out part in AddObserver panel whose direct output property was turned OFF in AddObserver Builder, the following dialog box appears.

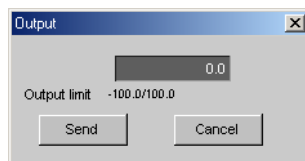

2. Change the value, then click the **Send** button.  
Numerical values are sent to the I/O Channel host.

If you click a numeric out part in AddObserver panel whose direct output property was turned ON in AddObserver Builder, the dialog box is not displayed, and the display area of the numeric out part becomes a numeric input screen.

- OFF -

### Note

- If an error occurs in I/O Channel, the error is not displayed. Errors are likewise not displayed when communication with the server (I/O channel host) is broken, or if there is a problem between the server and connected instruments.
- If communication with the monitor server fails for some reason such as a cable becoming disconnected during transmission, the output values are not resent even if the cable is reconnected.
- If the server (GateCONTROL) determines that the output value falls outside of the range on the instrument (temperature controller) the value is not sent to the instrument.


---

## 2.10 Operating the Selectable Out Object

The selectable out object is used to select strings to which numerical values are registered and send them to the I/O Channel host. The selectable out object selects values from channels that correspond to output channels for strings registered on the builder and displays them.

### Operation Procedure

1. If you click a selectable out part in AddObserver panel whose direct output property was turned OFF in AddObserver Builder, the following dialog box appears.



2. Click the list button to select a character string, then click the **Send** button. The corresponding numerical value is sent to the I/O Channel host. If an error occurs in an I/O Channel, the error is not displayed. Also, if the value from the channel corresponding to the output channel is not registered, nothing is displayed.

If you click a selectable out part in AddObserver panel whose direct output property was turned ON in AddObserver Builder, the dialog box is not displayed, and the display area of the selectable out part becomes a setting screen.



---

### Note

- If an error occurs in I/O Channel, the error is not displayed. Errors are likewise not displayed when communication with the server (I/O channel host) is broken, or if there is a problem between the server and connected instrument.
  - If communication with the monitor server fails for some reason such as a cable becoming disconnected during transmission, the output values are not resent even if the cable is reconnected.
  - If the server (GateCONTROL) determines that the output value falls outside of the range on the instrument (temperature controller), the value is not sent to the instrument.
-


## 2.11 Operating Temperature Controller Parts

The temperature controller is a GateCONTROL-specific object. The objects and channels assigned using the models set in GateCONTROL are different, and only existing channels are displayed. Temperature controller parts consist of numeric out, selectable out, alarms, digital meters, and other objects, and clicking numeric out displays a dialog box from which you can edit or send values.

### Operation Procedure

1. Click a component object of the temperature controller part created in AddObserver builder.

If you click a temperature controller part in AddObserver panel whose direct output property was turned OFF in AddObserver Builder, the following dialog box appears. Enter a setting and click the Send button.

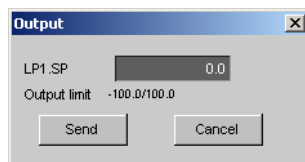

If you click a temperature controller part in AddObserver panel whose direct output property was turned ON in AddObserver Builder, the dialog box is not displayed, and the display area of the temperature controller part becomes a numeric input screen.

#### For the UP750

One from the following list is displayed here: LP1.SP, LP1.OUT, LP1.CLUT, LP1.HOUT, LP2.SP, LP2.OUT, LP2.COUT, LP2.HLUT. AUTO/MANUAL or AUTO/MANUAL/CASCADE

**Loop switching button**  
Enabled when there are multiple loops

**SP/OUT display button**  
Switches between existing SP values and OUT values

**PID number**

**AUTO/MANUAL, or AUTO/MANUAL/CASCADE**

**PV value**

**PV events**  
**TIME events**

**Program time**

**Pattern number**

**Segment number**

One from the following list is displayed here: RESET, PROGRAM, LOCAL, RESET, PRGRM1, PRGRM2, CASCADE, LOCAL, RELEASE, HOLD, ADVANCE, ADV.EXEC.  
When sending the ADVANCE command, select ADV.EXEC.

#### For the US1000

**OPEN/CLOSE**

**RUN/STOP**

#### For the UT750

**REMOTE/LOCAL**

**SP number**



## 2.11 Operating Temperature Controller Parts

---

### **Note**

- If an error occurs in I/O Channel, the error is not displayed. Errors are likewise not displayed when communication with the server (I/O channel host) is broken, or if there is a problem between the server and connected instruments.
  - If communication with the monitor server fails for some reason such as a cable becoming disconnected during transmission, the output values are not resent even if the cable is reconnected.
  - If the server (GateCONTROL) determines that the output values fall outside of the range on the instrument (temperature controller), the values are not sent to the instrument.
-

## 2.12 Playing, Stopping, and Acknowledging Alarm Sounds

You can perform the following operations on panels that have alarm sounds specified.

- Stop the alarm sound (Off).
- Play the sound of alarms that have not been acknowledged (On).
- Acknowledge alarm sounds (ACK)

### *Operating Procedure*

1. Choose **Alarm Sound** > **On** (or **Off**) or **ACK**.




---

## 2.13 Closing the Panel

### *Operating Procedure*

1. Disconnect from the monitor server. For details, see section 2.5.
2. Select **File > Close**, or click the **Close** button on the right corner of the title bar.




Close button

## 2.14 Exiting AddObserver Panel

### Operating Procedure

1. Choose **File > Exit**.



2. If there are no panels open that are connected to a monitor server, AddObserver Panel closes.  
If any panels are currently connected, a confirmation dialog box appears. Click **OK** to close the connection.



Then choose **File > Exit** once more to exit the program.

## 3.1 Error Messages and Their Corrective Actions

The following messages may appear during operation of the software. This section describes the meanings of the messages and the appropriate corrective actions.

### Warnings

Code	Comment	Corrective Action
W3902	COB file not found.	-
W3903	Too many connections.	The AddObserver can only connect with up to 16 monitor servers. Close an open panel to decrease the number of connections.

### Messages

Code	Comment	Corrective Action
M3553	Connections open.	- Close all connections?
M3566	Successful in login.	-
M3567	Password is not accord with user name.	Enter the correct user name and password.
M3901	File not checked. OK to continue?	Check and fix the data using the AddObserver Builder <sup>1</sup> Please contact your sales representative.

<sup>1</sup> Please inquire with one of our representatives for more information on the AddObserver Builder.

---


## 3.2 Checking the Version of the AddObserver Panel

### *Operating Procedure*

Choose **Help > About**.



The version number and other information is displayed.

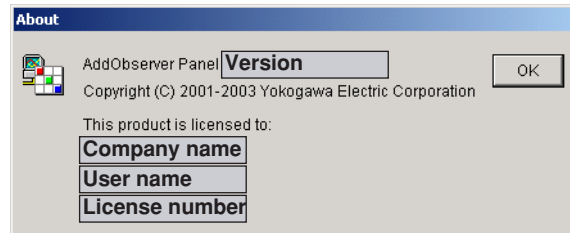

# Index

## A

AddObserver Runtime ..... 1-1  
 alarm ..... 2-9  
 alarm sound ..... 2-19  
 analog meter ..... 1-3  
 analog meter set ..... 1-3  
 auto zone ..... 2-11

## B

background color ..... 2-13  
 bar meter ..... 1-2  
 bar meter set ..... 1-3

## C

channel number ..... 2-4  
 clip ..... 2-12  
 .cob file ..... 2-2  
 communication status ..... 2-3  
 connecting to the monitor server ..... 1-9, 2-3  
 curtain ..... 2-13

## D

DAQ32 Plus ..... 1-1, 1-9  
 DAQEXPLORER ..... 1-1, 1-9  
 DAQLOGGER ..... 1-1, 1-9  
 digital ..... 1-2  
 digital meter set ..... 1-3  
 disconnecting from the monitor server ..... 2-6  
 display limit ..... 2-12

## E

edit zone ..... 2-10  
 error message ..... 3-1  
 example panel ..... 1-2  
 exiting DAQOBSERVER panel ..... 2-21

## F

full zone ..... 2-10

## G

GateCONTROL ..... 1-9

GateCONTROL-specific object ..... 2-17  
 GateEye ..... 1-1, 1-9  
 .gob file ..... 2-2  
 grid color ..... 2-13

## I

indicator ..... 1-2

## L

label display ..... 2-4

## M

medium line ..... 2-12  
 message ..... 3-1  
 meter set ..... 1-3  
 monitor server ..... 1-8  
 multi-axes zone ..... 2-11  
 MXLOGGER ..... 1-1, 1-9

## N

normal line ..... 2-12  
 numeric out object ..... 2-15

## O

opening the panel ..... 2-2

## P

panel object ..... 1-2  
 pausing the panel display ..... 2-5  
 PC system ..... 1-7  
 picture ..... 1-4

## R

reconnecting to the monitor server ..... 2-6  
 resuming the panel display ..... 2-5

## S

scroll bar ..... 2-13  
 selectable out object ..... 2-16

## Index

---

serial number ..... 3-2  
slide zone ..... 2-11  
starting DAQOBSERVER panel ..... 2-1

## T

---

tab display ..... 2-14  
tag comment ..... 2-4  
tag number ..... 2-4  
temperature controller parts ..... 2-17, 2-18  
Terms and Conditions of the Software License ..... ii  
thermometer ..... 1-3  
thermometer set ..... 1-3  
thick line ..... 2-12  
trend graph ..... 1-4  
trend graph display method ..... 2-8

## U

---

user zone ..... 2-10

## V

---

value rectangle ..... 1-2  
version ..... 3-2

## W

---

warning ..... 3-1

## Y

---

Y-axis display zone ..... 2-10

## Z

---

zoom in ..... 2-9  
zoom out ..... 2-9