



## Introduction to layers of protection analysis

Angela E. Summers\*

*SIS-TECH Solutions, LLC, PMB-295, 2323 Clear Lake City Blvd., Houston, TX 77062-8032, USA*

---

### Abstract

Layers of protection analysis (LOPA) is a powerful analytical tool for assessing the adequacy of protection layers used to mitigate process risk. LOPA builds upon well-known process hazards analysis techniques, applying semi-quantitative measures to the evaluation of the frequency of potential incidents and the probability of failure of the protection layers. This paper will provide an overview of the LOPA process, highlighting the key considerations.

© 2003 Elsevier B.V. All rights reserved.

*Keywords:* Layers of protection analysis (LOPA); Hazard analysis; Protection layers; IEC 61511; ANSI/ISA 84.01-1996; Risk mitigation

---

### 1. Introduction

The process industry is obligated to provide and maintain a safe, working environment for their employees. Safety is provided through inherently safe design and various safeguards, such as instrumented systems, procedures, and training. During a HAZOP, the team is responsible for assessing the process risk from various process deviations and determining the consequence of potential incidents. The team identifies the safeguards used to mitigate the hazardous event. If the team determines that the safeguards are inadequate, the team makes recommendations for further risk reduction.

The HAZOP team is often instructed to list all safeguards, whether these safeguards partially or completely mitigate the process risk or whether the safeguards are independent from one another. This often results in the team assuming more risk reduction from the safeguards than is possible based on the integrity of the individual components. Furthermore, a team's perception of the integrity of a specific safeguard impacts the assumed risk reduction for that safeguard, resulting in inconsistency in the number of required safeguards for successful mitigation of the process risk. Unfortunately, the inconsistency can result in over- and under-protected process risk, depending on the team composition. Consequently, there

---

\* Tel.: +1-713-320-4777; fax: +1-281-461-8109.

*E-mail address:* [asummers@sis-tech.com](mailto:asummers@sis-tech.com) (A.E. Summers).

*URL:* <http://www.sis-tech.com>.

must be an independent engineering assessment of the safeguards to ensure that adequate risk reduction is being provided.

## 2. What is layers of protection analysis (LOPA)?

LOPA is a semi-quantitative methodology that can be used to identify safeguards that meet the independent protection layer (IPL) criteria established by CCPS [6] in 1993. While IPLs are extrinsic safety systems, they can be active or passive systems, as long as the following criteria are met:

- *Specificity.* The IPL is capable of detecting and preventing or mitigating the consequences of specified, potentially hazardous event(s), such as a runaway reaction, loss of containment, or an explosion.
- *Independence.* An IPL is independent of all the other protection layers associated with the identified potentially hazardous event. Independence requires that the performance is not affected by the failure of another protection layer or by the conditions that caused another protection layer to fail. Most importantly, the protection layer is independent of the initiating cause.
- *Dependability.* The protection provided by the IPL reduces the identified risk by a known and specified amount.
- *Auditability.* The IPL is designed to permit regular periodic validation of the protective function.

Examples of IPLs are as follows:

- Standard operating procedures.
- Basic process control systems.
- Alarms with defined operator response.
- Safety instrumented systems (SIS).
- Pressure relief devices.
- Blast walls and dikes.
- Fire and gas systems.
- Deluge systems.

LOPA is not just another hazard assessment or risk assessment tool. It is an engineering tool used to ensure that process risk is successfully mitigated to an acceptable level. LOPA is a rational, defensible methodology that allows a rapid, cost effective means for identifying the IPLs that lower the frequency and/or the consequence of specific hazardous incidents. LOPA provides specific criteria and restrictions for the evaluation of IPLs, eliminating the subjectivity of qualitative methods at substantially less cost than fully quantitative techniques [1].

## 3. When is LOPA used?

LOPA is typically applied after a qualitative hazards analysis has been completed, which provides the LOPA team with a listing of hazard scenarios with associated consequence

description and potential safeguards for consideration. LOPA can be used at any point in the lifecycle of a project or process, but it is most cost effective when implemented during front-end loading when process flow diagrams are complete and the piping and instrumentation diagrams (P & IDs) are under development. For existing processes, LOPA should be used during or after the HAZOP review or revalidation.

A LOPA program is most successful when a procedure is developed that sets the criteria for when LOPA is used and who is qualified to use it. A well-written procedure will also incorporate criteria for evaluation of initiating cause frequency and IPL probability to fail on demand (PFD). The development of these criteria takes time, but this cost is rapidly offset by the increased speed at which LOPA can be implemented on specific projects.

#### 4. What is the LOPA process?

The overall LOPA process is illustrated in Fig. 1. Depending on the project stage, the process may be initiated differently from what is represented. This should be considered a general overview of LOPA and not a limitation on its applicability.

The six major steps to the LOPA process are as follows:

- (1) Record all reference documentation, including hazards analysis documentation, pressure relief valve design and inspection reports, protection layer design documents, etc.
- (2) Document the process deviation and hazard scenario under consideration by the team. It is important to focus the team on a specific hazard scenario, such as high pressure resulting in pipeline rupture.
- (3) Identify all of the initiating causes for the process deviation and determine the frequency of each initiating cause. The team should list all initiating causes of the hazard scenario, such as loss of flow control, loss of pressure control, excess reaction, etc. The initiating cause frequencies should be based on industry-accepted and standards-compliant failure rate data for each device, system, or human. For rapid execution of the LOPA methodology, the initiating cause frequency for common systems should be provided in the procedure.
- (4) Determine the consequence of the hazard scenario. This evaluation should include an examination of safety, environmental, and economic losses. Safety and environmental impacts must be mitigated for United States OSHA PSM [4] and EPA RMP [5] compliance. In other countries, federal or local regulatory authorities (e.g. HSE, TUV) establish requirements for safety and environmental protection. In contrast, economic loss prevention is strictly a company decision and is not covered under any regulatory mandate. The economic risk should be assessed to ensure that loss prevention goals are met, but the risk should be clearly delineated to allow flexibility in the IPL selection and design.

For instance, a hazard scenario may describe damage to furnace tubes, causing substantial downtime, but no safety impact. An instrumented system may be used to prevent this economic impact, but the IPL selection, design, operation, testing, and maintenance is not driven by the need to comply with the SIS standards [2,3]. Cost/benefit analysis can be used to determine what the actual design should be.

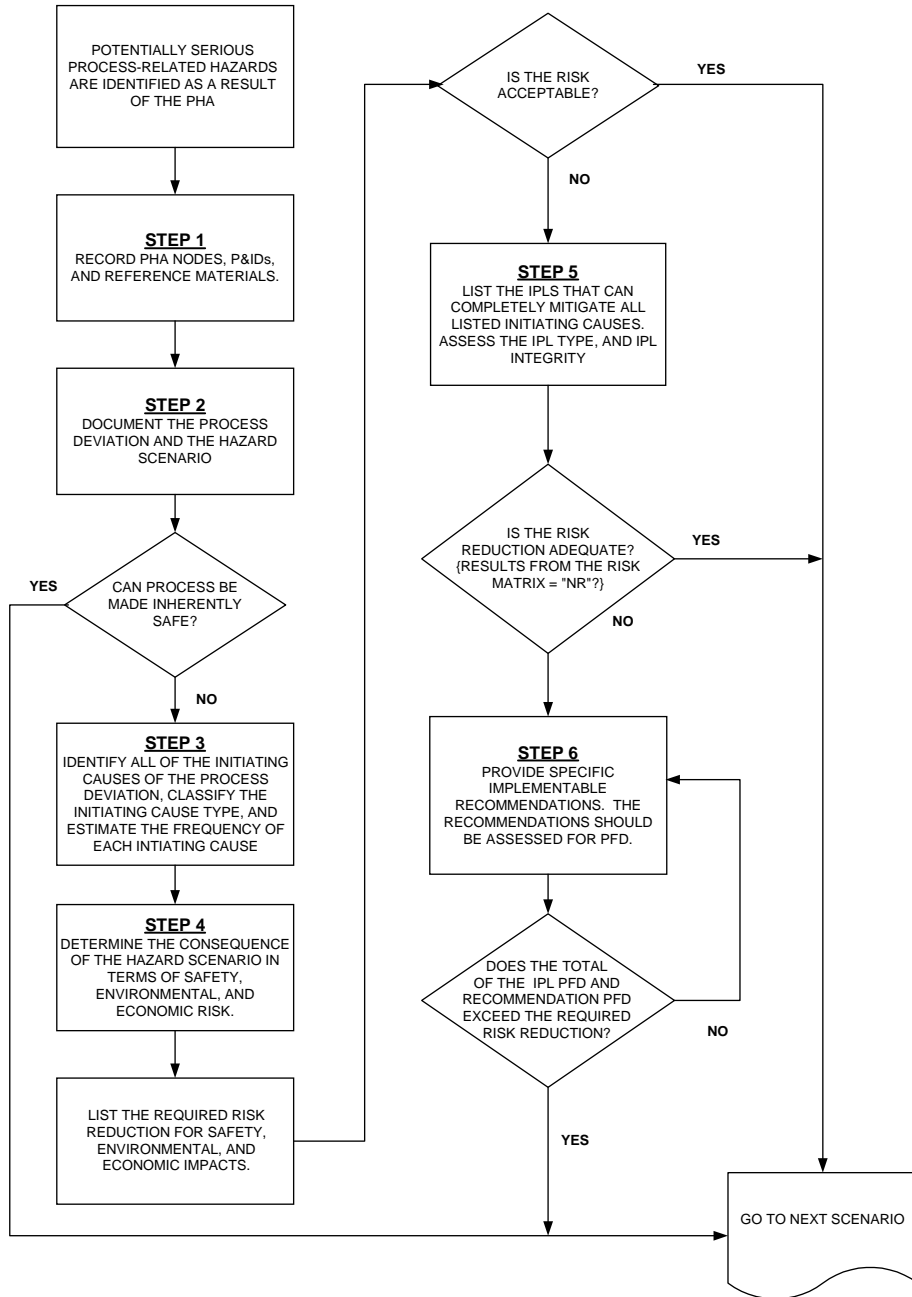


Fig. 1. LOPA process flow chart.

Once the team has an understanding of the frequency and consequence of the potential hazardous event, a risk matrix is often used to determine whether the risk is acceptable or whether IPLs are required for further risk reduction. The risk matrix is developed, as part of the LOPA procedure, using corporate risk criteria and provides consistency to the assessment of acceptable risk. Quantitative targets can also be used to assess whether additional risk reduction is required. However, this does require more specific assessment of the consequence and the declaration of a specific numerical risk tolerance, e.g. tolerable fatality rate. Whether a risk matrix or specific numerical risk tolerance is used, if it is determined that additional risk reduction is necessary, the team is required to identify IPLs (Step (5)) or list recommendations (Step (6)).

- (5) List the IPLs that can completely mitigate all listed initiating causes. The IPLs must meet the independence, specificity, dependability, and auditability requirements. This means that the IPL must be completely independent from the initiating cause, e.g., if a process control loop is the initiating cause, an alarm generated by the process control transmitter cannot be used for risk reduction.

For each IPL, determine the PFD. The PFD is a measure of the risk reduction that can be obtained using the IPL. For SISs, the PFD is equivalent to the safety integrity level (SIL), which serves as the benchmark for SIS design, operation, and maintenance according to ANSI/ISA 84.01-1996 [2] and IEC 61511 [3].

As in Step (3), it is important to provide the team with a list of acceptable IPLs, including design criteria and limitations. Also, for each IPL provide a PFD or range of PFDs based on the design criteria. Having a pre-approved list will substantially improve the consistency of the assessment and reduce the amount of time required for the analysis.

- (6) Provide specific implementable recommendations. The recommendations from the LOPA team must be considered options for implementation. The LOPA team should be encouraged to develop as many recommendations as possible to allow the project team to select the best option from an implementation ease and cost standpoint.

## 5. What is the benefit of using LOPA?

There are four primary benefits to implementing LOPA over other SIL assignment methodologies procedures:

- (1) Due to its scenario-related focus on the process risk, LOPA often reveals process safety issues that were not identified in previous qualitative hazards analysis.
- (2) Process hazards are directly connected to the safety actions that must take place, providing clear identification of the SISs and associated SIL.
- (3) It has been proven effective in resolving disagreements related to qualitative hazards analysis findings.
- (4) LOPA often identifies acceptable alternatives to the SIS, such as adding other layers of protection, modifying the process, or changing procedures. This provides options for the project team to evaluate using cost/benefit analysis, allowing the most cost effective means of risk reduction to be selected.

**References**

- [1] Layers of Protection Analysis: Simplified Process Risk Assessment, Center for Chemical Process Safety, American Institute of Chemical Engineers, New York, 2001.
- [2] Application of Safety Instrumented Systems for the Process Industries, ANSI/ISA 84.01-1996, ISA, Research Triangle Park, NC, 1996.
- [3] Functional Safety: Safety Instrumented Systems for the Process Sector, International Electrotechnical Commission (IEC), IEC 61511, Geneva, Switzerland, 2003.
- [4] Process Safety Management of Highly Hazardous Chemicals; Explosives and Blasting Agents, 29 CFR Part 1910, OSHA, Washington, 1992.
- [5] Risk Management Programs for Chemical Accidental Release Prevention, 40 CFR Part 68, Environmental Protection Agency, 1996.
- [6] Guidelines for Safe Automation of Chemical Processes, CCPS/AIChE, 1993, pp. 7–16.