

LEGEND:

- 1

PRATT & WHITNEY FRAME FT4 GTG.

2

STG BUILDING (FUTURE).

3

HRSG (FUTURE).

4

EXHAUST GILLOTINE.

5

TURBINE REMOVAL AREA.

6

GENERATOR REMOVAL AREA.
- 7

OVERHEAD CABLE TRAY.

8

GSU TRANSFORMER.

9

MODULAR CONTROL BUILDING.

10

FUEL GAS FILTER/REGULATOR.

11

WATER TREATMENT EQUIPMENTS AREA.

12

PARKING AREA.
- 13

PIPE RACK (FUTURE).

14

STG COOLING TOWER (FUTURE).

15

OFFICES/CONTROL/MAINTENANCE BUILDING.

16

OFFICE CONTROL ROOM.

17

WAREHOUSE AREA.

18

EMERGENCY GENERATOR.
- 19

WATER TREATMENT BUILDING.

20

FIRE WATER SKID.

21

AIR INSTRUMENT PACKAGE.

22

AUXILIARY TRANSFORMER (480 V).

23

GATE.

24

RAW/FIRE WATER TANK (300,000 GALS).
- 25

OILY WASTE TANK (5,000 GALS).

26

OILY WASTE OFF LOAD PUMP.

27

OILY WATER SEPARATOR.

28

LIQUID FUEL DAY TANK (CLEANED-50,000 GALS).

29

LIQUID FUEL CENTRIFUGE PACKAGE.

30

DEMINWATER TANK (2-21,000 GAL EACH).

31

LIQUID FUEL TANK (RAW-100,000 GALS).
- 32

LIQUID FUEAL TRANSFER PUMP.

33

LIQUID FUEL FORWARDING PUMP.

34

LIQUID FUEL OFF-LOAD PUMP.

35

LIQUID FUEL OFF-LOAD AREA.

36

ROAD.

37

GAS METER RUN.

38

ESD VALVE.
- 39


LIGHTING POLE.

40

PLANT FENCE.

41

GUARD HOSE.

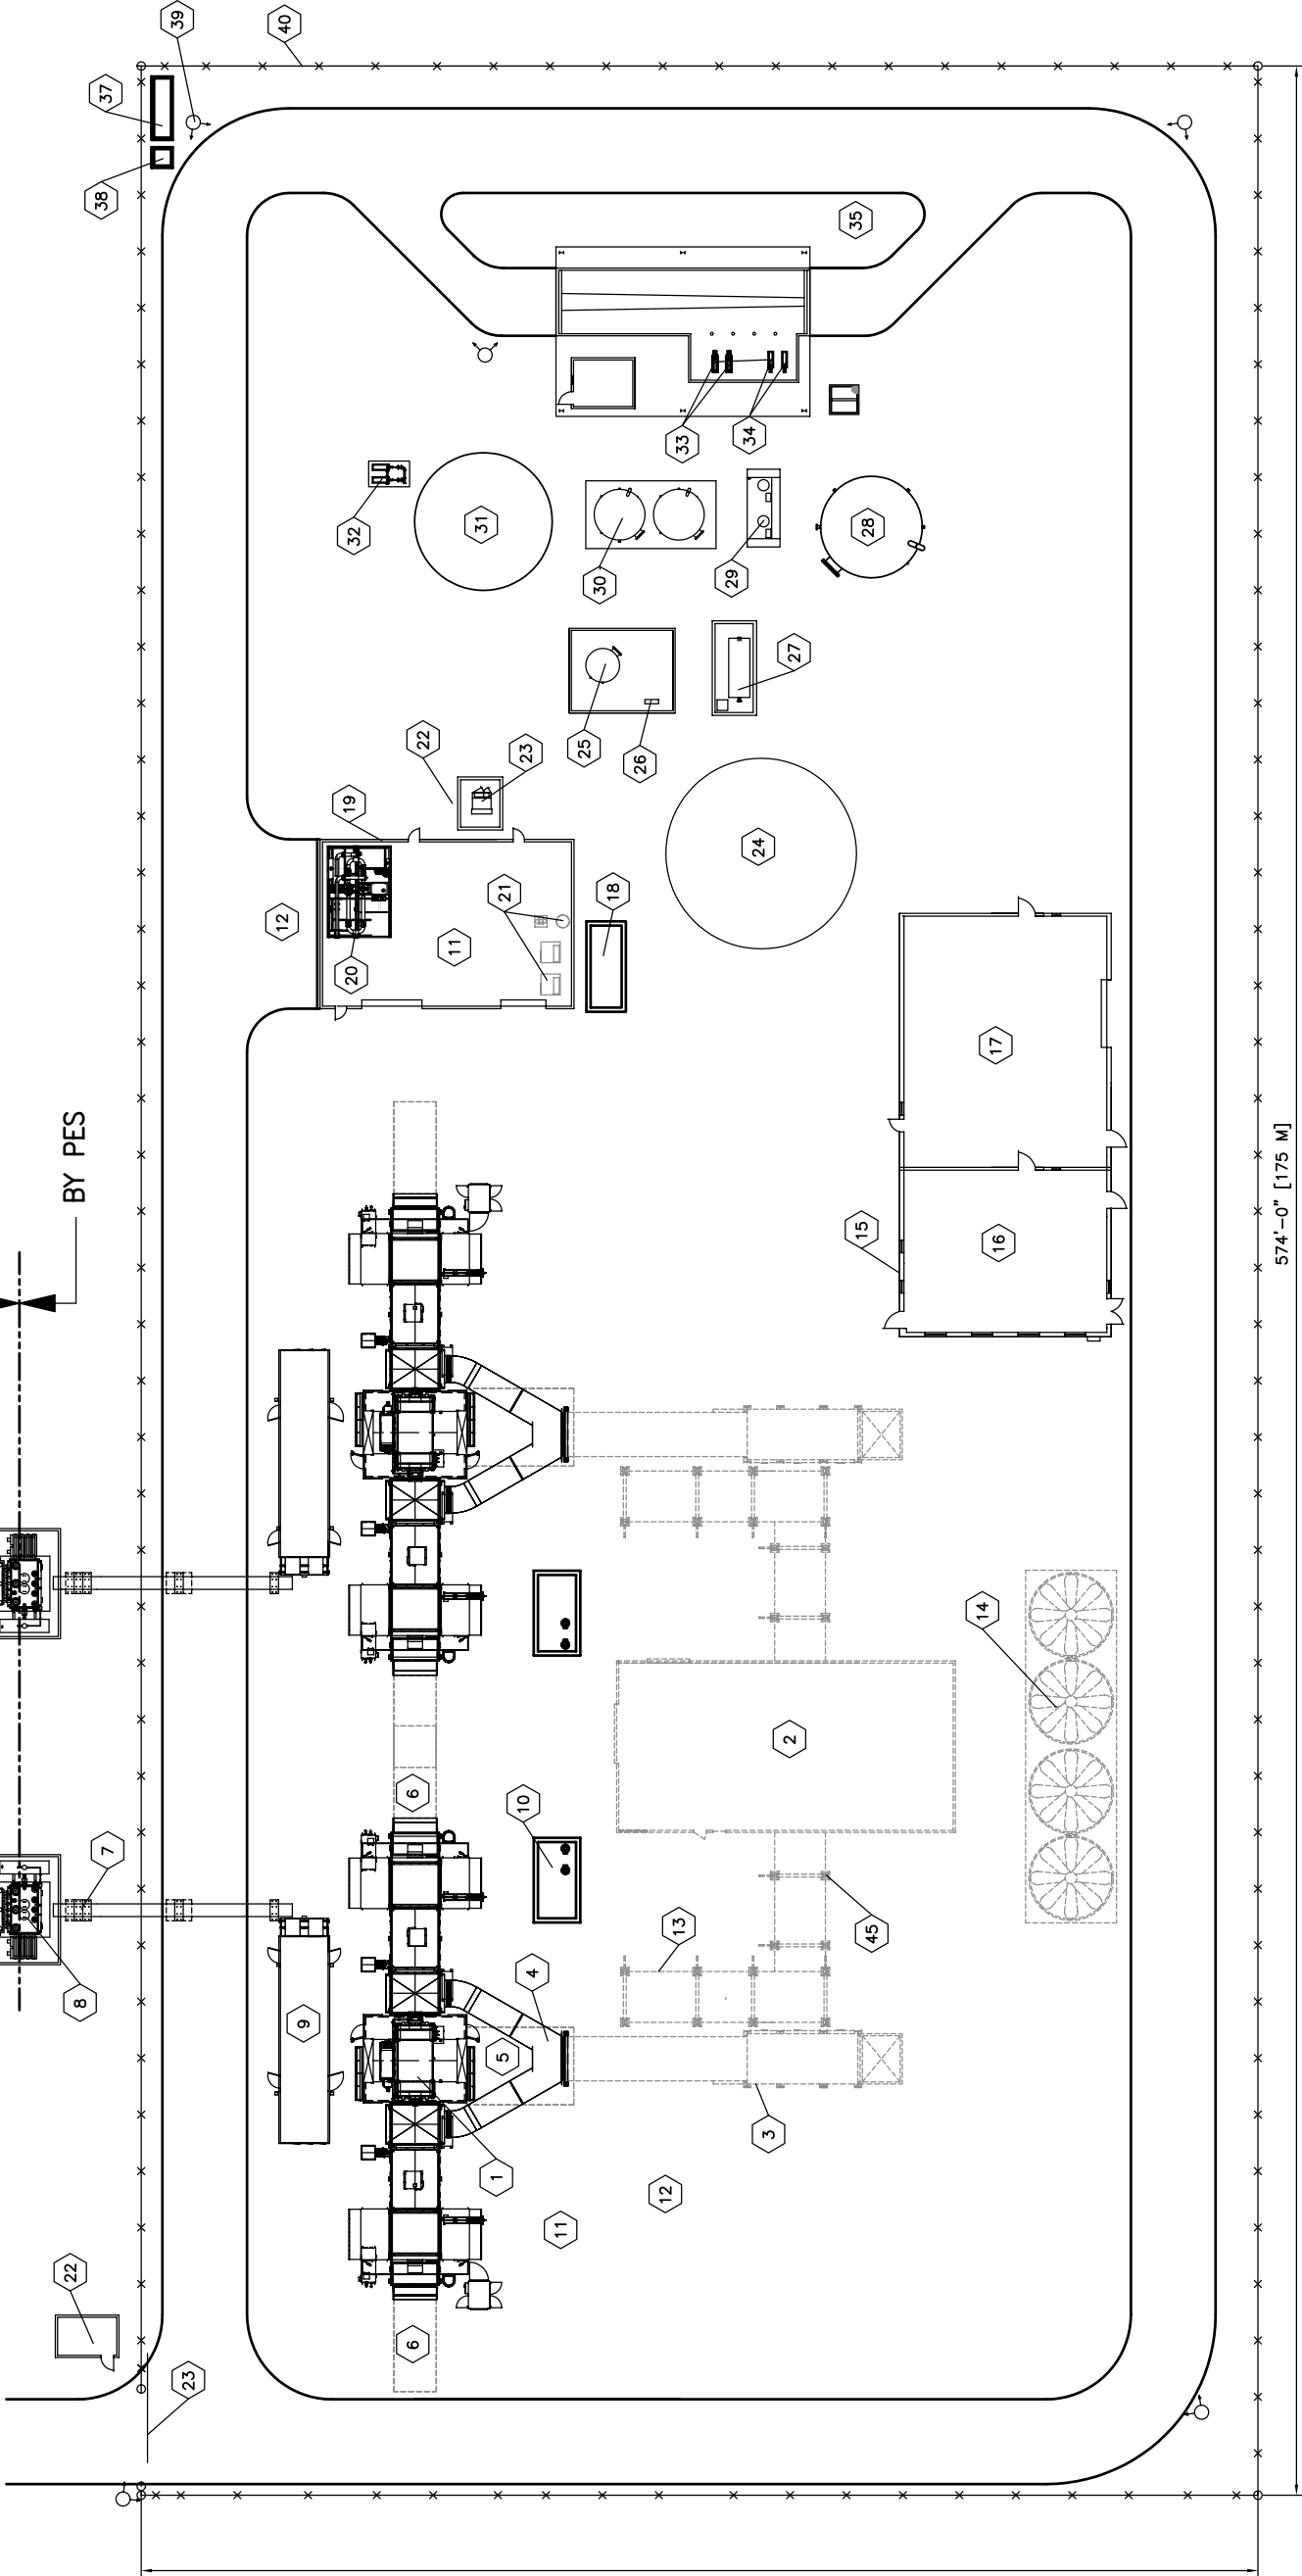

574'-0" [175 M]

264'-0" [80.50 M]



GRAPHIC SCALE

REVISED										CUSTOMER INFORMATION									
<p>© COPYRIGHT, 2008, ProEnergy SERVICES. ALL RIGHTS RESERVED. THIS DRAWING IS THE PROPRIETARY AND/OR CONFIDENTIAL PROPERTY OF ProEnergy SERVICES AND IS LOANED IN STRICT CONFIDENCE WITH THE UNDERSTANDING THAT IT WILL NOT BE REPRODUCED NOR USED FOR ANY PURPOSE EXCEPT THAT FOR WHICH IT IS LOANED. IT SHALL BE IMMEDIATELY RETURNED ON DEMAND, AND IS SUBJECT TO ALL OTHER TERMS AND CONDITIONS OF ANY WRITTEN AGREEMENT OR PURCHASE ORDER WHICH INCORPORATES OR RELATES TO THIS DRAWING.</p>																			
NO.		DATE		BY		APP'D		DESCRIPTION						REVISIONS					
								SCALE						1"=20'					
								SIZE						D					
								DRAWN						SL					
								CHECK						09/21/08					
								DESIGN											
								PROJ ENGR											
								PROJ MGR											
								QA MGR											