

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 1 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/16/2009


Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

To : BULLETIN BOARD
DIVISION DE SUMINISTROS
SAN JUAN PR 00936
United States of America

From : FRANCES M. PÉREZ
PR Electric Power Authority
PO Box 364267
San Juan PR 00936-4267
US



Phone :
Fax :

Phone : (787) 289-3300

DELIVERY POINT OFFER:

DELIVERY PROMISE:

PAYMENT TERMS:

P.R. EXCISE TAXES INCLUDED

(Y/N)

SELLING TERMS (CHOOSE ONE)

FOB FAS CIF C+F

VALIDITY: (IN DAYS)

Authorized Signature

TITLE:

S.S.:

DATE:

PH:

FAX:

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 2 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/16/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

Deliver To : ING. LUIS ALTUZ CORTÉS
PUERTO RICO POWER AUTHORITY
DIV. CONS. ELECT. Y PROT. DEL
SIST.
PLANIFICACION CONS. ELECT.
RIO PIEDRAS
PR
00926

Notes: *****APENDICE II *****

NUMERO DE PUBLICACION: Q033788
NUM DE REQ.: 09-10707 - 09-10660
FECHA DE APERTURA: 11/03/09
HORA: 10:30 AM
LUGAR: SALON DE SUBASTAS - TERCER PISO, EDIFICIO NEOS, SANTURCE.

ENTREGA: RENGLON 1. MONACILLOS
RENGLON 2. CENRTAL SAN JUAN

*****APENDICE NO. II (10.28.2004)*****

HACEMOS REFERENCIA A NUESTRA INVITACION A SUBASTA Q033788
CON FECHA DE 10/21/09 Y APERTURA EL 11/03/09 A LAS 10:30 AM.

LOS LICITADORES SON INFORMADOS DE LO SIGUIENTE:

NOTAS ESPECIALES:

1. ESTA INVITACIÓN TENDRÁ NUEVA FECHA DE APERTURA COMO PRE-SUBASTA
EL MIERCOLES 04 DE NOVIEMBRE DE 2009 A LA 9:00 A.M.
EN: SALON DE CONFERENCIAS JOSE CHEO GARCES TERCER PISO CENTRAL SAN
JUAN.

2. PARA EL RADIADOR DEL RENGLON UNO SE VISITARA EL
VIERNES 6 DE NOVIEMBRE DE 2009 A LAS 9:00 A.M.
EN: SALON DE CONFERENCIA TECNICA VEGA BAJA CALLE BETANCES #51 FINAL -
CARR. #2 KM 77.0 AL MONUMENTO EMPLEADO DE LA CAÑA

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 3 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/16/2009

Quote Number : Q033788
 Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR
 Supplier : 00540202

Line Number	Item Number/Requisition	Quantity Required	Unit Price
Commodity Code/Description		UOM	UOM
Manufacturer Name		Lead Time	Total Line Value
Reference			Discount %
Description			

1	D081319/09-0000010707	19.00	
		EACH	

HOT DIPPED GALVANIZED, WELDED HEADER TYPE, DEMOUNTABLE STEEL RADIATORS TO REPLACE THE EXISTING COOLING SYSTEM OF PAUWELS POWER TRANSFORMER EQUAL TO SERIAL NUMBER 90.4.5750. PREPA WILL NOT EVALUATE HOT SPRAYED GALVANIZED RADIATORS.

RADIATORS ARE TO BE MADE OF ASTM-A-36 STEEL 18GA MINIMUM. THE FOLLOWING DIMENSIONS ARE BASED ON ACTUAL RADIATOR SIZE TO PROVIDE EQUIVALENT COOLING SURFACE. PAINTED RADIATORS WILL NOT BE EVALUATED.

DRAWINGS FOR APPROVAL SHALL BE SUBMITTED BY THE MANUFACTURER AND SHALL BE APPROVED BY PREPA BEFORE STARTING THE CONSTRUCTION OF THE RADIATORS. SEE ATTACHED DRAWING FOR ACTUAL DIMENSIONS.

VENDOR SHALL FOLLOW FABRICATION DETAIL:

A. BOTH HEADERS AT THE END PANEL OF EACH RADIATOR ARE TO HAVE ROUND PAD TERMINATION WITH THREADS, SO THE RADIATORS CAN BE TIED TOGETHER FOR STABILIZATION.

B. BOTH HEADERS SHALL BE PROVIDED WITH THREADED BRASS PLUGS TO DRAIN OR VENT THE RADIATOR.

C. THE RADIATOR PLATES SHALL BE BRACED PROPERLY TO ENSURE RIGIDITY AND TO AVOID PLATES DEFORMATION DURING THE GALVANIZING PROCESS.

D. THE RADIATORS SHALL BE LEAK TESTED AT 25 PSI MINIMUM.

E. AFTER LEAK TESTING, THE RADIATORS SHALL BE INTERNALLY FLUSHED TO GUARANTEE CLEANLINESS AND TO AVOID ADDITIONAL OIL FLUSHING BEFORE INSTALLATION.

F. AFTER FLUSHING THE RADIATOR, IT SHALL BE SEALED WITH GASKETED 1/4 STEEL COVERS.

G. IT IS PREFERRED THAT THE RADIATORS BE DELIVERED AT MONACILLOS TRANSMISSION CENTER.

H. RADIATORS SHALL ARRIVE PACKED IN AN OPEN CONTAINER IN A MANNER THAT WILL BE SUITABLE TO UNLOAD WITH A CRANE FROM THE TOP, OR WITH A

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 4 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/16/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

FORKLIFT TRUCK FROM BOTH SIDES OF THE PLATFORM.

I. THE BIDDERS CAN QUOTE AS A SEPARATE ITEM FOR THE UNLOADING OF THE RADIATORS.

Item Notes : 320-004-010

Line Number	Item Number/Requisition	Quantity Required	Unit Price
Commodity Code/Description		UOM	UOM
Manufacturer Name		Lead Time	Total Line Value
Reference			Discount %
Description			

2	D081298/09-0000010660	44.00	
		EACH	

HOT DIPPED GALVANIZED, WELDED HEADER TYPE, DEMOUNTABLE STEEL RADIATORS TO REPLACE THE EXISTING COOLING SYSTEM OF GENERAL ELECTRIC POWER TRANSFORMER EQUAL TO SERIAL NUMBER D-569631. PREPA WILL NOT EVALUATE HOT SPRAYED GALVANIZED RADIATORS.

RADIATORS ARE TO BE MADE OF ASTM-A-36 STEEL 18GA MINIMUM. THE FOLLOWING DIMENSIONS ARE BASED ON ACTUAL RADIATOR SIZE TO PROVIDE EQUIVALENT COOLING SURFACE. PAINTED RADIATORS WILL NOT BE EVALUATED.

DRAWINGS FOR APPROVAL SHALL BE SUBMITTED BY THE MANUFACTURER AND SHALL BE APPROVED BY PREPA BEFORE STARTING THE CONSTRUCTION OF THE RADIATORS. SEE ATTACHED DRAWING FOR ACTUAL DIMENSIONS.

VENDOR SHALL FOLLOW FABRICATION DETAIL:

A. BOTH HEADERS AT THE END PANEL OF EACH RADIATOR ARE TO HAVE ROUND PAD TERMINATION WITH THREADS, SO THE RADIATORS CAN BE TIED TOGETHER FOR STABILIZATION.

B. BOTH HEADERS SHALL BE PROVIDED WITH THREADED BRASS PLUGS TO DRAIN OR VENT THE RADIATOR.

C. THE RADIATOR PLATES SHALL BE BRACED PROPERLY TO ENSURE RIGIDITY AND TO AVOID PLATES DEFORMATION DURING THE GALVANIZING PROCESS.

D. THE RADIATORS SHALL BE LEAK TESTED AT 25 PSI MINIMUM.

E. AFTER LEAK TESTING, THE RADIATORS SHALL BE INTERNALLY FLUSHED TO GUARANTEE CLEANLINESS AND TO AVOID ADDITIONAL OIL FLUSHING BEFORE INSTALLATION.

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 5 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/16/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

F. AFTER FLUSHING THE RADIATOR, IT SHALL BE SEALED WITH GASKETED 1/4 STEEL COVERS.

G. IT IS PREFERRED THAT THE RADIATORS BE DELIVERED AT SAN JUAN STEAM PLANT.

H. RADIATORS SHALL ARRIVE PACKED IN AN OPEN CONTAINER IN A MANNER THAT WILL BE SUITABLE TO UNLOAD WITH A CRANE FROM THE TOP, OR WITH A FORKLIFT TRUCK FROM BOTH SIDES OF THE PLATFORM.

I. THE BIDDERS CAN QUOTE AS A SEPARATE ITEM FOR THE UNLOADING OF THE RADIATORS.

REQUISITOS Y DOCUMENTOS GENERALES:

1. TODO PROVEEDOR QUE INTERESE PARTICIPAR EN LOS PROCESOS DE COMPRAS EN LA AUTORIDAD DE ENERGIA ELECTRICA, TIENE QUE PERTENECER AL REGISTRO UNICO DE LICITADORES DE LA ADMINISTRACION DE SERVICIOS GENERALES DEL ESTADO LIBRE ASOCIADO DE PUERTO RICO Y AL REGISTRO DE LICITADORES DE LA AUTORIDAD DE ENERGÍA ELÉCTRICA.

2. TIENE QUE ESTAR REGISTRADO Y ACTIVO EN EL REGISTRO DE LICITADORES DE LA AUTORIDAD DE ENERGÍA ELÉCTRICA.

3. TIENE QUE ESTAR EVALUADO Y/O CALIFICADO PARA OFRECER LOS BIENES Y SERVICIOS SOLICITADOS ANTES DE SOMETER SU PROPUESTA.

4. LOS LICITADORES TIENEN QUE INCLUIR CON SU COTIZACIÓN UNA DECLARACIÓN JURADA DE NO CONFLICTO DE INTERESES.

GENERAL REQUIRED DOCUMENTS AND REQUIREMENTS

1. BIDDERS WHO HAS AN INTENTION TO PARTICIPATE IN PREPA'S PURCHASING PROCESSES SHALL BE REGISTERED AND ACTIVE IN PUERTO RICO'S GENERAL SERVICES ADMINISTRATION BIDDERS REGISTRY OFFICE AND PUERTO RICO'S ELECTRIC POWER AUTHORITY BIDDERS REGISTRY OFFICE.

2. BIDDERS MUST BE REGISTERED AND ACTIVE IN PREPA'S SUPPLIERS' REGISTRATION OFFICE.

3. ALL POSSIBLE BIDDERS MUST BE QUALIFIED AND/OR EVALUATED TO PROVIDE SERVICES OR GOODS BEFORE A PROPOSAL SUBMISSION.

4. BIDDERS SHALL INCLUDE PREPA'S SWORN STATEMENT OF NON- CONFLICT WITH PROPOSAL DOCUMENTS.

CLAUSULAS PARA PAGOS DE IMPUESTOS ESTATALES Y FEDERALES

EN CUMPLIMIENTO CON LA SECCIÓN 2906 DEL ARTÍCULO 2, DEL CÓDIGO DE RENTAS INTERNAS DE PUERTO RICO, LA AUTORIDAD DE ENERGÍA ELÉCTRICA ESTÁ EXENTA DEL PAGO DEL ARBITRIO GENERAL DEL 6.6%. ADEMÁS, A PARTIR DEL

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 6 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/16/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

15 DE NOVIEMBRE DE 2006, ESTÁ EXENTA DEL PAGO DEL IMPUESTO A LA VENTA Y USOS (IVU) ESTATAL Y MUNICIPAL POR VIRTUD DE LA SECCIÓN 2508 DE LA LEY 117 DEL 4 DE JULIO DE 2006, CONOCIDA COMO LA LEY DE JUSTICIA CONTRIBUTIVA.

* LAS FACTURAS TIENEN QUE DETALLAR EL CONCEPTO DE LA COMPRA O SERVICIO.

LOCAL AND FEDERAL TAXES CLAUSE

IN COMPLIANCE WITH PUERTO RICO'S INTERNAL REVENUE SERVICE CODE, SECTION 2906, ARTICLE 2, PUERTO RICO ELECTRIC POWER AUTHORITY IS EXEMPT OF 6.6% TAX PAYMENT, ALSO, STARTING ON NOVEMBER 15TH, 2006; AND IN ACCORDANCE TO LAW 117 OF 4TH OF JULY OF 2006, KNOWN AS LEY DE JUSTICIA CONTRIBUTIVA ; PREPA IS EXCEMPT OF IVU (IMPUESTO A LA VENTA Y USOS ESTATAL Y MUNICIPAL) TAX PAYMENT.

INVOICES SHALL INCLUDE ALL DETAILS RELATED TO GOOD OR SERVICE PURCHASED.

INSTRUCCIONES PARA PARTICIPAR EN SUBASTA FORMAL

1. SE INCLUYEN INSTRUCCIONES ESPECIALES PARA ESTA INVITACIÓN A SUBASTA FORMAL, ASÍ COMO LOS DOCUMENTOS QUE EN ELLA SE MENCIONAN.

2. LOS LICITADORES QUE INCLUYAN EN SU COTIZACIÓN SUS TÉRMINOS Y CONDICIONES DE VENTA O SERVICIO SERÁN DECLARADOS NO RESPONDIENTE. FAVOR VER EL ARTÍCULO 24 DE LAS INSTRUCCIONES A LOS LICITADORES.

3. GARANTÍA DE LA PROPUESTA
EL LICITADOR SOMETERÁ CON SU PROPUESTA UNA GARANTÍA DE LICITACIÓN (BID BOND) POR LA CANTIDAD DE 10 PORCIENTO DEL PRECIO TOTAL COTIZADO. LAS PROPUESTAS QUE NO INCLUYAN ESTA GARANTÍA SERÁN RECHAZADAS.

4. LA AEE NO ACEPTARÁ ESTA COTIZACIÓN POR FACCIÓN MIL U OTROS MEDIOS ELECTRÓNICOS.

5. NO SE OTORGARÁ CONTRATO DE CLASE ALGUNA EN EL CUAL NO SE ACOMPAÑE, PREVIO A LA FIRMA, UNA CERTIFICACIÓN DEL DEPARTAMENTO DE HACIENDA DONDE ESTABLEZCA QUE ESTÁ AL DÍA EN EL PAGO DE CONTRIBUCIONES O POSEE ALGÚN PLAN DE PAGOS.

FORMAL BLIND SEAL BID INSTRUCTIONS

1. SPECIAL INSTRUCTIONS AND OTHER DOCUMENTS MENTIONED IN THIS PUBLICATION ARE ATTACHED.

2. BIDDERS THAT INCLUDE THEIR OWN TERMS AND CONDITIONS WILL BE DISQUALIFIED AUTOMATICALLY. (SEE INSTRUCTIONS TO BIDDERS, ARTICLE 24)

3. BID PROPOSAL WARRANTIES:

A 10% OF A PROPOSAL TOTAL BID BOND IS REQUIRED FOR THIS BID. PROPOSALS

PUERTO RICO ELECTRIC POWER AUTHORITY

	Bid -- Purchase Order	Page 7 of 7
	Prepared Date	: 10/21/2009
	Replies Required By	: 11/16/2009
Quote Number	: Q033788	
Description	: HOT DIPPED GALVANIZED/ STEEL RADIATOR	
Supplier	: 00540202	

THAT NOT INCLUDE REQUIRED BID BOND WILL BE DESCQUALIFIED.

4. PROPOSALS WILL NOT BE ACCEPTED BY FAX OR E-MAIL.

5. PREPA WILL NOT SIGN ANY CONTRACT OR PO WITHOUT A PUERTO RICO I.R.S. NO DEBT CERTIFICATION.

INSTRUCCIONES PARA CARTA DE INTENCIÓN

* LA AUTORIDAD EMITIRÁ UNA CARTA DE INTENCIÓN DE ADJUDICACIÓN CON EL PROPÓSITO QUE DENTRO DE LOS PRÓXIMOS 10 DÍAS DE LA FECHA DE LA MISMA, EL PROVEEDOR AGRACIADO OBTENGA LOS DOCUMENTOS REQUERIDOS. DE NO HACERLO ASÍ, ESTARÁ SUJETO A LAS SANCIONES APLICABLES.

INTENTION LETTERS INSTRUCTIONS

* PREPA ARE GOING TO SENT AN INTENTION LETTER TO THE COMPANY SELECTED AFTER THE QUOTE IS AWARDED. THE SELECTED SUPPLIER IS RESPONSIBLE AFTER THE NEXT 10 DAY OF THE NOTIFICATION TO SUBMIT ALL DOCUMENTS AND INFORMATION REQUIRED. COMPANIES THAT ARE NOT COMPLY WITH THOSE REQUIREMENTS COULD BE SANCTIONED BY PREPA ACCORDING TO FORMAL BID POLICY RULES.

CRITERIO DE ACEPTACIÓN PARA APLICAR LA LEY NÚMERO 14 DEL 8 DE ENERO DE 2004

LA LEY NÚMERO 14 DEL 8 DE ENERO DE 2004 APLICA A LAS COMPRAS DE LA AUTORIDAD DE ENERGÍA ELÉCTRICA.

PARA CONSIDERAR Y APLICAR ESTA LEY EL LICITADOR TIENE QUE SOMETER CON SU COTIZACIÓN COPIA DE LA RESOLUCIÓN CON EL INCENTIVO DE PREFERENCIA OTORGADO POR LA JUNTA PARA LA INVERSIÓN DE LA INDUSTRIA PUERTORRIQUEÑA ADSCRITA A LA COMPAÑÍA DE FOMENTO INDUSTRIAL.

ACCEPTANCE CRITERIA FOR LAW NO. 14 OF JANUARY 8TH, 2004

LAW NO. 14 OF JANUARY 8TH, 2004; APPLIES TO PREPA'S PURCHASES.

IN ORDER TO CONSIDER AND APPLY THIS LAW, BIDDERS SHAL HAVE TO INCLUDE WITH A PROPOSAL, AN APPROVED COPY OF THE INCENTIVO DE PREFERENCIA RESOLUTION. THIS DOCUMENT WILL PRESENT AN INCENTIVE PERCENTAGE APPROVED BY LA JUNTA PARA LA INVERSIÓN DE LA INDUSTRIA PUERTORRIQUEÑA .

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 1 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009


Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

To : BULLETIN BOARD
DIVISION DE SUMINISTROS
SAN JUAN PR 00936
United States of America

From : FRANCES M. PÉREZ
PR Electric Power Authority
PO Box 364267
San Juan PR 00936-4267
US



Phone :
Fax :

Phone : (787) 289-3300

DELIVERY POINT OFFER:

DELIVERY PROMISE:

PAYMENT TERMS:

P.R. EXCISE TAXES INCLUDED
(Y/N)

SELLING TERMS (CHOOSE ONE)

FOB FAS CIF C+F

VALIDITY: (IN DAYS)

Authorized Signature

TITLE:

S.S.:

DATE:

PH:

FAX:

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 2 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

Deliver To : ING. LUIS ALTUZ CORTÉS
PUERTO RICO POWER AUTHORITY
DIV. CONS. ELECT. Y PROT. DEL
SIST.
PLANIFICACION CONS. ELECT.
RIO PIEDRAS
PR
00926

Notes: *****APENDICE I *****

NUMERO DE PUBLICACION: Q033788

NUM DE REQ.: 09-10707 - 09-10660

FECHA DE APERTURA: 11/03/09

HORA: 10:30 AM

LUGAR: SALON DE SUBASTAS - TERCER PISO, EDIFICIO NEOS, SANTURCE.

ENTREGA: RENGLON 1. MONACILLOS

RENGLON 2. CENRTAL SAN JUAN

**LOS RADIADORES DEBEN ENTREGARSE EN PLATAFORMA ABIERTA.

*****APENDICE I (10-28/09)*****

SE GENERA ESTE APENDICE I PARA INFORMAR A LOS LICITADORES DE LO SIGUIENTE:

1. SE INCLUYE DIBUJO PARA EL RENGLON 2.

EL RESTO DE LOS TERMINOS Y CONDICIONES PERMANECEN INALTERADOS.

FRANCES M. PEREZ - SUPERVISOR DE COMPRAS SENIOR

TEL: (787) 521-3315, 3316

FAX. (787) 521-2593, e-mail: fr-perez-dsad@prepa.com

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 3 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

Line Number	Item Number/Requisition	Quantity Required	Unit Price
Commodity Code/Description		UOM	UOM
Manufacturer Name		Lead Time	Total Line Value
Reference			Discount %
Description			

1	D081319/09-0000010707	19.00	
		EACH	

HOT DIPPED GALVANIZED, WELDED HEADER TYPE, DEMOUNTABLE STEEL RADIATORS TO REPLACE THE EXISTING COOLING SYSTEM OF PAUWELS POWER TRANSFORMER EQUAL TO SERIAL NUMBER 90.4.5750. PREPA WILL NOT EVALUATE HOT SPRAYED GALVANIZED RADIATORS.

RADIATORS ARE TO BE MADE OF ASTM-A-36 STEEL 18GA MINIMUM. THE FOLLOWING DIMENSIONS ARE BASED ON ACTUAL RADIATOR SIZE TO PROVIDE EQUIVALENT COOLING SURFACE. PAINTED RADIATORS WILL NOT BE EVALUATED.

DRAWINGS FOR APPROVAL SHALL BE SUBMITTED BY THE MANUFACTURER AND SHALL BE APPROVED BY PREPA BEFORE STARTING THE CONSTRUCTION OF THE RADIATORS. SEE ATTACHED DRAWING FOR ACTUAL DIMENSIONS.

VENDOR SHALL FOLLOW FABRICATION DETAIL:

A. BOTH HEADERS AT THE END PANEL OF EACH RADIATOR ARE TO HAVE ROUND PAD TERMINATION WITH THREADS, SO THE RADIATORS CAN BE TIED TOGETHER FOR STABILIZATION.

B. BOTH HEADERS SHALL BE PROVIDED WITH THREADED BRASS PLUGS TO DRAIN OR VENT THE RADIATOR.

C. THE RADIATOR PLATES SHALL BE BRACED PROPERLY TO ENSURE RIGIDITY AND TO AVOID PLATES DEFORMATION DURING THE GALVANIZING PROCESS.

D. THE RADIATORS SHALL BE LEAK TESTED AT 25 PSI MINIMUM.

E. AFTER LEAK TESTING, THE RADIATORS SHALL BE INTERNALLY FLUSHED TO GUARANTEE CLEANLINESS AND TO AVOID ADDITIONAL OIL FLUSHING BEFORE INSTALLATION.

F. AFTER FLUSHING THE RADIATOR, IT SHALL BE SEALED WITH GASKETED 1/4 STEEL COVERS.

G. IT IS PREFERRED THAT THE RADIATORS BE DELIVERED AT MONACILLOS TRANSMISSION CENTER.

H. RADIATORS SHALL ARRIVE PACKED IN AN OPEN CONTAINER IN A MANNER THAT WILL BE SUITABLE TO UNLOAD WITH A CRANE FROM THE TOP, OR WITH A

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 4 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

FORKLIFT TRUCK FROM BOTH SIDES OF THE PLATFORM.

I. THE BIDDERS CAN QUOTE AS A SEPARATE ITEM FOR THE UNLOADING OF THE RADIATORS.

Item Notes : 320-004-010

Line Number	Item Number/Requisition	Quantity Required	Unit Price
	Commodity Code/Description	UOM	UOM
	Manufacturer Name	Lead Time	Total Line Value
	Reference		Discount %
	Description		

2	D081298/09-0000010660	44.00	
		EACH	

HOT DIPPED GALVANIZED, WELDED HEADER TYPE, DEMOUNTABLE STEEL RADIATORS TO REPLACE THE EXISTING COOLING SYSTEM OF GENERAL ELECTRIC POWER TRANSFORMER EQUAL TO SERIAL NUMBER D-569631. PREPA WILL NOT EVALUATE HOT SPRAYED GALVANIZED RADIATORS.

RADIATORS ARE TO BE MADE OF ASTM-A-36 STEEL 18GA MINIMUM. THE FOLLOWING DIMENSIONS ARE BASED ON ACTUAL RADIATOR SIZE TO PROVIDE EQUIVALENT COOLING SURFACE. PAINTED RADIATORS WILL NOT BE EVALUATED.

DRAWINGS FOR APPROVAL SHALL BE SUBMITTED BY THE MANUFACTURER AND SHALL BE APPROVED BY PREPA BEFORE STARTING THE CONSTRUCTION OF THE RADIATORS. SEE ATTACHED DRAWING FOR ACTUAL DIMENSIONS.

VENDOR SHALL FOLLOW FABRICATION DETAIL:

A. BOTH HEADERS AT THE END PANEL OF EACH RADIATOR ARE TO HAVE ROUND PAD TERMINATION WITH THREADS, SO THE RADIATORS CAN BE TIED TOGETHER FOR STABILIZATION.

B. BOTH HEADERS SHALL BE PROVIDED WITH THREADED BRASS PLUGS TO DRAIN OR VENT THE RADIATOR.

C. THE RADIATOR PLATES SHALL BE BRACED PROPERLY TO ENSURE RIGIDITY AND TO AVOID PLATES DEFORMATION DURING THE GALVANIZING PROCESS.

D. THE RADIATORS SHALL BE LEAK TESTED AT 25 PSI MINIMUM.

E. AFTER LEAK TESTING, THE RADIATORS SHALL BE INTERNALLY FLUSHED TO GUARANTEE CLEANLINESS AND TO AVOID ADDITIONAL OIL FLUSHING BEFORE INSTALLATION.

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 5 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

F. AFTER FLUSHING THE RADIATOR, IT SHALL BE SEALED WITH GASKETED 1/4 STEEL COVERS.

G. IT IS PREFERRED THAT THE RADIATORS BE DELIVERED AT SAN JUAN STEAM PLANT.

H. RADIATORS SHALL ARRIVE PACKED IN AN OPEN CONTAINER IN A MANNER THAT WILL BE SUITABLE TO UNLOAD WITH A CRANE FROM THE TOP, OR WITH A FORKLIFT TRUCK FROM BOTH SIDES OF THE PLATFORM.

I. THE BIDDERS CAN QUOTE AS A SEPARATE ITEM FOR THE UNLOADING OF THE RADIATORS.

REQUISITOS Y DOCUMENTOS GENERALES:

1. TODO PROVEEDOR QUE INTERESE PARTICIPAR EN LOS PROCESOS DE COMPRAS EN LA AUTORIDAD DE ENERGIA ELECTRICA, TIENE QUE PERTENECER AL REGISTRO UNICO DE LICITADORES DE LA ADMINISTRACION DE SERVICIOS GENERALES DEL ESTADO LIBRE ASOCIADO DE PUERTO RICO Y AL REGISTRO DE LICITADORES DE LA AUTORIDAD DE ENERGÍA ELÉCTRICA.

2. TIENE QUE ESTAR REGISTRADO Y ACTIVO EN EL REGISTRO DE LICITADORES DE LA AUTORIDAD DE ENERGÍA ELÉCTRICA.

3. TIENE QUE ESTAR EVALUADO Y/O CALIFICADO PARA OFRECER LOS BIENES Y SERVICIOS SOLICITADOS ANTES DE SOMETER SU PROPUESTA.

4. LOS LICITADORES TIENEN QUE INCLUIR CON SU COTIZACIÓN UNA DECLARACIÓN JURADA DE NO CONFLICTO DE INTERESES.

GENERAL REQUIRED DOCUMENTS AND REQUIREMENTS

1. BIDDERS WHO HAS AN INTENTION TO PARTICIPATE IN PREPA'S PURCHASING PROCESSES SHALL BE REGISTERED AND ACTIVE IN PUERTO RICO'S GENERAL SERVICES ADMINISTRATION BIDDERS REGISTRY OFFICE AND PUERTO RICO'S ELECTRIC POWER AUTHORITY BIDDERS REGISTRY OFFICE.

2. BIDDERS MUST BE REGISTERED AND ACTIVE IN PREPA'S SUPPLIERS' REGISTRATION OFFICE.

3. ALL POSSIBLE BIDDERS MUST BE QUALIFIED AND/OR EVALUATED TO PROVIDE SERVICES OR GOODS BEFORE A PROPOSAL SUBMISSION.

4. BIDDERS SHALL INCLUDE PREPA'S SWORN STATEMENT OF NON- CONFLICT WITH PROPOSAL DOCUMENTS.

CLAUSULAS PARA PAGOS DE IMPUESTOS ESTATALES Y FEDERALES

EN CUMPLIMIENTO CON LA SECCIÓN 2906 DEL ARTÍCULO 2, DEL CÓDIGO DE RENTAS INTERNAS DE PUERTO RICO, LA AUTORIDAD DE ENERGÍA ELÉCTRICA ESTÁ EXENTA DEL PAGO DEL ARBITRIO GENERAL DEL 6.6%. ADEMÁS, A PARTIR DEL

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 6 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

15 DE NOVIEMBRE DE 2006, ESTÁ EXENTA DEL PAGO DEL IMPUESTO A LA VENTA Y USOS (IVU) ESTATAL Y MUNICIPAL POR VIRTUD DE LA SECCIÓN 2508 DE LA LEY 117 DEL 4 DE JULIO DE 2006, CONOCIDA COMO LA LEY DE JUSTICIA CONTRIBUTIVA.

* LAS FACTURAS TIENEN QUE DETALLAR EL CONCEPTO DE LA COMPRA O SERVICIO.

LOCAL AND FEDERAL TAXES CLAUSE

IN COMPLIANCE WITH PUERTO RICO'S INTERNAL REVENUE SERVICE CODE, SECTION 2906, ARTICLE 2, PUERTO RICO ELECTRIC POWER AUTHORITY IS EXEMPT OF 6.6% TAX PAYMENT, ALSO, STARTING ON NOVEMBER 15TH, 2006; AND IN ACCORDANCE TO LAW 117 OF 4TH OF JULY OF 2006, KNOWN AS LEY DE JUSTICIA CONTRIBUTIVA ; PREPA IS EXEMPT OF IVU (IMPUESTO A LA VENTA Y USOS ESTATAL Y MUNICIPAL) TAX PAYMENT.

INVOICES SHALL INCLUDE ALL DETAILS RELATED TO GOOD OR SERVICE PURCHASED.

INSTRUCCIONES PARA PARTICIPAR EN SUBASTA FORMAL

1. SE INCLUYEN INSTRUCCIONES ESPECIALES PARA ESTA INVITACIÓN A SUBASTA, ASÍ COMO LOS DOCUMENTOS QUE EN ELLA SE MENCIONAN.
2. LOS LICITADORES QUE INCLUYAN EN SU COTIZACIÓN SUS TÉRMINOS Y CONDICIONES DE VENTA O SERVICIO SERÁN DECLARADOS NO RESPONDIENTE. FAVOR VER EL ARTÍCULO 24 DE LAS INSTRUCCIONES A LOS LICITADORES.
3. GARANTÍA DE LA PROPUESTA
EL LICITADOR SOMETERÁ CON SU PROPUESTA UNA GARANTÍA DE LICITACIÓN (BID BOND) POR LA CANTIDAD DE 10 PORCIENTO DEL PRECIO TOTAL COTIZADO. LAS PROPUESTAS QUE NO INCLUYAN ESTA GARANTÍA SERÁN RECHAZADAS.
4. LA AEE NO ACEPTARÁ ESTA COTIZACIÓN POR FAX O MEDIOS ELECTRÓNICOS.
5. NO SE OTORGARÁ CONTRATO DE CLASE ALGUNA EN EL CUAL NO SE ACOMPAÑE, PREVIO A LA FIRMA, UNA CERTIFICACIÓN DEL DEPARTAMENTO DE HACIENDA COMO QUE ESTÁ AL DÍA O TIENE PLAN DE PAGOS POR CONTRIBUCIÓN.

FORMAL BLIND SEAL BID INSTRUCTIONS

1. SPECIAL INSTRUCTIONS AND OTHER DOCUMENTS MENTIONED IN THIS PUBLICATION ARE ATTACHED.
2. BIDDERS THAT INCLUDE THEIR OWN TERMS AND CONDITIONS WILL BE DISQUALIFIED AUTOMATICALLY. (SEE INSTRUCTIONS TO BIDDERS, ARTICLE 24)
3. BID PROPOSAL WARRANTIES:
A 10% OF A PROPOSAL TOTAL BID BOND IS REQUIRED FOR THIS BID. PROPOSALS THAT NOT INCLUDE REQUIRED BID BOND WILL BE DISQUALIFIED.

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 7 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

4. PROPOSALS WILL NOT BE ACCEPTED BY FAX OR E-MAIL.

5. PREPA WILL NOT SIGN ANY CONTRACT OR PO WITHOUT A PUERTO RICO I.R.S. NO DEBT CERTIFICATION.

INSTRUCCIONES PARA CARTA DE INTENCIÓN

* LA AUTORIDAD EMITIRÁ UNA CARTA DE INTENCIÓN DE ADJUDICACIÓN CON EL PROPÓSITO QUE DENTRO DE LOS PRÓXIMOS 10 DÍAS DE LA FECHA DE LA MISMA, EL PROVEEDOR AGRACIADO OBTENGA LOS DOCUMENTOS REQUERIDOS. DE NO HACERLO ASÍ, ESTARÁ SUJETO A LAS SANCIONES APLICABLES.

INTENTION LETTERS INSTRUCTIONS

* PREPA ARE GOING TO SENT AN INTENTION LETTER TO THE COMPANY SELECTED AFTER THE QUOTE IS AWARDED. THE SELECTED SUPPLIER IS RESPONSIBLE AFTER THE NEXT 10 DAY OF THE NOTIFICATION TO SUBMIT ALL DOCUMENTS AND INFORMATION REQUIRED. COMPANIES THAT ARE NOT COMPLY WITH THOSE REQUIREMENTS COULD BE SANCTIONED BY PREPA ACCORDING TO FORMAL BID POLICY RULES.

CRITERIO DE ACEPTACIÓN PARA APLICAR LA LEY NÚMERO 14 DEL 8 DE ENERO DE 2004

LA LEY NÚMERO 14 DEL 8 DE ENERO DE 2004 APLICA A LAS COMPRAS DE LA AUTORIDAD DE ENERGÍA ELÉCTRICA.




PARA CONSIDERAR Y APLICAR ESTA LEY EL LICITADOR TIENE QUE SOMETER CON SU COTIZACIÓN COPIA DE LA RESOLUCIÓN CON EL INCENTIVO DE PREFERENCIA OTORGADO POR LA JUNTA PARA LA INVERSIÓN DE LA INDUSTRIA PUERTORRIQUEÑA ADSCRITA A LA COMPAÑÍA DE FOMENTO INDUSTRIAL.

ACCEPTANCE CRITERIA FOR LAW NO. 14 OF JANUARY 8TH, 2004

LAW NO. 14 OF JANUARY 8TH, 2004; APPLIES TO PREPA'S PURCHASES.

IN ORDER TO CONSIDER AND APPLY THIS LAW, BIDDERS SHAL HAVE TO INCLUDE WITH A PROPOSAL, AN APPROVED COPY OF THE INCENTIVO DE PREFERENCIA RESOLUTION. THIS DOCUMENT WILL PRESENT AN INCENTIVE PERCENTAGE APPROVED BY LA JUNTA PARA LA INVERSIÓN DE LA INDUSTRIA PUERTORRIQUEÑA.

INFORME DE CONDICIÓN DE RADIADORES MPT UB, CENTRAL SAN JUAN.

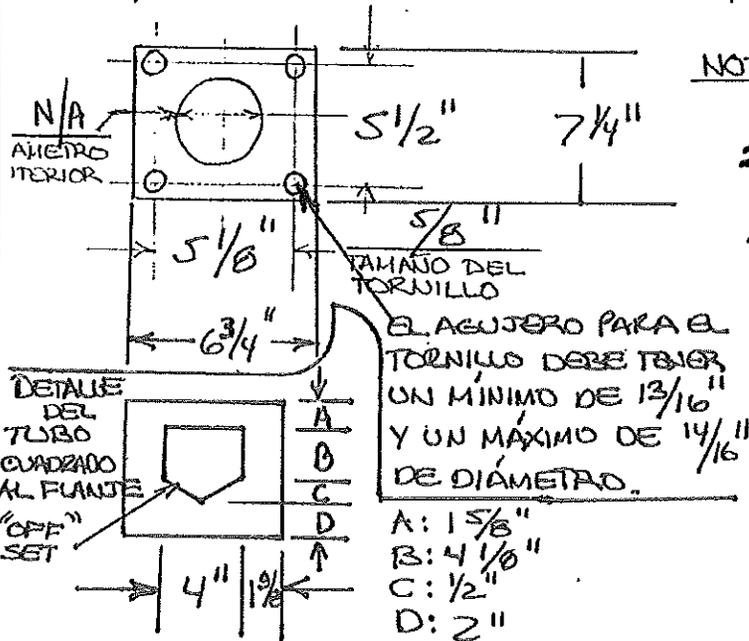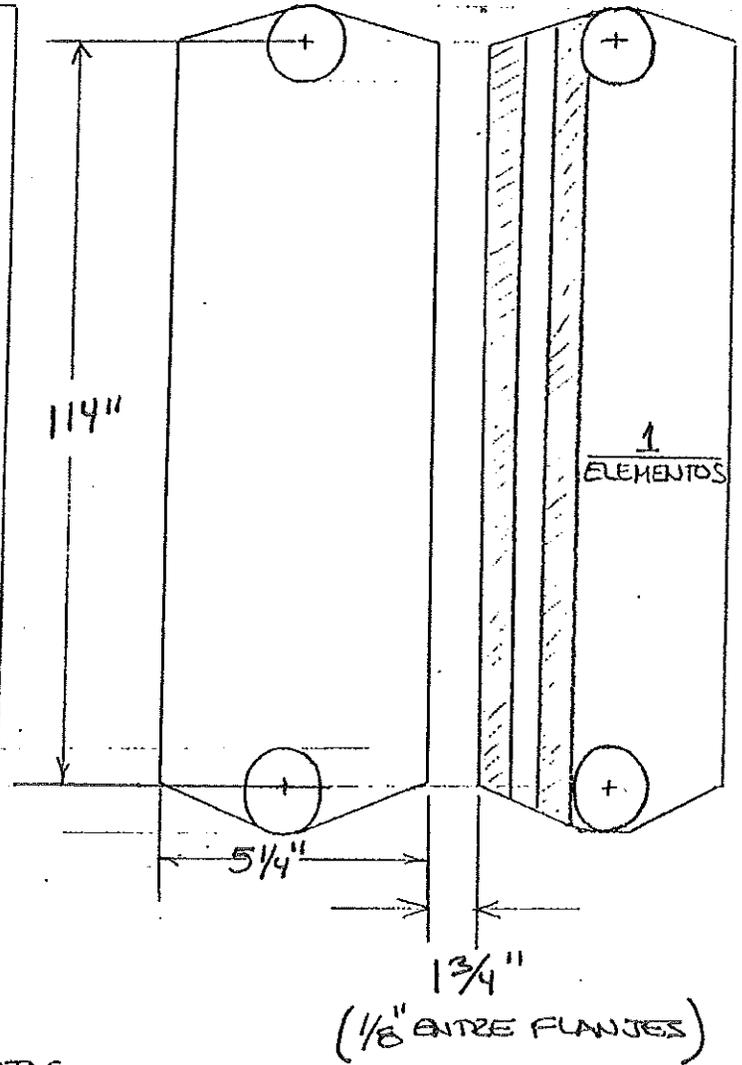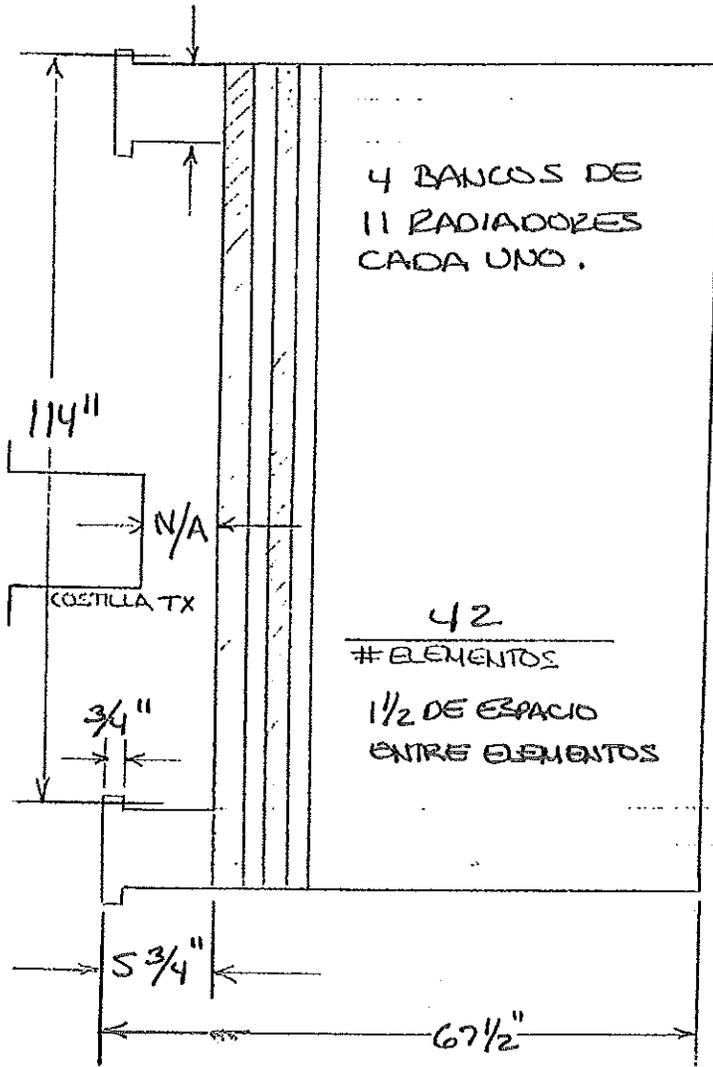

NOTAS

2. LOS TUBOS INFERIORES Y SUPERIORES
NO ESTÁN EN EL CENTRO DEL FLANJE
2. LOS RADIADORES NO TIENEN VÁLVULAS

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 1 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009


Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

To : BULLETIN BOARD
DIVISION DE SUMINISTROS
SAN JUAN PR 00936
United States of America

From : FRANCES M. PÉREZ
PR Electric Power Authority
PO Box 364267
San Juan PR 00936-4267
US



Phone :

Phone : (787) 289-3300

Fax :

DELIVERY POINT OFFER:

DELIVERY PROMISE:

PAYMENT TERMS:

P.R. EXCISE TAXES INCLUDED

(Y/N)

SELLING TERMS (CHOOSE ONE)

FOB ___ FAS ___ CIF ___ C+F ___

VALIDITY: (IN DAYS)

Authorized Signature

TITLE:

S.S.:

DATE:

PH:

FAX:

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 2 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

Deliver To : ING. LUIS ALTUZ CORTÉS
PUERTO RICO POWER AUTHORITY
DIV. CONS. ELECT. Y PROT. DEL
SIST.
PLANIFICACION CONS. ELECT.
RIO PIEDRAS
PR
00926

Notes: NUMERO DE PUBLICACION: Q033788
NUM DE REQ.: 09-10707 - 09-10660
FECHA DE APERTURA: 11/03/09
HORA: 10:30 AM
LUGAR: SALON DE SUBASTAS - TERCER PISO, EDIFICIO NEOS, SANTURCE.

ENTREGA: RENGLON 1. MONACILLOS
RENGLON 2. CENRTAL SAN JUAN

**LOS RADIADORES DEBEN ENTREGARSE EN PLATAFORMA ABIERTA.

NOTAS ESPECIALES:

1. PARA ESTA SUBASTA O SOLICITUD DE PRECIO LA AEE ACEPTARA PIEZAS IGUAL O APROBADO IGUAL A LAS ESPECIFICADAS EXCEPTO EN LOS RENGLONES QUE SE ESPECIFIQUE LO CONTRARIO. FAVOR SOMETER LITERATURA TÉCNICA SI SU PRODUCTO NO ES IGUAL AL ESPECIFICADO. EL LICITADOR QUE NO INDIQUE MARCA Y MODELO SE PRESUME QUE ESTA OFERTANDO LO ESPECIFICADO.

2. LOS LICITADORES COTIZARAN LOS MATERIALES Y SERVICIOS SOLICITADOS CON ENTREGA EN SITIO.

3. ES REQUISITO PARA LOS LICITADORES CONTAR CON LA CERTIFICACIÓN DE ELEGIBILIDAD DEL REGISTRO ÚNICO DE LICITADORES DE LA ADMINISTRACIÓN DE SERVICIOS GENERALES DEL ELA DE PR PARA LA ADJUDICACIÓN DE LA ORDEN. FAVOR SOMETER CON SU PROPUESTA COPIA ACTUALIZADA DE LA MISMA

4. EL LICITADOR AGRACIADO TENDRA QUE SOMETER UNA FIANZA DE EJECUCION DE 30 PORCIENTO DEL TOTAL DEL PRECIO COTIZADO.

5. PARA ESTA SUBASTA LA AUTORIDAD REQUIERE QUE LOS LICITADORES INCLUYAN CON SU PROPUESTA UNA FIANZA DE LICITACIÓN INDIVIDUAL DEL 10 PORCIENTO DEL PRECIO TOTAL, FORMULARIO AEE 500.0-368. OFERTAS QUE INCUMPLAN CON ESTE REQUERIMIENTO SERÁN RECHAZADAS.

6. FAVOR VERIFICAR TODOS LOS RENGLONES ANTES DE COTIZAR.

7. SE INCLUYE DIBUJO EN DOCUMENTO APARTE.

FRANCES M. PEREZ - SUPERVISOR DE COMPRAS SENIOR
TEL: (787) 521-3315, 3316

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 3 of 7

Prepared Date : 10/21/2009
 Replies Required By : 11/03/2009

Quote Number : Q033788
 Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR
 Supplier : 00540202

FAX. (787) 521-2593, e-mail: fr-perez-dsad@prepa.com

Line Number	Item Number/Requisition	Quantity Required	Unit Price
Commodity Code/Description		UOM	UOM
Manufacturer Name		Lead Time	Total Line Value
Reference			Discount %
Description			

1	D081319/09-0000010707	19.00	
		EACH	

HOT DIPPED GALVANIZED, WELDED HEADER TYPE, DEMOUNTABLE STEEL RADIATORS TO REPLACE THE EXISTING COOLING SYSTEM OF PAUWELS POWER TRANSFORMER EQUAL TO SERIAL NUMBER 90.4.5750. PREPA WILL NOT EVALUATE HOT SPRAYED GALVANIZED RADIATORS.

RADIATORS ARE TO BE MADE OF ASTM-A-36 STEEL 18GA MINIMUM. THE FOLLOWING DIMENSIONS ARE BASED ON ACTUAL RADIATOR SIZE TO PROVIDE EQUIVALENT COOLING SURFACE. PAINTED RADIATORS WILL NOT BE EVALUATED.

DRAWINGS FOR APPROVAL SHALL BE SUBMITTED BY THE MANUFACTURER AND SHALL BE APPROVED BY PREPA BEFORE STARTING THE CONSTRUCTION OF THE RADIATORS. SEE ATTACHED DRAWING FOR ACTUAL DIMENSIONS.

VENDOR SHALL FOLLOW FABRICATION DETAIL:

A. BOTH HEADERS AT THE END PANEL OF EACH RADIATOR ARE TO HAVE ROUND PAD TERMINATION WITH THREADS, SO THE RADIATORS CAN BE TIED TOGETHER FOR STABILIZATION.

B. BOTH HEADERS SHALL BE PROVIDED WITH THREADED BRASS PLUGS TO DRAIN OR VENT THE RADIATOR.

C. THE RADIATOR PLATES SHALL BE BRACED PROPERLY TO ENSURE RIGIDITY AND TO AVOID PLATES DEFORMATION DURING THE GALVANIZING PROCESS.

D. THE RADIATORS SHALL BE LEAK TESTED AT 25 PSI MINIMUM.

E. AFTER LEAK TESTING, THE RADIATORS SHALL BE INTERNALLY FLUSHED TO GUARANTEE CLEANLINESS AND TO AVOID ADDITIONAL OIL FLUSHING BEFORE INSTALLATION.

F. AFTER FLUSHING THE RADIATOR, IT SHALL BE SEALED WITH GASKETED 1/4 STEEL COVERS.

G. IT IS PREFERRED THAT THE RADIATORS BE DELIVERED AT MONACILLOS TRANSMISSION CENTER.

H. RADIATORS SHALL ARRIVE PACKED IN AN OPEN CONTAINER IN A MANNER THAT

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 4 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

WILL BE SUITABLE TO UNLOAD WITH A CRANE FROM THE TOP, OR WITH A FORKLIFT TRUCK FROM BOTH SIDES OF THE PLATFORM.

I. THE BIDDERS CAN QUOTE AS A SEPARATE ITEM FOR THE UNLOADING OF THE RADIATORS.

Item Notes : 320-004-010

Line Number	Item Number/Requisition	Quantity Required	Unit Price
Commodity Code/Description		UOM	UOM
Manufacturer Name		Lead Time	Total Line Value
Reference			Discount %
Description			

2	D081298/09-0000010660	44.00	
		EACH	

HOT DIPPED GALVANIZED, WELDED HEADER TYPE, DEMOUNTABLE STEEL RADIATORS TO REPLACE THE EXISTING COOLING SYSTEM OF GENERAL ELECTRIC POWER TRANSFORMER EQUAL TO SERIAL NUMBER D-569631. PREPA WILL NOT EVALUATE HOT SPRAYED GALVANIZED RADIATORS.

RADIATORS ARE TO BE MADE OF ASTM-A-36 STEEL 18GA MINIMUM. THE FOLLOWING DIMENSIONS ARE BASED ON ACTUAL RADIATOR SIZE TO PROVIDE EQUIVALENT COOLING SURFACE. PAINTED RADIATORS WILL NOT BE EVALUATED.

DRAWINGS FOR APPROVAL SHALL BE SUBMITTED BY THE MANUFACTURER AND SHALL BE APPROVED BY PREPA BEFORE STARTING THE CONSTRUCTION OF THE RADIATORS. SEE ATTACHED DRAWING FOR ACTUAL DIMENSIONS.

VENDOR SHALL FOLLOW FABRICATION DETAIL:

A. BOTH HEADERS AT THE END PANEL OF EACH RADIATOR ARE TO HAVE ROUND PAD TERMINATION WITH THREADS, SO THE RADIATORS CAN BE TIED TOGETHER FOR STABILIZATION.

B. BOTH HEADERS SHALL BE PROVIDED WITH THREADED BRASS PLUGS TO DRAIN OR VENT THE RADIATOR.

C. THE RADIATOR PLATES SHALL BE BRACED PROPERLY TO ENSURE RIGIDITY AND TO AVOID PLATES DEFORMATION DURING THE GALVANIZING PROCESS.

D. THE RADIATORS SHALL BE LEAK TESTED AT 25 PSI MINIMUM.

E. AFTER LEAK TESTING, THE RADIATORS SHALL BE INTERNALLY FLUSHED TO GUARANTEE CLEANLINESS AND TO AVOID ADDITIONAL OIL FLUSHING BEFORE INSTALLATION.

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 5 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

F. AFTER FLUSHING THE RADIATOR, IT SHALL BE SEALED WITH GASKETED 1/4 STEEL COVERS.

G. IT IS PREFERRED THAT THE RADIATORS BE DELIVERED AT SAN JUAN STEAM PLANT.

H. RADIATORS SHALL ARRIVE PACKED IN AN OPEN CONTAINER IN A MANNER THAT WILL BE SUITABLE TO UNLOAD WITH A CRANE FROM THE TOP, OR WITH A FORKLIFT TRUCK FROM BOTH SIDES OF THE PLATFORM.

I. THE BIDDERS CAN QUOTE AS A SEPARATE ITEM FOR THE UNLOADING OF THE RADIATORS.

REQUISITOS Y DOCUMENTOS GENERALES:

1. TODO PROVEEDOR QUE INTERESE PARTICIPAR EN LOS PROCESOS DE COMPRAS EN LA AUTORIDAD DE ENERGIA ELECTRICA, TIENE QUE PERTENECER AL REGISTRO UNICO DE LICITADORES DE LA ADMINISTRACION DE SERVICIOS GENERALES DEL ESTADO LIBRE ASOCIADO DE PUERTO RICO Y AL REGISTRO DE LICITADORES DE LA AUTORIDAD DE ENERGÍA ELÉCTRICA.

2. TIENE QUE ESTAR REGISTRADO Y ACTIVO EN EL REGISTRO DE LICITADORES DE LA AUTORIDAD DE ENERGÍA ELÉCTRICA.

3. TIENE QUE ESTAR EVALUADO Y/O CALIFICADO PARA OFRECER LOS BIENES Y SERVICIOS SOLICITADOS ANTES DE SOMETER SU PROPUESTA.

4. LOS LICITADORES TIENEN QUE INCLUIR CON SU COTIZACIÓN UNA DECLARACIÓN JURADA DE NO CONFLICTO DE INTERESES.

GENERAL REQUIRED DOCUMENTS AND REQUIREMENTS

1. BIDDERS WHO HAS AN INTENTION TO PARTICIPATE IN PREPA'S PURCHASING PROCESSES SHALL BE REGISTERED AND ACTIVE IN PUERTO RICO'S GENERAL SERVICES ADMINISTRATION BIDDERS REGISTRY OFFICE AND PUERTO RICO'S ELECTRIC POWER AUTHORITY BIDDERS REGISTRY OFFICE.

2. BIDDERS MUST BE REGISTERED AND ACTIVE IN PREPA'S SUPPLIERS' REGISTRATION OFFICE.

3. ALL POSSIBLE BIDDERS MUST BE QUALIFIED AND/OR EVALUATED TO PROVIDE SERVICES OR GOODS BEFORE A PROPOSAL SUBMISSION.

4. BIDDERS SHALL INCLUDE PREPA'S SWORN STATEMENT OF NON- CONFLICT WITH PROPOSAL DOCUMENTS.

CLAUSULAS PARA PAGOS DE IMPUESTOS ESTATALES Y FEDERALES

EN CUMPLIMIENTO CON LA SECCIÓN 2906 DEL ARTÍCULO 2, DEL CÓDIGO DE RENTAS INTERNAS DE PUERTO RICO, LA AUTORIDAD DE ENERGÍA ELÉCTRICA ESTÁ

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 6 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

EXENTA DEL PAGO DEL ARBITRIO GENERAL DEL 6.6%. ADEMÁS, A PARTIR DEL 15 DE NOVIEMBRE DE 2006, ESTÁ EXENTA DEL PAGO DEL IMPUESTO A LA VENTA Y USOS (IVU) ESTATAL Y MUNICIPAL POR VIRTUD DE LA SECCIÓN 2508 DE LA LEY 117 DEL 4 DE JULIO DE 2006, CONOCIDA COMO LA LEY DE JUSTICIA CONTRIBUTIVA.

* LAS FACTURAS TIENEN QUE DETALLAR EL CONCEPTO DE LA COMPRA O SERVICIO.

LOCAL AND FEDERAL TAXES CLAUSE

IN COMPLIANCE WITH PUERTO RICO'S INTERNAL REVENUE SERVICE CODE, SECTION 2906, ARTICLE 2, PUERTO RICO ELECTRIC POWER AUTHORITY IS EXEMPT OF 6.6% TAX PAYMENT, ALSO, STARTING ON NOVEMBER 15TH, 2006; AND IN ACCORDANCE TO LAW 117 OF 4TH OF JULY OF 2006, KNOWN AS LEY DE JUSTICIA CONTRIBUTIVA ; PREPA IS EXEMPT OF IVU (IMPUESTO A LA VENTA Y USOS ESTATAL Y MUNICIPAL) TAX PAYMENT.

INVOICES SHALL INCLUDE ALL DETAILS RELATED TO GOOD OR SERVICE PURCHASED.

INSTRUCCIONES PARA PARTICIPAR EN SUBASTA FORMAL

1. SE INCLUYEN INSTRUCCIONES ESPECIALES PARA ESTA INVITACIÓN A SUBASTA, ASÍ COMO LOS DOCUMENTOS QUE EN ELLA SE MENCIONAN.

2. LOS LICITADORES QUE INCLUYAN EN SU COTIZACIÓN SUS TÉRMINOS Y CONDICIONES DE VENTA O SERVICIO SERÁN DECLARADOS NO RESPONDIENTE. FAVOR VER EL ARTÍCULO 24 DE LAS INSTRUCCIONES A LOS LICITADORES.

3. GARANTÍA DE LA PROPUESTA

EL LICITADOR SOMETERÁ CON SU PROPUESTA UNA GARANTÍA DE LICITACIÓN (BID BOND) POR LA CANTIDAD DE 10 PORCIENTO DEL PRECIO TOTAL COTIZADO. LAS PROPUESTAS QUE NO INCLUYAN ESTA GARANTÍA SERÁN RECHAZADAS.

4. LA AEE NO ACEPTARÁ ESTA COTIZACIÓN POR FAX O MEDIOS ELECTRÓNICOS.

5. NO SE OTORGARÁ CONTRATO DE CLASE ALGUNA EN EL CUAL NO SE ACOMPAÑE, PREVIO A LA FIRMA, UNA CERTIFICACIÓN DEL DEPARTAMENTO DE HACIENDA COMO QUE ESTÁ AL DÍA O TIENE PLAN DE PAGOS POR CONTRIBUCIÓN.

FORMAL BLIND SEAL BID INSTRUCTIONS

1. SPECIAL INSTRUCTIONS AND OTHER DOCUMENTS MENTIONED IN THIS PUBLICATION ARE ATTACHED.

2. BIDDERS THAT INCLUDE THEIR OWN TERMS AND CONDITIONS WILL BE DISQUALIFIED AUTOMATICALLY. (SEE INSTRUCTIONS TO BIDDERS, ARTICLE 24)

3. BID PROPOSAL WARRANTIES:

A 10% OF A PROPOSAL TOTAL BID BOND IS REQUIRED FOR THIS BID. PROPOSALS THAT NOT INCLUDE REQUIRED BID BOND WILL BE DISQUALIFIED.

PUERTO RICO ELECTRIC POWER AUTHORITY

Bid -- Purchase Order

Page 7 of 7

Prepared Date

: 10/21/2009

Replies Required By

: 11/03/2009

Quote Number : Q033788

Description : HOT DIPPED GALVANIZED/ STEEL RADIATOR

Supplier : 00540202

4. PROPOSALS WILL NOT BE ACCEPTED BY FAX OR E-MAIL.

5. PREPA WILL NOT SIGN ANY CONTRACT OR PO WITHOUT A PUERTO RICO I.R.S. NO DEBT CERTIFICATION.

INSTRUCCIONES PARA CARTA DE INTENCIÓN

* LA AUTORIDAD EMITIRÁ UNA CARTA DE INTENCIÓN DE ADJUDICACIÓN CON EL PROPÓSITO QUE DENTRO DE LOS PRÓXIMOS 10 DÍAS DE LA FECHA DE LA MISMA, EL PROVEEDOR AGRACIADO OBTENGA LOS DOCUMENTOS REQUERIDOS. DE NO HACERLO ASÍ, ESTARÁ SUJETO A LAS SANCIONES APLICABLES.

INTENTION LETTERS INSTRUCTIONS

* PREPA ARE GOING TO SENT AN INTENTION LETTER TO THE COMPANY SELECTED AFTER THE QUOTE IS AWARDED. THE SELECTED SUPPLIER IS RESPONSIBLE AFTER THE NEXT 10 DAY OF THE NOTIFICATION TO SUBMIT ALL DOCUMENTS AND INFORMATION REQUIRED. COMPANIES THAT ARE NOT COMPLY WITH THOSE REQUIREMENTS COULD BE SANCTIONED BY PREPA ACCORDING TO FORMAL BID POLICY RULES.

CRITERIO DE ACEPTACIÓN PARA APLICAR LA LEY NÚMERO 14 DEL 8 DE ENERO DE 2004

LA LEY NÚMERO 14 DEL 8 DE ENERO DE 2004 APLICA A LAS COMPRAS DE LA AUTORIDAD DE ENERGÍA ELÉCTRICA.

PARA CONSIDERAR Y APLICAR ESTA LEY EL LICITADOR TIENE QUE SOMETER CON SU COTIZACIÓN COPIA DE LA RESOLUCIÓN CON EL INCENTIVO DE PREFERENCIA OTORGADO POR LA JUNTA PARA LA INVERSIÓN DE LA INDUSTRIA PUERTORRIQUEÑA ADSCRITA A LA COMPAÑÍA DE FOMENTO INDUSTRIAL.

ACCEPTANCE CRITERIA FOR LAW NO. 14 OF JANUARY 8TH, 2004

LAW NO. 14 OF JANUARY 8TH, 2004; APPLIES TO PREPA'S PURCHASES.

IN ORDER TO CONSIDER AND APPLY THIS LAW, BIDDERS SHAL HAVE TO INCLUDE WITH A PROPOSAL, AN APPROVED COPY OF THE INCENTIVO DE PREFERENCIA RESOLUTION. THIS DOCUMENT WILL PRESENT AN INCENTIVE PERCENTAGE APPROVED BY LA JUNTA PARA LA INVERSIÓN DE LA INDUSTRIA PUERTORRIQUEÑA.

ESTADO LIBRE ASOCIADO DE PUERTO RICO
AUTORIDAD DE ENERGÍA ELÉCTRICA DE PUERTO RICO


SAN JUAN, PUERTO RICO



www.acepr.com
TRANSFORMADOR
RANKED 115 138 KW
VOLT BAJA TC (166-02-003-002)


APARTADO 364267
CORREO GENERAL
SAN JUAN, PUERTO RICO 00936-4267

Informe de Condición de Radiadores


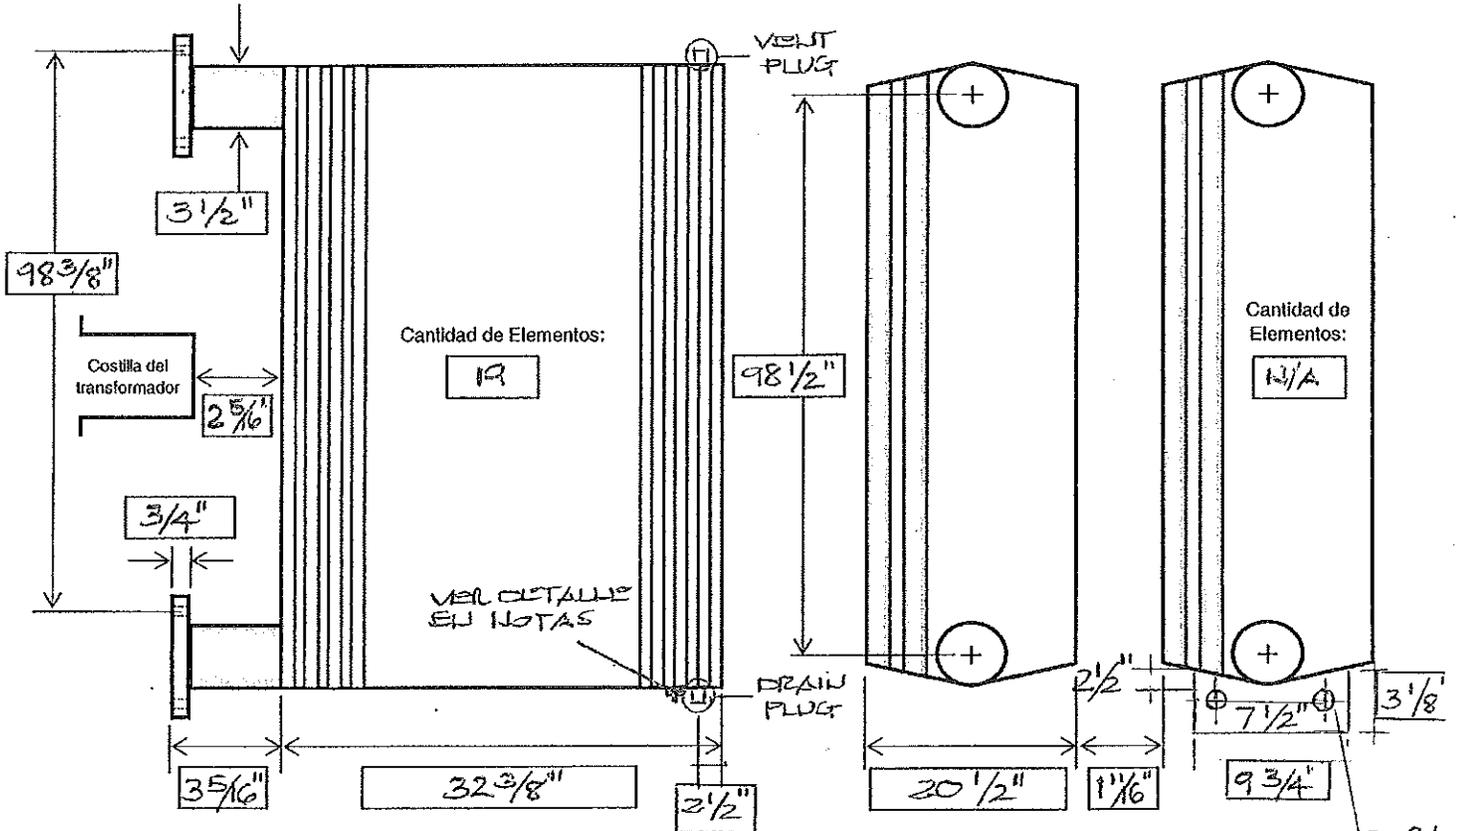


Notas:

Detalle del Flange:

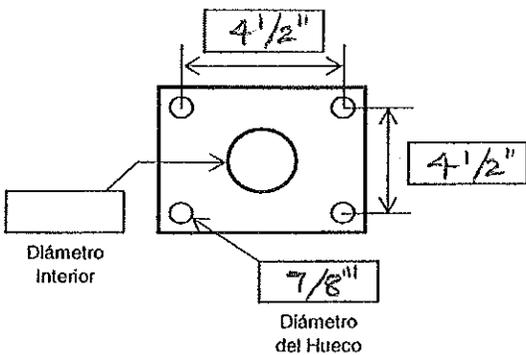

DETALLE SOPORTE DEL APARATO (VISTA LATERAL)

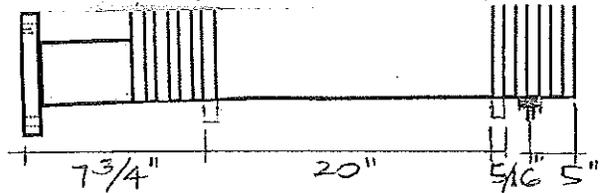

DETALLE DE PIEZA PARA INSTALAR BRACES QUE EVITAN EL MAXIMIZADO DEL RADIADOR

Requisición EMPAC:

Requisición Local:

"Somos un patrono con igualdad de oportunidades en el empleo y no discriminamos por razón de raza, color, sexo, edad, origen social o nacional, condición social, afiliación política, ideas políticas o religiosas; por ser víctima o ser percibida como víctima de violencia doméstica, agresión sexual o acoso, por impedimento físico, mental o ambos o condición de veterano."