

# DeviceNet

---

## NI-DNET™ User Manual

**Internet Support**

E-mail: [support@natinst.com](mailto:support@natinst.com)

FTP Site: <ftp.natinst.com>

Web Address: <http://www.natinst.com>

**Bulletin Board Support**

BBS United States: 512 794 5422

BBS United Kingdom: 01635 551422

BBS France: 01 48 65 15 59

**Fax-on-Demand Support**

512 418 1111

**Telephone Support (USA)**

Tel: 512 795 8248

Fax: 512 794 5678

**International Offices**

Australia 03 9879 5166, Austria 0662 45 79 90 0, Belgium 02 757 00 20, Brazil 011 288 3336,  
Canada (Ontario) 905 785 0085, Canada (Québec) 514 694 8521, Denmark 45 76 26 00, Finland 09 725 725 11,  
France 01 48 14 24 24, Germany 089 741 31 30, Hong Kong 2645 3186, Israel 03 6120092, Italy 02 413091,  
Japan 03 5472 2970, Korea 02 596 7456, Mexico 5 520 2635, Netherlands 0348 433466, Norway 32 84 84 00,  
Singapore 2265886, Spain 91 640 0085, Sweden 08 730 49 70, Switzerland 056 200 51 51, Taiwan 02 377 1200,  
United Kingdom 01635 523545

**National Instruments Corporate Headquarters**

6504 Bridge Point Parkway Austin, Texas 78730-5039 USA Tel: 512 794 0100

# Important Information

---

## Warranty

The media on which you receive National Instruments software are warranted not to fail to execute programming instructions, due to defects in materials and workmanship, for a period of 90 days from date of shipment, as evidenced by receipts or other documentation. National Instruments will, at its option, repair or replace software media that do not execute programming instructions if National Instruments receives notice of such defects during the warranty period. National Instruments does not warrant that the operation of the software shall be uninterrupted or error free.

A Return Material Authorization (RMA) number must be obtained from the factory and clearly marked on the outside of the package before any equipment will be accepted for warranty work. National Instruments will pay the shipping costs of returning to the owner parts which are covered by warranty.

National Instruments believes that the information in this manual is accurate. The document has been carefully reviewed for technical accuracy. In the event that technical or typographical errors exist, National Instruments reserves the right to make changes to subsequent editions of this document without prior notice to holders of this edition. The reader should consult National Instruments if errors are suspected. In no event shall National Instruments be liable for any damages arising out of or related to this document or the information contained in it.

EXCEPT AS SPECIFIED HEREIN, NATIONAL INSTRUMENTS MAKES NO WARRANTIES, EXPRESS OR IMPLIED, AND SPECIFICALLY DISCLAIMS ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. CUSTOMER'S RIGHT TO RECOVER DAMAGES CAUSED BY FAULT OR NEGLIGENCE ON THE PART OF NATIONAL INSTRUMENTS SHALL BE LIMITED TO THE AMOUNT THERETOFORE PAID BY THE CUSTOMER. NATIONAL INSTRUMENTS WILL NOT BE LIABLE FOR DAMAGES RESULTING FROM LOSS OF DATA, PROFITS, USE OF PRODUCTS, OR INCIDENTAL OR CONSEQUENTIAL DAMAGES, EVEN IF ADVISED OF THE POSSIBILITY THEREOF. This limitation of the liability of National Instruments will apply regardless of the form of action, whether in contract or tort, including negligence. Any action against National Instruments must be brought within one year after the cause of action accrues. National Instruments shall not be liable for any delay in performance due to causes beyond its reasonable control. The warranty provided herein does not cover damages, defects, malfunctions, or service failures caused by owner's failure to follow the National Instruments installation, operation, or maintenance instructions; owner's modification of the product; owner's abuse, misuse, or negligent acts; and power failure or surges, fire, flood, accident, actions of third parties, or other events outside reasonable control.

## Copyright

Under the copyright laws, this publication may not be reproduced or transmitted in any form, electronic or mechanical, including photocopying, recording, storing in an information retrieval system, or translating, in whole or in part, without the prior written consent of National Instruments Corporation.

## Trademarks

BridgeVIEW™, LabVIEW™, LabWindows/CVI™, NI-CAN™, and NI-DNET™ are trademarks of National Instruments Corporation.

Product and company names listed are trademarks or trade names of their respective companies.

## WARNING REGARDING MEDICAL AND CLINICAL USE OF NATIONAL INSTRUMENTS PRODUCTS

National Instruments products are not designed with components and testing intended to ensure a level of reliability suitable for use in treatment and diagnosis of humans. Applications of National Instruments products involving medical or clinical treatment can create a potential for accidental injury caused by product failure, or by errors on the part of the user or application designer. Any use or application of National Instruments products for or involving medical or clinical treatment must be performed by properly trained and qualified medical personnel, and all traditional medical safeguards, equipment, and procedures that are appropriate in the particular situation to prevent serious injury or death should always continue to be used when National Instruments products are being used. National Instruments products are NOT intended to be a substitute for any form of established process, procedure, or equipment used to monitor or safeguard human health and safety in medical or clinical treatment.

# Contents

---

## About This Manual

How to Use the Manual Set .....	ix
Organization of This Manual .....	x
Conventions Used in This Manual .....	x
Related Documentation .....	xi
Customer Communication .....	xi

## Chapter 1 Introduction

DeviceNet Overview .....	1-1
History of DeviceNet .....	1-1
Physical Characteristics of DeviceNet .....	1-2
General Object Modeling Concepts .....	1-2
Object Modeling in the DeviceNet Specification .....	1-3
Explicit Messaging Connections .....	1-5
I/O Connections .....	1-7
Polled I/O .....	1-8
Bit Strobed I/O .....	1-8
Change-of-State and Cyclic I/O .....	1-9
Assembly Objects .....	1-11
Device Profiles .....	1-13
Open DeviceNet Vendors Association (ODVA) .....	1-13
NI-DNET Software Overview .....	1-13
NI-DNET Objects .....	1-14
Interface Object .....	1-14
Explicit Messaging Object .....	1-15
I/O Object .....	1-15
Example .....	1-16
NI-DNET Software Components .....	1-16
NI-DNET Driver and Utilities .....	1-17
Firmware Image Files .....	1-18
Language Interface Files .....	1-18
Application Examples .....	1-18
WinDnet Support Files .....	1-19

## Chapter 2 Developing Your Application

How to Access the NI-DNET Software from your Programming Environment .....	2-1
Using LabVIEW or BridgeVIEW (G) .....	2-1
Using LabWindows/CVI.....	2-1
Using Microsoft C/C++ or Borland C/C++ .....	2-2
Direct Entry Access .....	2-3
Programming Model for NI-DNET Applications .....	2-5
Step 1. Open Objects.....	2-6
Step 2. Start Communication .....	2-7
Step 3. Run Your DeviceNet Application.....	2-7
Step 4. Stop Communication .....	2-8
Step 5. Close Objects .....	2-8
Handling Status in G (LabVIEW/BridgeVIEW).....	2-8
Checking Status.....	2-8
Status Format .....	2-9
Status .....	2-10
Code.....	2-10
Source .....	2-10
Handling Status in C.....	2-11
Checking Status.....	2-11
Status Format .....	2-12
Error/Warning Indicators (Severity).....	2-12
Code.....	2-13
Qualifier.....	2-13

## Chapter 3 NI-DNET Programming Techniques

Configuring I/O Connections .....	3-1
Expected Packet Rate.....	3-1
Strobed I/O .....	3-2
Polled I/O.....	3-3
Scanned Polling.....	3-3
Background Polling.....	3-4
Individual Polling .....	3-5
Cyclic I/O .....	3-6
Change-of-State (COS) I/O .....	3-7
Automatic EPR Feature .....	3-7
Using I/O Data in Your Application .....	3-8
Accessing I/O Members in LabVIEW .....	3-10
Accessing I/O Members in C .....	3-11

Using Explicit Messaging Services .....	3-12
Get and Set Attributes in a Remote DeviceNet Device.....	3-12
Other Explicit Messaging Services .....	3-13
Handling Multiple Devices .....	3-14
Configuration.....	3-15
Object Handles .....	3-15
Main Loop .....	3-16
SimpleWho Utility .....	3-17
DeviceNet Network Management .....	3-19

## Chapter 4

### Application Examples

Example 1. SingleDevice.....	4-1
Run the Example .....	4-2
Program Flow Chart .....	4-5
Extending the Example.....	4-6
Example 2. GetIdentityAttrs .....	4-8
Run the Example .....	4-9
Program Flow Chart .....	4-10
Extending the Example.....	4-11

## Appendix A

### Customer Communication

### Glossary

### Index

### Figures

Figure 1-1. Classes of Geometric Shapes .....	1-3
Figure 1-2. Object Model.....	1-4
Figure 1-3. Polled I/O Example .....	1-8
Figure 1-4. Strobed I/O Example .....	1-9
Figure 1-5. COS/Cyclic I/O Example .....	1-11
Figure 1-6. Input and Output Assemblies .....	1-12
Figure 1-7. Input Assembly for Photoeye or Limit Switch.....	1-12
Figure 1-8. NI-DNET Objects for a Small Network of Three Devices .....	1-16
Figure 1-9. Structure of an NI-DNET System .....	1-17

Figure 2-1.	General Programming Steps for an NI-DNET Application.....	2-6
Figure 2-2.	NI-DNET Error Cluster Example .....	2-9
Figure 2-3.	Error Cluster Code Field .....	2-10
Figure 2-4.	Status Format in C .....	2-12
Figure 3-1.	Strobed I/O Timing Example .....	3-2
Figure 3-2.	Scanned Polling Timing Example .....	3-4
Figure 3-3.	Background Polling Timing Example .....	3-5
Figure 3-4.	Individual Polling Timing Example.....	3-6
Figure 3-5.	Congestion Due to Back-to-Back COS I/O .....	3-7
Figure 3-6.	AC Drive Output Assembly, Instance 20 .....	3-9
Figure 4-1.	SingleDevice Front Panel .....	4-2
Figure 4-2.	Programming Steps for SingleDevice Example .....	4-6
Figure 4-3.	GetIdentityAttrs Front Panel.....	4-8
Figure 4-4.	Programming Steps for GetIdentityAttrs Example.....	4-11

## Tables

Table 1-1.	DeviceNet Baud Rates and Cable Lengths .....	1-2
Table 1-2.	Explicit Message Request .....	1-6
Table 1-3.	Explicit Message Response.....	1-6
Table 2-1.	Determining Severity of Status .....	2-12
Table 3-1.	Attribute Mapping for Basic Speed Control Output Assembly .....	3-10


# About This Manual

---

This manual describes the basics of DeviceNet and explains how to develop an application program. It also provides detailed examples you can use as models for your own applications. The NI-DNET software is meant to be used with either Windows 95/98 or Windows NT version 3.51 or later. This manual assumes that you are already familiar with the Windows system you are using.

## How to Use the Manual Set

---

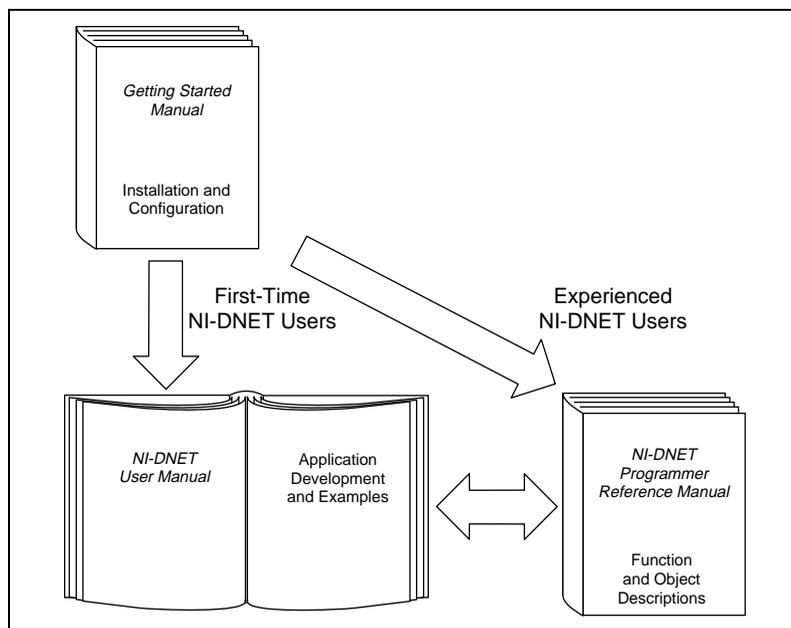

Use the getting started manual to install and configure your DeviceNet hardware and the NI-DNET software for Windows 95/98 or Windows NT.

Use this *NI-DNET User Manual* to learn the basics of DeviceNet and how to develop an application program. The user manual also contains detailed examples.

Use the *NI-DNET Programmer Reference Manual* for specific information about each NI-DNET function and object, including format, parameters, and possible errors.

# Organization of This Manual

---

This manual is organized as follows:

- Chapter 1, *Introduction*, gives an overview of DeviceNet and the NI-DNET software.
- Chapter 2, *Developing Your Application*, explains how to develop an application program using the NI-DNET functions.
- Chapter 3, *NI-DNET Programming Techniques*, describes various techniques to help you program your NI-DNET application.
- Chapter 4, *Application Examples*, describes the example applications provided with your NI-DNET software.
- Appendix A, *Customer Communication*, contains forms you can use to request help from National Instruments or to comment on our products and manuals.
- The *Glossary* contains an alphabetical list and description of terms used in this manual, including abbreviations, acronyms, metric prefixes, mnemonics, and symbols.
- The *Index* contains an alphabetical list of key terms and topics in this manual, including the page where you can find each one.

# Conventions Used in This Manual

---

The following conventions are used in this manual:

- » The » symbol leads you through nested menu items and dialog box options to a final action. The sequence **File»Page Setup»Options»Substitute Fonts** directs you to open the **File** menu, select the **Page Setup** item, select **Options**, and finally select the **Substitute Fonts** option from the last dialog box.
- bold** Bold text denotes the names of menus, menu items, dialog boxes, dialog box buttons or options, icons, windows, Windows 95/98 or Windows NT tabs, or LEDs.
- italic* Italic text denotes emphasis, a cross reference, or an introduction to a key concept. This font also denotes text from which you supply the appropriate word or value, as in Windows 3.x.
- monospace Text in this font denotes text or characters that should literally enter from the keyboard, sections of code, programming examples, and syntax examples. This font is also used for the proper names of disk drives, paths,

directories, programs, subprograms, subroutines, device names, functions, parameters, operations, variables, filenames and extensions, and for statements and comments taken from programs.

paths

Paths in this manual are denoted using backslashes (\) to separate drive names, directories, folders, and files.

## Related Documentation

---

The following documents contain information that you may find helpful as you read this manual:

- ANSI/ISO Standard 11898-1993, *Road Vehicles—Interchange of Digital Information—Controller Area Network (CAN) for High-Speed Communication*
- *DeviceNet Specification, Version 2.0*, Open DeviceNet Vendor Association
- LabVIEW online reference
- ODVA website, [www.odva.org](http://www.odva.org)
- Microsoft Win32 Software Development Kit (SDK) online help

## Customer Communication

---

National Instruments wants to receive your comments on our products and manuals. We are interested in the applications you develop with our products, and we want to help if you have problems with them. To make it easy for you to contact us, this manual contains comment and configuration forms for you to complete. These forms are in Appendix A, *Customer Communication*, at the end of this manual.

---

# Introduction

This chapter gives an overview of DeviceNet and the NI-DNET software.

## DeviceNet Overview

---

### History of DeviceNet

The Controller Area Network (CAN) was developed in the early 1980s by Bosch, a leading automotive equipment supplier. CAN was developed to overcome the limitations of conventional automotive wiring harnesses. CAN connects devices such as engine controllers, anti-lock brake controllers, and various sensors and actuators on a common serial bus. By using a common pair of signal wires, any device on a CAN network can communicate with any other device.

As CAN implementations became widespread throughout the automotive industry, CAN was standardized internationally as ISO 11898, and major semiconductor manufacturers such as Intel, Motorola, and Philips began producing CAN chips. With these developments, many manufacturers of industrial automation equipment began to consider other applications of CAN technology. Automotive and industrial device networks showed many similarities, including the transition away from dedicated signal lines, low cost, resistance to harsh environments, and excellent real-time capabilities.

In response to these similarities, Allen-Bradley developed DeviceNet, an industrial networking protocol based on CAN. DeviceNet built on CAN's communication facilities to provide higher-level features which allow industrial devices from different vendors to operate on the same network.

Soon after DeviceNet was developed, Allen-Bradley transferred the specification to an independent organization called the Open DeviceNet Vendor's Association (ODVA). ODVA formally manages the *DeviceNet Specification* and provides services to facilitate development of DeviceNet devices and tools by various vendors. Due in large part to the efforts of ODVA, hundreds of different vendors now provide DeviceNet products for a wide range of applications.

## Physical Characteristics of DeviceNet

The list below summarizes the physical characteristics of DeviceNet:

- Trunkline-dropline cabling: main trunk cable with a drop cable for each device
- Selectable baud rates of 125K, 250K, and 500K

**Table 1-1.** DeviceNet Baud Rates and Cable Lengths

Baud Rate	Trunk Length	Drop Length Maximum	Drop Length Cumulative
125Kb/s	500 m (1640 ft)	6 m (20 ft)	156 m (512 ft)
250Kb/s	250 m (820 ft)	6 m (20 ft)	78 m (256 ft)
500Kb/s	100 m (328 ft)	6 m (20 ft)	39 m (128 ft)

- Support for up to 64 devices: each device identifies itself using a MAC ID (Media Access Control Identifier) from 0-63
- Device removal/insertion without severing the network
- Simultaneous support for both network-powered and self-powered devices
- Various connector styles

For complete information on how to connect your National Instruments hardware onto the DeviceNet network, refer to Chapter 2, *Installation*, and Appendix B, *Cabling Requirements*, in your getting started manual.


## General Object Modeling Concepts

The *DeviceNet Specification* uses *object-oriented modeling* to describe the behavior of different components in a device, how those components relate to one another, and how network communication takes place. The following paragraphs briefly describe object-oriented modeling and how these concepts are used within the *DeviceNet Specification*.

In object-oriented terminology, a classification of components with similar qualities is called a *class*. For example, different classes of geometric shapes would include squares, circles, and triangles. All squares belong to the same class because they all have similar qualities, such as four equal sides. The term *instance* refers to a specific instance of a given class. For example, a blue square of 4 inches per side would be one instance, and a red square of 5 inches per side would be another instance. The term *object*

is often used as a synonym for the term instance, although in some contexts it may also refer to a class.


Each class defines a set of *attributes* which represent its externally visible characteristics. The set of attributes defined by a class are common to all instances within that class. For the class square, attributes could include length of each side and color. For the class circle, attributes could include radius and color. Each class also defines a set of *services* (or *methods*) which are used to perform an operation on an instance. For the class square, services could include resize, rotate, or change color. Figure 1-1 shows various classes and instances of geometric shapes:

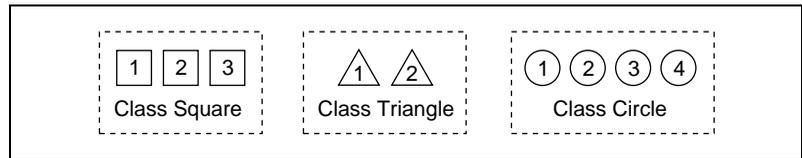

**Figure 1-1.** Classes of Geometric Shapes

## Object Modeling in the DeviceNet Specification

Figure 1-2 illustrates the object modeling used within the *DeviceNet Specification*.

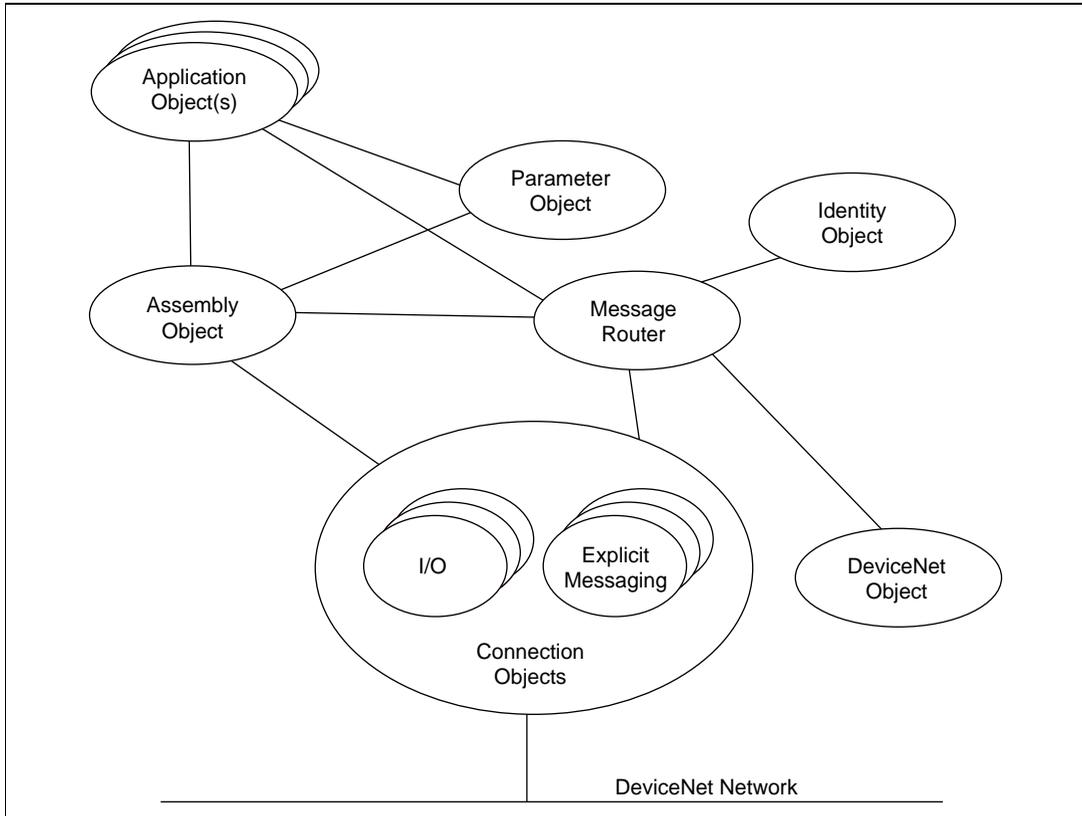

**Figure 1-2.** Object Model

Every DeviceNet device contains at least one instance (instance one) of the *Identity Object*. The Identity Object instance defines attributes which describe the device, including the device's vendor, product name, and serial number. The Identity Object also defines services which apply to the entire device. For example, if you use the Reset service on instance one of the Identity Object, the device resets to its power on state.

Another class of object contained in every DeviceNet device is the *Connection Object*. Each instance of the Connection Object represents a communication path to one or more devices. Attributes of each Connection Object instance include the maximum number of bytes produced on the connection, the maximum number of bytes consumed, and the expected rate at which data is transferred.

In Figure 1-2, the term *Application Objects* refers to objects within the device which are used to perform its fundamental behavior. For example,

within a photoelectric sensor, an instance of the Presence Sensing object (an Application Object) represents the physical photoelectric sensor hardware. Within a position controller device, an instance of the Position Controller object (an Application Object) is provided for every axis (motor) which can be controlled using the device.

For more information on the classes, instances, attributes, and services provided by DeviceNet, refer to the *DeviceNet Specification*. Additional information on the specific classes and instances supported by a given device can often be found in the documentation provided by the device's vendor.

Although the NI-DNET driver software provides object instances which are used to access the DeviceNet network, these objects do not correspond directly to the objects defined by the *DeviceNet Specification*, and the NI-DNET functions do not directly correspond to the services defined by DeviceNet. In order to facilitate access to your DeviceNet network, the features provided by the NI-DNET driver are a simplification of the objects and services defined in the *DeviceNet Specification*.

## Explicit Messaging Connections

Each device on the DeviceNet network supports at least one *explicit messaging connection*. Explicit messaging connections provide a general-purpose communication path used to execute services on a particular object in a device.

For a given explicit messaging connection between two DeviceNet devices, the device requesting execution of the service is called the *client*, and the device to which the service request is directed is called the *server*. Your NI-DNET software can be used as an explicit messaging client with any number of DeviceNet server devices.

Using an explicit messaging connection, the client device sends an explicit message request to the server device. This request indicates the service to perform and the object to which the service is directed. When the server receives the explicit message request, it executes the service and sends an explicit message response to the client device. If the service executed successfully, this response contains information requested by the client.

The MAC ID (address) of the explicit message client and server are contained in the header of the DeviceNet explicit messages.

The following tables describe the general format of DeviceNet explicit message requests and responses as they appear on the DeviceNet network:

**Table 1-2.** Explicit Message Request

<b>Field</b>	<b>Description</b>
Service Code	This number identifies the service requested by the client. Valid service codes are defined in the <i>DeviceNet Specification</i> .
Class ID	This number identifies the class to which the service is directed. Valid class IDs are defined in the <i>DeviceNet Specification</i> .
Instance ID	This number identifies the instance to which the service is directed. If the instance ID is zero, the service is directed to the entire class. If the instance ID is one or greater, the service is directed to a specific instance within the class.
Service Data	Data bytes which are specific to the Service Code. The number and format of these data bytes is defined by the specification for the service.

**Table 1-3.** Explicit Message Response

<b>Field</b>	<b>Description</b>
Service Code	This number indicates success or failure for execution of the service. If this number is the same as the Service Code of the request, the service executed successfully. If this number is 14 hex, the service failed to execute due to an error.
Service Data	<p>If the service executed successfully, this field contains data bytes which are specific to the Service Code. The number and format of these data bytes is defined by the specification for the service.</p> <p>If the service failed to execute, the first byte of Service Data contains a General Error Code which describes the error, and the second byte contains an Additional Error Code which qualifies the error. Valid values for the General Error Code and Additional Error Code are defined in the <i>DeviceNet Specification</i>.</p>

The *DeviceNet Specification* defines a set of services which are supported in a common way by different devices. These common services include Reset, Save, Restore, Get Attribute Single, and Set Attributes Single.

The Get Attribute Single service is used to obtain the value of a specific attribute within a device's object, and the Set Attribute Single service is used to set the value of an attribute. These Get and Set services are the most commonly used explicit messaging services. Since these two services are used often, NI-DNET provides functions for these services: `ncGetDnetAttribute` and `ncSetDnetAttribute`.

Other services defined by DeviceNet are used less often. For these services, NI-DNET provides general purpose functions to send an explicit message request (`ncWriteDnetExplMsg`) and receive an explicit message response (`ncReadDnetExplMsg`). These NI-DNET functions use parameters which are similar to the explicit message request/response listed above. For more information on DeviceNet common services other than Get/Set Attribute Single, refer to the *DeviceNet Specification*.

## I/O Connections

In addition to explicit messaging connections, DeviceNet devices provide another type of Connection Object called an *I/O connection*. I/O connections provide a communication path for the exchange of physical input/output (sensor/actuator) data as well as other control-oriented data. I/O connections are useful for transferring data at regular intervals.

Since many DeviceNet devices do not begin their normal operation until an I/O connection is established, explicit messaging is often used for configuration and initialization. For example, for a device with an analog input, the I/O connection is normally used to read the analog input measurement, and explicit messages are used for configuration such as setting the measurement range and units (such as  $-10\text{ V}$  to  $+10\text{ V}$  versus  $4\text{ mA}$  to  $20\text{ mA}$ ).

The *DeviceNet Specification* defines two types of I/O connections: *master/slave* and *peer-to-peer*. In master/slave I/O connections, a master device uses an I/O connection to communicate with one or more slave devices, and those slave devices can only communicate with the master and not one another. In peer-to-peer I/O connections, each device on the network can communicate as a peer, and communication paths between peer devices are established as needed. The NI-DNET software currently supports only master/slave I/O connections because the procedure used to establish these I/O connections is more well defined. For this reasons,

almost all existing DeviceNet devices only implement master/slave I/O connections.

The *DeviceNet Specification* defines four types of master/slave I/O connections: *polled*, *bit strobed*, *change-of-state* (COS), and *cyclic*. A slave device can support at most one polled, one strobed, and one COS or cyclic connection (COS and cyclic connections cannot be used simultaneously).

## Polled I/O

The polled I/O connection uses a request/response scheme for each device. The master sends a poll command (request) message to the slave device with any amount of output data. The slave then sends a poll response message back to the master with any amount of input data. The poll command/response messages are handled individually for each slave which supports polled I/O connections. Polled I/O is typically used for devices which provide both input and output data, such as position controllers and modular I/O devices.

Figure 1-3 shows an example of four polled slave devices.

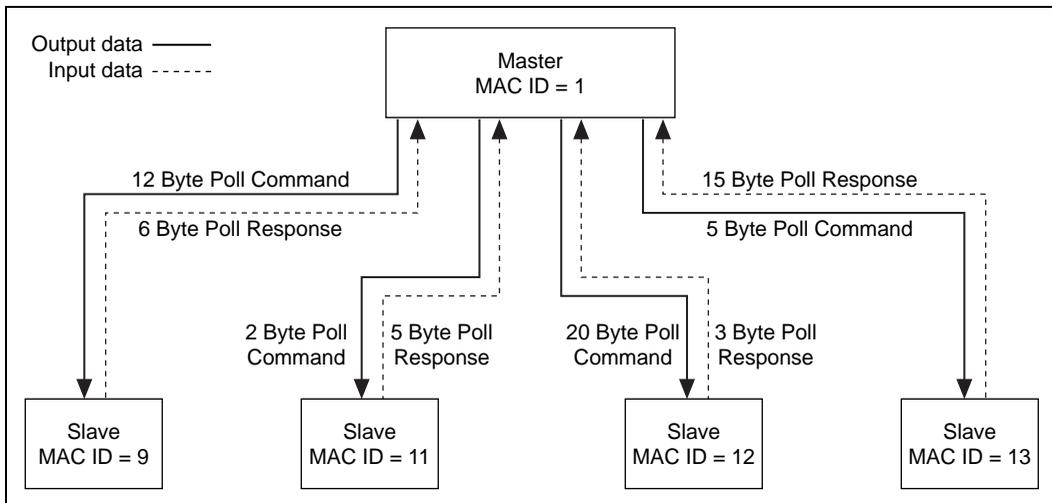


Figure 1-3. Polled I/O Example

## Bit Strobed I/O

The (bit) strobed I/O connection is designed to move small amounts of input data from the slave to its master. Strobed I/O is typically used for simple sensors, such as photoelectric sensors and limit switches.

Strobed I/O is also called bit strobed I/O since the master sends a 64-bit (8-byte) message containing a single bit of output data for each strobed slave. This strobe command (request) message is received by all slave devices simultaneously and can be used to trigger simultaneous measurements (such as to take multiple photoelectric readings simultaneously).

When a strobed slave receives the strobe command, it uses the output data bit that corresponds to its own MAC ID (for example, the slave with MAC ID 5 uses bit 5). Regardless of the value of its output bit, each strobed slave responds to the command message by sending an individual strobe message back to the master. The slave's strobe response contains from 0 to 8 bytes of input data.

Figure 1-4 shows an example of four strobed slave devices.

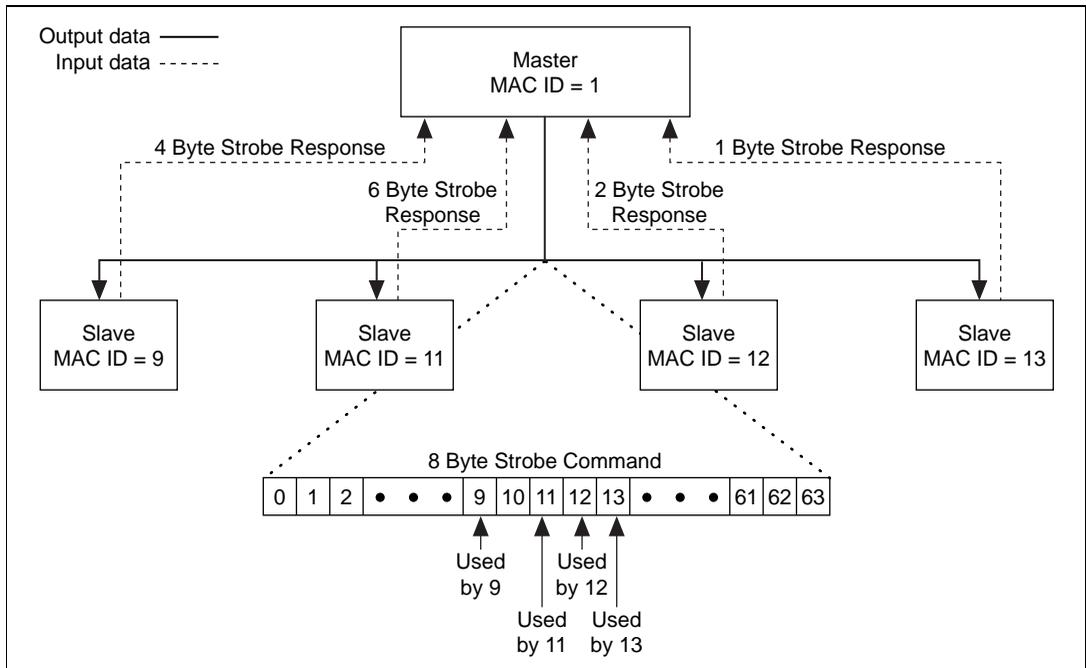


Figure 1-4. Strobed I/O Example

## Change-of-State and Cyclic I/O

The change-of-state (COS) and cyclic I/O connections both use the same underlying communication mechanisms. Both transmit data at a fixed interval called the *expected packet rate* (EPR). Since COS and cyclic I/O

connections use the same messaging on the DeviceNet network, they are often referred to as a single I/O connection called COS/cyclic I/O.

The cyclic I/O connection enables a slave device to send input data to its master at the configured EPR interval. You would normally configure the EPR to be consistent with the rate at which the device measures its physical input sensors. For example, if a temperature sensor can take a measurement at most once every 500 ms, you would configure the cyclic I/O connection's EPR as 500 ms. Cyclic I/O can be configured to send output data from master to slave, but this configuration is seldom used since it is essentially the same as polled I/O. Cyclic I/O messages can contain any amount of data.

The COS I/O connection enables a slave device to send input data to its master when a change is detected on its physical inputs. In addition to sending input data when a change is detected, the COS slave also sends its input data at a slower EPR interval that lets the master know it is still functioning. COS I/O is typically used for devices with physical inputs that can change frequently but can have the same input value for a long time. For example, if a pushbutton device supports COS I/O, you might configure its EPR as 3 seconds since the device will send a message immediately if a button is pressed. COS I/O can be configured to send output data from master to slave. Although master-to-slave COS output is seldom used, it can be useful for things like front-panel pushbuttons which are sent to a slave's discrete outputs (such as LEDs and simple motors). COS I/O messages can contain any amount of data.

When using COS/cyclic I/O connections, you can configure the device that receives data to send an acknowledgment so that the transmitting device can verify that the data was received successfully. For example, if you configure slave-to-master COS I/O (input length nonzero), the master sends an acknowledgment to the slave each time it receives an input message. Since the acknowledgment message is used for verification only, it does not contain data. If this verification can be handled using other means (such as using strobed I/O to verify device status), the acknowledgment message can be suppressed. For information on how to suppress COS/cyclic acknowledgments using NI-DNET, refer to the description of the I/O Object in Chapter 3, *NI-DNET Objects*, in the *NI-DNET Programmer Reference Manual*.

Since COS and cyclic I/O use the same messages on the DeviceNet network, they cannot be used simultaneously for a given slave device. Also, polled I/O uses the same messages on the DeviceNet network as master-to-slave output messages of COS/cyclic I/O. This means that a slave

device can use slave-to-master COS/cyclic I/O simultaneously with polled I/O, but not master-to-slave COS/cyclic I/O.

Figure 1-5 shows an example of four COS/cyclic I/O connections.


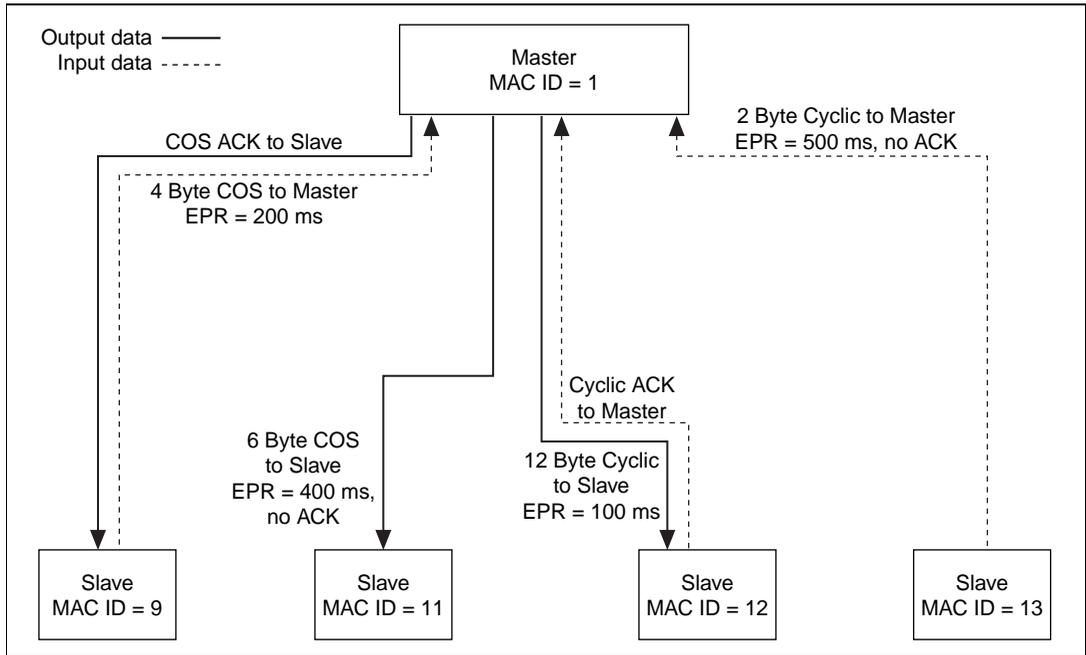


Figure 1-5. COS/Cyclic I/O Example

## Assembly Objects

One of the more important objects in the *DeviceNet Specification* is the *Assembly Object*. There are two types of Assembly Object: input assemblies and output assemblies. Assembly objects act like a switchboard, routing incoming and outgoing data to its proper location within the device. Output assemblies receive an output message from an I/O connection and distribute its contents to multiple attributes within the slave. Input assemblies gather multiple attributes within the slave for transmission on an I/O connection.


Figure 1-6 shows the operation of input and output assemblies.

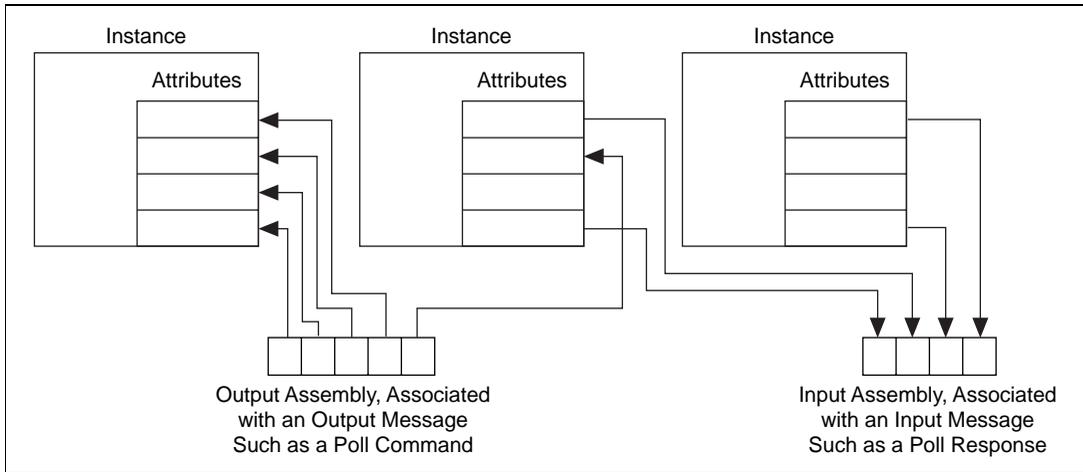

**Figure 1-6.** Input and Output Assemblies

As a more specific example, consider a DeviceNet photoelectric sensor (photoeye) or a limit switch. These devices contain a single instance of a class called the Presence Sensing object. This instance has attributes for the Output Signal (on/off) and Diagnostic Status (good/fault). These two attributes are often routed through a single input assembly consisting of a single byte.

Figure 1-7 shows an example of a Presence Sensing instance and its input assembly.

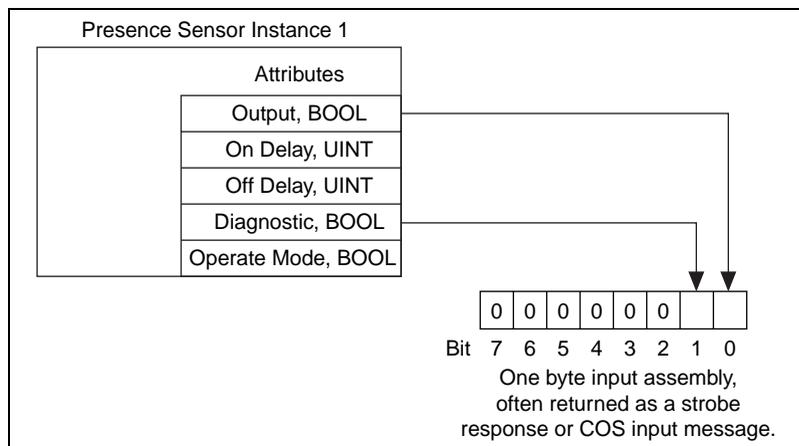

**Figure 1-7.** Input Assembly for Photoeye or Limit Switch

As you can see, in order to use the data bytes contained in I/O messages, it is important to know the format of a device's internal input and output assemblies. For more information on I/O assemblies, refer to *Using I/O Data in Your Application* in Chapter 3, *NI-DNET Programming Techniques*.

## Device Profiles

In order to provide interoperability for devices of the same type, the *DeviceNet Specification* defines various *device profiles*. The goal behind device profiles is that for a given type of device, such as a photoelectric sensor, it should be relatively straightforward to replace a sensor from one vendor with a sensor from another vendor.

All devices which conform to a given profile must:

- Exhibit the same behavior
- Use the same object model (certain instances are required)
- Contain the same input and output assemblies
- Contain the same set of configurable attributes

In addition to required features, most device profiles define a variety of optional features. When an optional feature is supported by a vendor, it must be supported as defined by the *DeviceNet Specification*. Device profiles also allow for vendor-specific features.

The *DeviceNet Specification* provides device profiles for such devices as Photoelectric Sensors, Limit Switches, Motor Starters, Position Controllers, and Mass-Flow Controllers.

## Open DeviceNet Vendors Association (ODVA)

This chapter provides only a short summary of DeviceNet. For additional information, such as a list of DeviceNet products and how to purchase the *DeviceNet Specification*, refer to the ODVA web site at [www.odva.org](http://www.odva.org).

# NI-DNET Software Overview

---

The DeviceNet software provided with National Instruments DeviceNet hardware is called NI-DNET. This section provides an overview of the NI-DNET software.

## NI-DNET Objects

The NI-DNET software, like the *DeviceNet Specification*, uses object-oriented concepts to represent components in the DeviceNet system. However, while in the *DeviceNet Specification* objects represent a multitude of components in DeviceNet devices, NI-DNET objects represent components of the Windows 95/98 or Windows NT device driver software. The NI-DNET device driver objects do not correspond directly to objects contained in remote devices. In order to facilitate access to the DeviceNet network, the NI-DNET objects provide a more concise representation of various objects defined in the *DeviceNet Specification*.

Much like any other object-oriented system, NI-DNET device driver objects use the concepts of class, instance, attribute, and service to describe their features. The NI-DNET device driver software provides three classes of objects: Interface Objects, Explicit Messaging Objects, and I/O Objects. You open an instance of a NI-DNET object using one of the three open functions (`ncOpenDnetExplMsg`, `ncOpenDnetIntf`, or `ncOpenDnetIO`). The services for an NI-DNET object are accomplished using the NI-DNET functions, which can be called directly from your programming environment (such as Microsoft C/C++ or LabVIEW). The essential attributes of an NI-DNET object are initialized using its open function, but other attributes can be accessed using `ncGetDriverAttr` or `ncSetDriverAttr`. The attributes of NI-DNET device driver objects are called *driver attributes*, in order to differentiate them from actual attributes in remote DeviceNet devices.

For complete information on each NI-DNET Object, including its driver attributes and supported functions (services), refer to your *NI-DNET Programmer Reference Manual*.

### Interface Object

The Interface Object represents a DeviceNet interface (physical DeviceNet port on your DeviceNet board). Since this interface acts as a device on the DeviceNet network much like any other device, it is configured with its own MAC ID and baud rate.

The Interface Object is used to:

- Configure NI-DNET settings that apply to the entire interface
- Start and stop communication for all NI-DNET objects associated with the interface

## Explicit Messaging Object

The Explicit Messaging Object represents an explicit messaging connection to a remote DeviceNet device (physical device attached to your interface by a DeviceNet cable). Since only one explicit messaging connection is created for a given device, the Explicit Messaging Object is also used for features that apply to the device as a whole.

The Explicit Messaging Object is used to:

- Execute the DeviceNet Get Attribute Single service on the remote device (`ncGetDnetAttribute`)
- Execute the DeviceNet Set Attribute Single service on the remote device (`ncSetDnetAttribute`)
- Send any other explicit message request to the remote device and receive the associated explicit message response (`ncWriteDnetExplMsg`, `ncReadDnetExplMsg`)
- Configure NI-DNET settings that apply to the entire remote device

## I/O Object

The I/O Object represents an I/O connection to a remote DeviceNet device (physical device attached to your interface by a DeviceNet cable). The I/O Object usually represents I/O communication as a master with a remote slave device, but it can also be used for I/O communication as a slave.

The I/O Object supports as many master/slave I/O connections as currently allowed by the *DeviceNet Specification* (version 2.0). This means that you can use polled, strobed, and COS/cyclic I/O connections simultaneously for a given device. As specified by the *DeviceNet Specification*, only one master/slave I/O connection of a given type can be used for each device (MAC ID). For example, you cannot open two polled I/O connections for the same device.

The I/O Object is used to:

- Read data from the most recent message received on the I/O connection (`ncReadDnetIO`)
- Write data for the next message produced on the I/O connection (`ncWriteDnetIO`)

## Example

Figure 1-8 shows an example of how NI-DNET objects can be used to communicate on a DeviceNet network. This example shows three DeviceNet devices. The first device (at MAC ID 1) is the National Instruments DeviceNet interface board. The second device (at MAC ID 5) uses NI-DNET to access a polled and a COS I/O connection simultaneously. The third device (at MAC ID 8) uses NI-DNET to access an explicit messaging connection and a strobed I/O connection.


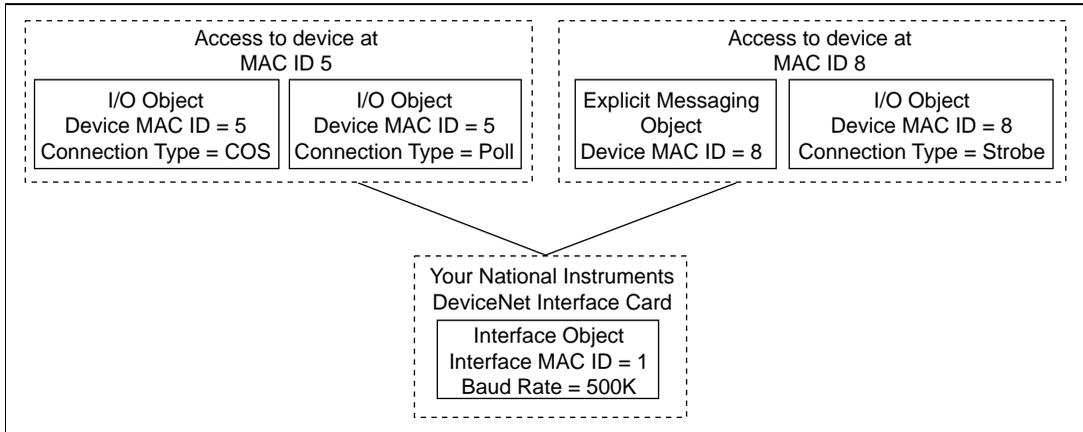


Figure 1-8. NI-DNET Objects for a Small Network of Three Devices

## NI-DNET Software Components

The following section highlights important components included with the NI-DNET software for Windows 95/98 and Windows NT.

The following diagram illustrates how your NI-DNET software works with your system and your DeviceNet hardware.

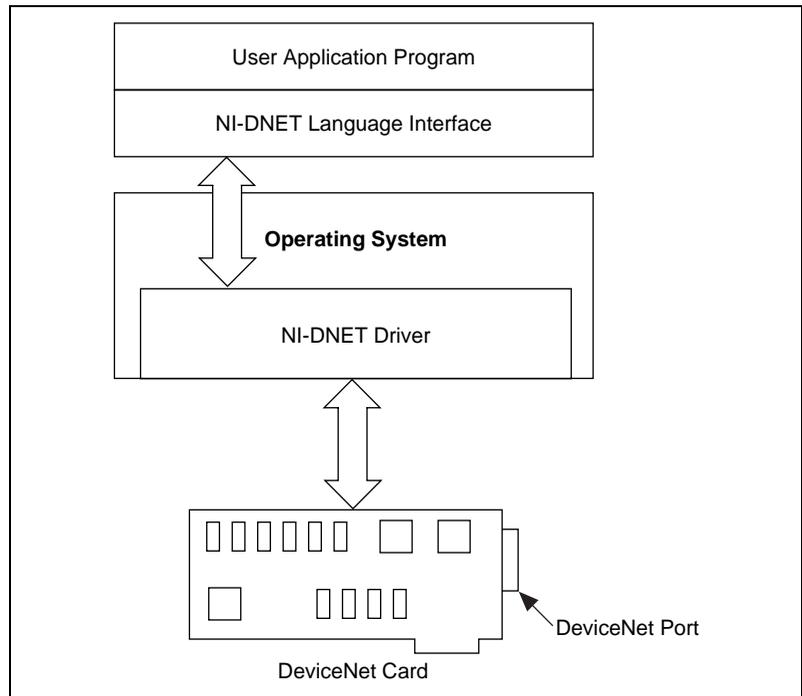

**Figure 1-9.** Structure of an NI-DNET System

## NI-DNET Driver and Utilities

- A documentation file, `readme.txt`, contains important information about the NI-DNET software and a description of any new features. Before you use the software, read this file for the most recent information about the NI-DNET software.
- A 32-bit, multitasking-aware device driver is used to interface with National Instruments DeviceNet hardware. Under Windows 95/98, this is a dynamically loadable, Plug and Play aware virtual device driver (VxD). Under Windows NT, this is a native Windows NT kernel driver.
- A Win32 dynamic link library acts as the interface between all Windows 95/98 and Windows NT DeviceNet applications and the NI-DNET device driver.

- The NI-DNET Hardware Configuration utility is used to configure the DeviceNet hardware and verify proper operation of the DeviceNet hardware and software.
- The `SimpleWho` utility is used to determine basic information about the devices on your DeviceNet network. This information assists with determining the parameters needed for I/O configuration (`ncOpenDnetIO`).

## Firmware Image Files

All National Instruments DeviceNet hardware products contain an on-board microprocessor. This microprocessor is used so that all time-critical aspects of the NI-DNET software can be executed separately from your Windows 95/98 or Windows NT application. The firmware image which runs on the on-board microprocessor, `nidnet.nfw`, is loaded and executed automatically when your NI-DNET application starts.

## Language Interface Files

- A documentation file, `readme.txt`, contains information about the NI-DNET language interface files.
- A 32-bit C language header file, `nidnet.h`, contains NI-DNET function prototypes, host data types, and various predefined constants.
- A 32-bit C language link library, `nidnetms.lib`, is used by Microsoft C/C++ applications to access NI-DNET functions.
- A 32-bit C language link library, `nidnetbo.lib`, is used by Borland C/C++ (5.0 or later) applications to access NI-DNET functions.
- NI-DNET language interface files for LabWindows/CVI, when installed into your LabWindows/CVI directory, provide for complete integration in that environment.
- NI-DNET language interface files for LabVIEW/BridgeVIEW, when installed into your LabVIEW/BridgeVIEW directory, provide for complete integration in that environment.

## Application Examples

The NI-DNET software includes two example applications. For a detailed description of the example application files, refer to Chapter 4, [Application Examples](#).

## WinDnet Support Files

The NI-DNET software includes support files for the Allen-Bradley WinDnet architecture. With this software, the National Instruments DeviceNet hardware can be used with various Allen-Bradley DeviceNet software tools, such as the DeviceNet Manager software. The DeviceNet Manager software provides features to assist in the installation and configuration of devices in a DeviceNet system.

---

# Developing Your Application

This chapter explains how to develop an application program using the NI-DNET functions.

## How to Access the NI-DNET Software from your Programming Environment

---

### Using LabVIEW or BridgeVIEW (G)

For an application written in LabVIEW (4.0 or later) or BridgeVIEW, NI-DNET provides a complete G language function library, front panel controls, and examples.

To add NI-DNET functions and controls to your LabVIEW palettes, select **Select Palette Set** from the LabVIEW **Edit** menu, then select **nidnet\_view**. You can place NI-DNET functions into your diagram from the LabVIEW **Functions** palette, and you can place NI-DNET controls into your front panel from the LabVIEW **Controls** palette.

For a complete description of how each NI-DNET function is used in LabVIEW, refer to the *NI-DNET Programmer Reference Manual*. For online help for a specific NI-DNET function or control, select **Show Help** from the LabVIEW **Help** menu, then point to the NI-DNET function or control. You can point to a function within the NI-DNET palette or after placement into your diagram.

### Using LabWindows/CVI

For an application written in LabWindows/CVI, NI-DNET provides complete LabWindows/CVI function panels as well as a LabWindows/CVI header file (`nidnet.h`) and link library (`nidnet.lib`).

After you create a new project and a new C source file for your NI-DNET application, add the following line to the beginning of your C source code:

```
#include "nidnet.h"
```

You can now call NI-DNET functions within your LabWindows/CVI source code. You can enter NI-DNET function calls into your code by typing them directly or by using the NI-DNET function panels. To open the NI-DNET function panels, select **NI-DNET** from the LabWindows/CVI **Library** menu. The NI-DNET function panels are used much like any other LabWindows/CVI function panel set. They include online help for each NI-DNET function and parameter.

When you compile your LabWindows/CVI application for NI-DNET, it is automatically linked with `nidnet.lib`, the link library for LabWindows/CVI. When NI-DNET is installed, the installation program checks to see which compatible C compiler you are using with LabWindows/CVI (Microsoft, Borland, Watcom, or Symantec) and copies an appropriate `nidnet.lib` for that compiler. If you re-install LabWindows/CVI in order to change your compatible compiler, you must also re-install your NI-DNET software.

For a complete description of how each NI-DNET function is used in LabWindows/CVI, refer to the *NI-DNET Programmer Reference Manual*. For online help for a specific NI-DNET function or control, refer to the NI-DNET function panels.

## Using Microsoft C/C++ or Borland C/C++

For an application written in Microsoft Visual C/C++ (2.0 or later) or Borland C/C++ (5.0 or later), NI-DNET provides a header file (`nidnet.h`) and link library (`nidnetms.lib` or `nidnetbo.lib`). For LabWindows/CVI, support for NI-DNET is built-in (see previous section). For other C/C++ programming environments, you must access NI-DNET functions using direct entry (see [Direct Entry Access](#), later in this chapter).

To use the Microsoft C/C++ or Borland C/C++ language interface files for your application:

1. Include the `nidnet.h` header file in your C source code.
  - For C applications (files with the `.c` extension), add the following line to the beginning of your source code:
 

```
#include "nidnet.h"
```
  - For C++ applications (files with the `.cpp` extension), add the following lines to the beginning of your source code:
 

```
#define _cplusplus
#include "nidnet.h"
```

The `_cplusplus` define allows `nidnet.h` to properly handle the transition from C++ to the C language NI-DNET functions.

2. You can now enter NI-DNET function calls into your source code by typing them directly.
3. Link your application to the NI-DNET link library.
  - For Microsoft C/C++, link your application with the NI-DNET link library for Microsoft C/C++ (2.0 or later), `nidnetms.lib`.
  - For Borland C/C++, link your application with the NI-DNET link library for Borland C/C++ (5.0 or later), `nidnetbo.lib`. For Borland C/C++ 4.5, you must use direct entry (see [Direct Entry Access](#), later in this chapter).

For a complete description of how each NI-DNET function is used in C/C++, refer to the *NI-DNET Programmer Reference Manual*.

## Direct Entry Access

You can directly access NI-DNET from any programming environment that allows you to request addresses of functions that a dynamic link library (DLL) exports. The functions used to access a DLL in this manner are provided by the Microsoft Win32 functions of Windows 95/98 and Windows NT. Using these Microsoft Win32 functions to access a DLL is often referred to as *direct entry*. To use direct entry with NI-DNET, complete the following steps:

1. Load the NI-DNET DLL, `nican.dll`.

The following C language code fragment illustrates how to call the Win32 `LoadLibrary` function and check for an error:

```
#include <windows.h>
#include "nidnet.h"

HINSTANCE NidnetLib = NULL;

NidnetLib=LoadLibrary("nican.dll");
if (NidnetLib == NULL) {
    return FALSE; /*Error*/
}
```

2. Get the addresses for the NI-DNET DLL functions you will use.

Your application must use the Win32 `GetProcAddress` function to get the addresses of the NI-DNET functions your application needs to use. For each NI-DNET function used by your application, you must define a direct entry prototype. For the prototypes for each function exported by `nican.dll`, refer to the *NI-DNET Programmer Reference Manual*. The following code fragment illustrates how to get

the addresses of the `ncOpenDnetIO`, `ncCloseObject`, and `ncReadDnetIO` functions:

```
static NCTYPE_STATUS (_NCFUNC_ *PncOpenDnetIO)
    (NCTYPE_STRING ObjName,
     NCTYPE_OBJH_P ObjHandlePtr);
static NCTYPE_STATUS (_NCFUNC_ *PncCloseObject)
    (NCTYPE_OBJH ObjHandle);
static NCTYPE_STATUS (_NCFUNC_ *PncReadDnetIO)
    (NCTYPE_OBJH ObjHandle, NCTYPE_UINT32 SizeofData,
     NCTYPE_ANY_P Data);

PncOpenDnetIO = (NCTYPE_STATUS (_NCFUNC_ *)
    (NCTYPE_STRING, NCTYPE_OBJH_P))
    GetProcAddress(NidnetLib,
    (LPCSTR)"ncOpenDnetIO");
PncCloseObject = (NCTYPE_STATUS (_NCFUNC_ *)
    (NCTYPE_OBJH))
    GetProcAddress(NidnetLib,
    (LPCSTR)"ncCloseObject");
PncRead = (NCTYPE_STATUS (_NCFUNC_ *)
    (NCTYPE_OBJH, NCTYPE_UINT32, NCTYPE_ANY_P))
    GetProcAddress(NidnetLib,
    (LPCSTR)"ncReadDnetIO");
```

If `GetProcAddress` fails, it returns a `NULL` pointer. The following code fragment illustrates how to verify that none of the calls to `GetProcAddress` failed:

```
if ((PncOpenDnetIO == NULL) ||
    (PncCloseObject == NULL) ||
    (PncReadDnetIO == NULL)) {
    FreeLibrary(NidnetLib);
    printf("GetProcAddress failed");
}
```

3. Configure your application to de-reference the pointer in order to call an NI-DNET function, as illustrated by the following code:

```
NCTYPE_STATUS status;
NCTYPE_OBJH MyObjh;

status = (*PncOpenDnetIO) ("DNET0", &MyObjh);
if (status < 0) {
    printf("ncOpenDnetIO failed");
}
```

4. `Free nican.dll`.

Before exiting your application, you need to free `nican.dll` with the following command:


```
FreeLibrary(NidnetLib);
```

For the most recent information on NI-DNET support for other programming environments, refer to the `readme.txt` file. For more information on direct entry, refer to the Microsoft Win32 Software Development Kit (SDK) online help.

## Programming Model for NI-DNET Applications

---

The following steps provide an overview of how to use the NI-DNET functions in your application. The steps are shown in Figure 2-1 in flowchart form. For examples of using NI-DNET for specific applications, refer to Chapter 4, *Application Examples*. The NI-DNET functions are described in detail in the *NI-DNET Programmer Reference Manual*, Chapter 2, *NI-DNET Functions*.

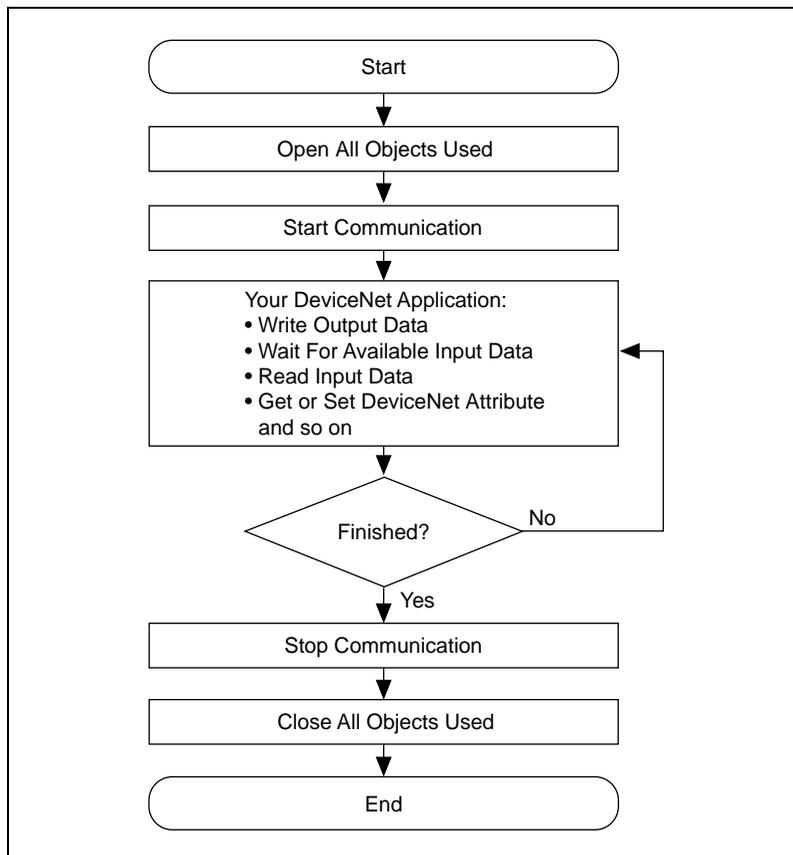

**Figure 2-1.** General Programming Steps for an NI-DNET Application

## Step 1. Open Objects

Prior to using an NI-DNET object in your application, you must configure and open it using either `ncOpenDnetIntf`, `ncOpenDnetExplMsg`, or `ncOpenDnetIO`. These open functions return a handle for use in all subsequent NI-DNET calls for that object.

The `ncOpenDnetIntf` function configures and opens an Interface Object. Your NI-DNET application uses this Interface Object to start and stop communication. The Interface Object must be the first NI-DNET object opened by your application.

The `ncOpenDnetExplMsg` function configures and opens an Explicit Messaging Object, and the `ncOpenDnetIO` function configures and opens an I/O Object.

## Step 2. Start Communication

Start communication to initialize DeviceNet connections to remote devices. Use the Interface Object to call the `ncOperateDnetIntf` function with the `Opcode` parameter set to `Start`.

The following optional steps can be done prior to starting communication:

- For an I/O Object, if it is not acceptable to send output data of all zeros, call `ncWriteDnetIO` to provide valid output values for the initial transmission.
- For an I/O Object, if your application is multitasking, call the `ncCreateNotification` or `ncCreateOccurrence` function with the `DesiredState` parameter set to `Read Available`. This provides a notification to your application when new input data is received from the remote device.

## Step 3. Run Your DeviceNet Application

After you open your NI-DNET objects and start communication, you are ready to interact with the DeviceNet network.

Use the following steps with an I/O Object:

1. Call the `ncWriteDnetIO` function to write output data for subsequent transmission on the DeviceNet network.
2. Call the `ncWaitForState` function with the `DesiredState` parameter set to `Read Available`. This function waits for output data to be transmitted and for new input data to be received. If your application is multitasking, you may have other tasks to do in your application while waiting for new input data. If so, use the `ncCreateNotification` or `ncCreateOccurrence` function instead of `ncWaitForState` (see [Step 2. Start Communication](#)).
3. Call the `ncReadDnetIO` function to read input data received from the DeviceNet network.
4. Loop back to Step 1 as needed.

Use the following steps with an Explicit Messaging Object:

1. Call the `ncWaitForState` function with the `DesiredState` parameter set to `Established`. This ensures that the explicit message connection is established before you send the first explicit message request.
2. To get an attribute from a remote DeviceNet device, call the `ncGetDnetAttribute` function.

3. To set the value of an attribute in a remote DeviceNet device, call the `ncSetDnetAttribute` function.
4. To invoke other explicit message services in a remote DeviceNet device, use the `ncWriteDnetExplMsg` function to write the service request, the `ncWaitForState` function to wait for the service response, and the `ncReadDnetExplMsg` function to read the service response.
5. Loop back to Step 2 as needed.

## Step 4. Stop Communication

Before you exit your application, stop communication in order to shut down DeviceNet connections to remote devices. Use the Interface Object to call the `ncOperateDnetIntf` function with the `Opcode` parameter set to `Stop`.

## Step 5. Close Objects

Before you exit your application, close all NI-DNET objects using the `ncCloseObject` function.

# Handling Status in G (LabVIEW/BridgeVIEW)

---

## Checking Status

For applications written in G (LabVIEW/BridgeVIEW), status checking is handled automatically. For all NI-DNET functions, the lower left and right terminals provide status information using LabVIEW Error Clusters. LabVIEW Error Clusters are designed so that status information flows from one function to the next, and function execution stops when an error occurs. For more information, refer to the Error Handling section in the LabVIEW online reference.

Within your LabVIEW block diagram, you wire the `Error in` and `Error out` terminals of NI-DNET functions together in succession. When an error is detected in an NI-DNET function (`status` field true), all NI-DNET functions wired together are skipped except for `ncCloseObject`. The `ncCloseObject` function executes regardless of whether an error occurred, thus ensuring that all NI-DNET objects are closed properly when execution stops due to an error. Depending on how you want to handle errors, you can wire the `Error in` and `Error out` terminals together per-object (group a single open/close pair), per-device

(group together Explicit Messaging and I/O Objects for a given device), or per-network (group all functions for a given interface).

The `DeviceNet Error Handler` function converts an NI-DNET Error Cluster into a descriptive string. By displaying this string when an error or warning is detected, you can avoid interpretation of individual fields of the Error Cluster in order to debug the problem quickly and effectively. The `Error` in terminal of this function is normally wired from the `Error out` terminal of an `ncCloseObject` function.

In order to display an NI-DNET Error Cluster description without interrupting execution of other code, the `Error out` and `Error String` output terminals of the `DeviceNet Error Handler` are normally wired to front panel indicators. If you wish to interrupt execution and display a dialog box describing the error, set `Show Error Dialog` to true instead of using front panel indicators.

The following figure shows the Error Cluster of the `ncCloseObject` function wired into the `DeviceNet Error Handler` function. Instead of showing the dialog box when an error occurs, this diagram displays the error description using a front panel indicator.

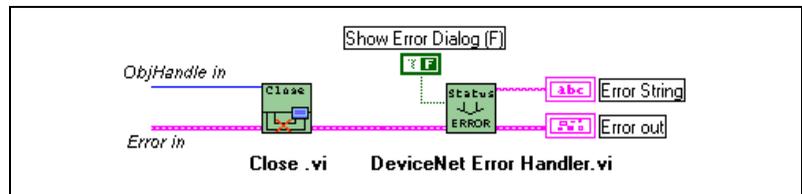


Figure 2-2. NI-DNET Error Cluster Example

## Status Format

When you use the `DeviceNet Error Handler` function in your diagram, a description of the error is displayed either in a dialog box or on your front panel (assuming you wire `Error String` to an indicator). When you display the error string generated by `DeviceNet Error Handler`, you do not need to interpret the individual fields of the NI-DNET Error Cluster.


In the NI-DNET implementation of Error Clusters, each field has the following meaning.

## Status

This boolean field is set to true when an error occurs and remains false when a warning or success occurs. An error occurs when a function does not perform the expected behavior. A warning occurs when the function performed as expected but a condition exists which may require your attention. Success indicates that the function performed normally.

## Code

The 32 bits of the `code` field have the following format (see Figure 2-3).

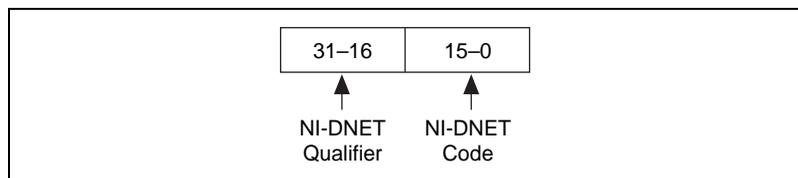

**Figure 2-3.** Error Cluster Code Field

The lower 16 bits indicate the primary status code used for warnings or errors. For example, if NI-DNET cannot initialize communication with a device, the code `NC_ERR_DEVICE_INIT` is returned. If no warning or error exists, the Error Cluster's `code` field has the value zero.

The upper 16 bits indicate a qualifier for the primary NI-DNET warning or error code. This NI-DNET qualifier is specific to individual values for the NI-DNET code and provides additional information useful for detailed debugging. For example, if the status code is `NC_ERR_DEVICE_INIT`, the qualifier indicates the exact cause of the initialization problem. If no qualifier exists, the NI-DNET qualifier field has the value zero.

## Source

When an error or warning occurs, the `source` field (a string) of the Error Cluster provides the complete VI hierarchy for the NI-DNET function in which the error or warning occurred. If no error or warning occurs in your application, `source` remains blank.

The first line in `source` displays the NI-DNET function in which the error or warning occurred. The next line displays the name of the VI that called

the NI-DNET function. Subsequent lines display the next highest VI in the call chain, up to the main VI for your application.

## Handling Status in C

---

### Checking Status

Each C language NI-DNET function returns a value that indicates the status of the function call. This status value is zero for success, greater than zero for a warning, and less than zero for an error.

After every call to an NI-DNET function, your program should check to see if the return status is nonzero. If so, call the `ncStatusToString` function to obtain an ASCII string which describes the error/warning. You can then display this ASCII string using standard C functions such as `printf`.

The following text shows C source code for handling the status returned from the `ncCloseObject` function. If an error or warning is detected, call `ncStatusToString` to obtain an error description.

```
NCTYPE_STATUS      status;
char                string[80];
. . .
status = ncCloseObject(objh);
if (status != NC_SUCCESS) {
    ncStatusToString(status, sizeof(string), string);
    printf("ncCloseObject: %s\n", string);
    . . .
}
. . .
```


When accessing the NI-DNET code and qualifier within your application, you should use the constants defined in `nidnet.h`. These constants use the same names as described in Appendix A, *Status Handling*, in the *NI-DNET Programmer Reference Manual*. For example, to check for a timeout after calling `ncWaitForState`, you would write C code like:

```
if (NC_STATCODE(status) == NC_ERR_TIMEOUT) {
    YourCodeToHandleTimeout();
}
```

## Status Format

When you use the `ncStatusToString` function in your C source code, you can always obtain a complete description of the error, and you do not need to interpret the individual fields of the NI-DNET status.

To provide the maximum amount of information, the status returned by NI-DNET functions is encoded as a signed 32-bit integer. The format of this integer is shown in Figure 2-4.

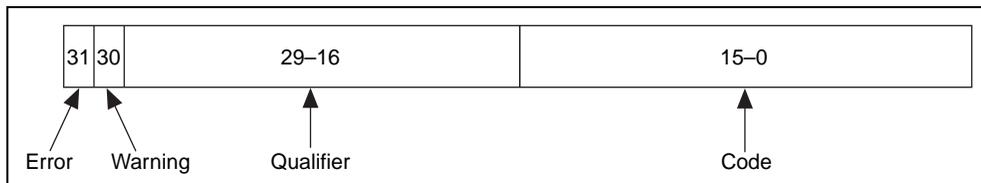

**Figure 2-4.** Status Format in C

### Error/Warning Indicators (Severity)

The error and warning bits ensure that all NI-DNET errors generate a negative status and all NI-DNET warnings generate a positive status. The error bit is set when a function does not perform the expected behavior, resulting in a negative status. The warning bit is set when the function performed as expected but a condition exists that may require your attention. If no error or warning occurs, the entire status is set to zero to indicate success. Table 2-1 summarizes the behavior of NI-DNET status.

**Table 2-1.** Determining Severity of Status

Status	Result
Negative	Error. Function did not perform expected behavior.
Zero	Success. Function completed successfully.
Positive	Warning. Function performed as expected, but a condition arose that may require your attention.

## Code

The code bits indicate the primary status code used for warning or errors. For example, if NI-DNET cannot initialize communication with a device, the code `NC_ERR_DEVICE_INIT` is returned. If no warning or error exists, this field has the value zero.

## Qualifier

The qualifier bits hold a qualifier for the warning or error code. It is specific to individual values for the code field and provides additional information useful for detailed debugging. For example, if the status code is `NC_ERR_DEVICE_INIT`, the qualifier indicates the exact cause of the initialization problem. If no qualifier exists, this field has the value zero.

---

# NI-DNET Programming Techniques

This chapter describes various techniques to help you program your NI-DNET application. The techniques include configuration of I/O connection timing, using I/O data (assemblies), using explicit messaging, and handling multiple devices. This chapter also includes information on the `SimpleWho` utility and DeviceNet network management tools.

## Configuring I/O Connections

---

This section provides information on how I/O connections relate to one another and how your configuration of I/O connection timing can affect the overall performance of your DeviceNet system. The various types of I/O connections provided by DeviceNet are described in Chapter 1, *Introduction*.

In a master/slave DeviceNet I/O system, the master determines the timing of all I/O communication. Within your NI-DNET application, the `ncOpenDnetIO` function is used to configure the timing for I/O connections in which your application communicates as master. As you read this section, you may want to refer to the description of the `ncOpenDnetIO` function in Chapter 2, *NI-DNET Functions*, of the *NI-DNET Programmer Reference Manual*.

### Expected Packet Rate

Each DeviceNet I/O connection contains an attribute called the expected packet rate, which specifies the expected rate (in milliseconds) of messages (*packets*) for the I/O connection. For NI-DNET, the expected packet rate is configured using the `ExpPacketRate` parameter of the `ncOpenDnetIO` function.

Once you start communication, the embedded microprocessor on your National Instruments DeviceNet interface is used to transmit messages at the `ExpPacketRate`. This means that once the I/O connection is

configured, your NI-DNET application does not need to be concerned with the timing of messages on the DeviceNet network.

When selecting an `ExpPacketRate` for an I/O connection, you must consider all I/O connections in your system. For example, although you may be able to configure an `ExpPacketRate` of 3 ms for a single I/O connection, you cannot configure a 3 ms `ExpPacketRate` for 40 I/O connections because DeviceNet’s bandwidth capabilities cannot support 40 messages in a 3 ms time frame.

The following sections describe how to evaluate system considerations so that you can configure valid values for `ExpPacketRate`.

### Strobed I/O

For strobed I/O connections, the master broadcasts a single strobe command message to all strobed slaves. Since all strobed I/O connections transfer data at the rate of this single strobe command message, the `ExpPacketRate` of each strobed I/O connection must be set to the same value.

The common `ExpPacketRate` for all strobed I/O connections should provide enough time for the strobe command and each strobed slave’s response. You must also allow time for other I/O messages and explicit messages to occur in the `ExpPacketRate` time frame. If you do not know the time needed, you can let NI-DNET calculate a safe value for you (see [Automatic EPR Feature](#), later in this chapter).

Figure 3-1 shows a timing example for four strobed devices at MAC ID 9, 11, 12, and 13. Notice that since MAC ID 11 is slow to respond, the `ExpPacketRate` is set to 20 ms to provide additional safety margin for other messages.

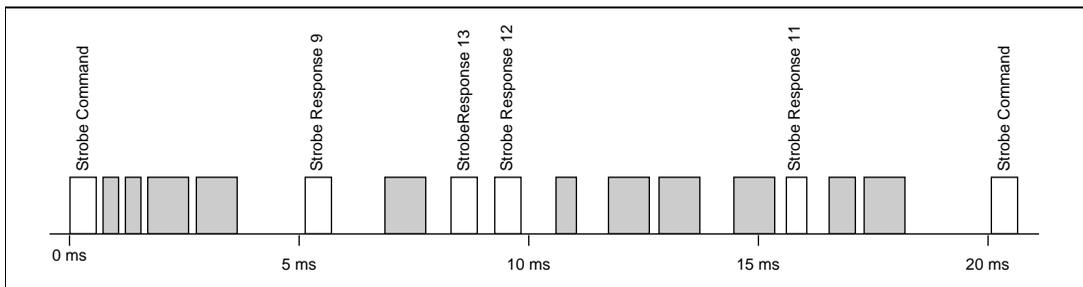


Figure 3-1. Strobed I/O Timing Example

## Polled I/O

Polled I/O connections use a separate poll command and response message for each device.

The overall scheme that NI-DNET uses to time polled I/O connections is determined by the `PollMode` parameter of `ncOpenDnetIntf`. This `PollMode` parameter applies to all polled I/O connections (all calls to `ncOpenDnetIO` with `ConnectionType` of `Poll`).

The following sections describe different schemes you can use for polled I/O.

### Scanned Polling

You can set the `ExpPacketRate` of each polled I/O connection to the same value used for all strobed I/O. Using a common `ExpPacketRate` for all strobed and polled I/O is referred to as scanned I/O. Scanned I/O is also referred to as *scanned polling* with respect to polled I/O connections. When you use scanned I/O, NI-DNET transmits all strobe and poll command messages onto the network in quick succession.

Scanned I/O is a simple, efficient way to handle I/O connections requiring similar response rates. With scanned I/O, the master knows that all strobe and poll commands go out at the same time. Therefore, the master does not need to manage individual timers, thus optimizing processing overhead. Scanned I/O also provides overall consistency. If a given DeviceNet system uses only scanned I/O, then you know that all higher level control algorithms can execute at the single common strobe/poll `ExpPacketRate`.


The common `ExpPacketRate` for all strobed and polled I/O connections should provide enough time for all strobe/poll commands and each slave's response. You must also allow time for other I/O messages and explicit messages to occur in the `ExpPacketRate` time frame.

NI-DNET provides two different methods for configuring scanned I/O:

- If you set the `PollMode` parameter of `ncOpenDnetIntf` to `Automatic`, NI-DNET automatically calculates a valid common `ExpPacketRate` value for each strobed and polled I/O connection. Using this scheme, you do not need to specify a valid `ExpPacketRate` when opening your strobed/poll I/O connections. For more information, refer to the [Automatic EPR Feature](#) section, later in this chapter.
- If you set the `PollMode` parameter of `ncOpenDnetIntf` to `Scanned`, then in order to configure scanned I/O, you must specify the exact

same `ExpPacketRate` when opening each of your strobed/pollled I/O connections. Using this scheme, you must determine a valid `ExpPacketRate` for your DeviceNet system.

Figure 3-2 shows a scanned polling example for four polled devices at MAC ID 14, 17, 20, and 30. The shaded areas indicate other message traffic, such as the strobed I/O messages shown in Figure 3-1.

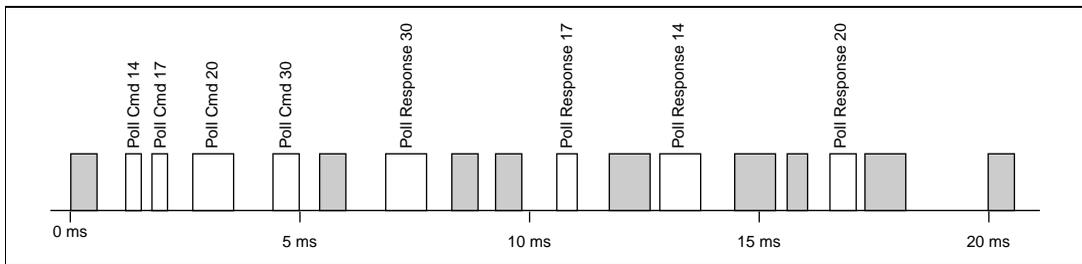

**Figure 3-2.** Scanned Polling Timing Example

## Background Polling


Scanned polling may be less efficient when used with devices with significantly different response times or devices with significantly different rates of physical measurement. In the example above (Figure 3-2), consider what would happen if device 14 took 52 ms to respond and device 20 took 38 ms to respond. In this case, even though device 17 and device 30 respond well within 20 ms, the common `ExpPacketRate` would need to be at least 52 ms. This situation can often be avoided using a special case of scanned polling called *background polling*.

In order to configure background polling, you first set the `PollMode` parameter of `ncOpenDnetIntf` to `Scanned`. Then for each polled I/O connection you configure (`ncOpenDnetIO` with `ConnectionType` set to `Poll`), you must set `ExpPacketRate` to either a foreground rate or a background rate. The foreground poll rate is the same as the common `ExpPacketRate` used for all strobed I/O. Devices in this group generally respond quickly to poll commands or have data that changes relatively quickly. The background poll rate must be an exact multiple of the foreground poll rate. Devices in this group generally respond slowly to poll commands or have data that changes relatively slowly (such as temperature).

Background polling provides many of the same advantages as scanned polling. The handling of only two groups optimizes performance. Also, background polling maintains overall network consistency because

NI-DNET evenly disperses all background poll commands among multiple foreground cycles. In other words, all background poll commands are not sent in quick succession and thus do not generate quick bursts of traffic on the network.

Figure 3-3 shows a background polling example which resolves the problem discussed previously. Devices at MAC ID 17 and 30 are foreground polled every 20 ms (as before). Devices at MAC ID 14 and 20 are background polled every 60 ms (3 times the 20 ms foreground rate). The shaded areas indicate other message traffic.

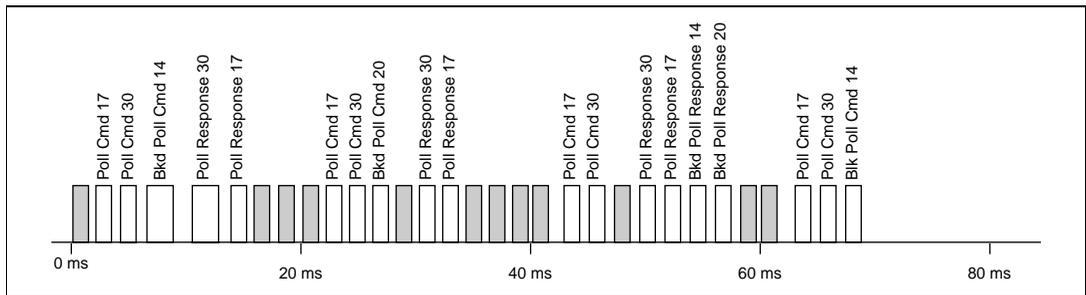

**Figure 3-3.** Background Polling Timing Example


## Individual Polling

When the underlying response rates of all polled I/O devices do not fit into two clear groups, background polling may still be inefficient. For example, assume you have four different polled I/O sensors capable of updating measured input at 10 ms, 35 ms, 100 ms, and 700 ms respectively. Each device responds to its poll command within 1 ms but measures data at a different rate (such as a pushbutton for 10 ms and a temperature sensor for 700 ms). You could group these into a foreground rate of 10 ms and a background rate of 700 ms, but then much DeviceNet bandwidth would be wasted polling the 35 ms and 100 ms devices at the foreground rate. For this situation, the *individual polling* scheme is most appropriate.

In order to configure individual polling, you first set the `PollMode` parameter of `ncOpenDnetIntf` to `Individual`. Then for each polled I/O connection you configure (`ncOpenDnetIO` with `ConnectionType` set to `Poll`), you must set `ExpPacketRate` to the rate desired for that device. Unlike the scanned polling or background polling scheme, each poll command is no longer associated with the strobe command's rate, but instead is solely based on its `ExpPacketRate`.

Since the poll commands are not synchronized for individual polling, they can often be scattered relatively randomly. They can be evenly interspersed for a while, then suddenly occur in bursts of back-to-back messages. Because of this inconsistency, you should use smaller MAC IDs for smaller `ExpPacketRate` values. Since smaller MAC IDs in DeviceNet usually gain access to the network before larger MAC IDs, this helps to ensure that smaller rates can be maintained during bursts of increased traffic.

Figure 3-4 shows an individual polling example: MAC ID 3 is polled every 10 ms, MAC ID 10 every 35 ms, MAC ID 12 every 100 ms, and MAC ID 13 every 700 ms. Only the poll commands are shown (not poll responses or other messages).

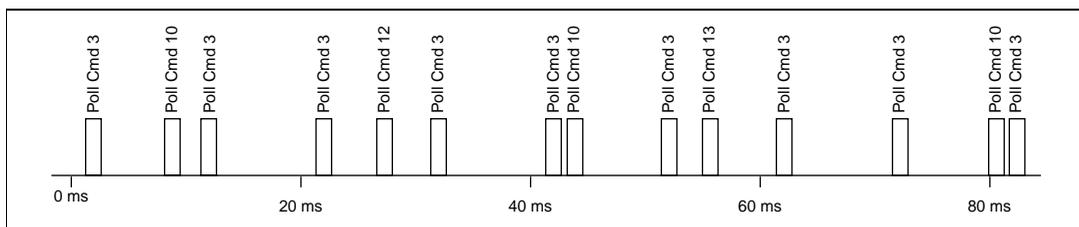

**Figure 3-4.** Individual Polling Timing Example

## Cyclic I/O

Cyclic I/O connections essentially use the same timing scheme as individually polled I/O connections. Each cyclic I/O connection sends its data at the configured `ExpPacketRate`. The main difference is that cyclic I/O data is transferred from slave to master, rather than from master to slave.

In the *DeviceNet Specification*, a poll command message is exactly the same as a cyclic output message (master to slave data). Since cyclic data from master to slave can be handled using individual polling, cyclic I/O connections are more commonly used for input data from slave to master. For NI-DNET, this means that for cyclic I/O connections, `ncOpenDnetIO` is normally called with `InputLength` nonzero and `OutputLength` zero.


Just as for individually polled I/O, you should use smaller MAC IDs for smaller cyclic I/O `ExpPacketRate` values. Doing so will ensure that cyclic I/O traffic is prioritized properly.

## Change-of-State (COS) I/O

Change-of-State I/O connections use the same timing scheme as cyclic I/O connections, but in addition to the `ExpPacketRate`, COS I/O sends data to the master whenever a change is detected.

For COS I/O, the cyclic transmission is used solely to verify that the I/O connection still exists, so the `ExpPacketRate` is typically set to a large value, such as 10,000 (10 seconds). Given such a large `ExpPacketRate`, the main performance concerns for COS I/O are an appropriate MAC ID, and if needed, a nonzero `InhibitTimer`.

In many cases, a given COS I/O device cannot detect data changes very quickly. If a COS device is capable of detecting quickly changing data, there is a chance that it could transmit many COS messages back-to-back, precluding other I/O messages and thus dramatically impairing overall DeviceNet performance. This problem is demonstrated in Figure 3-5.

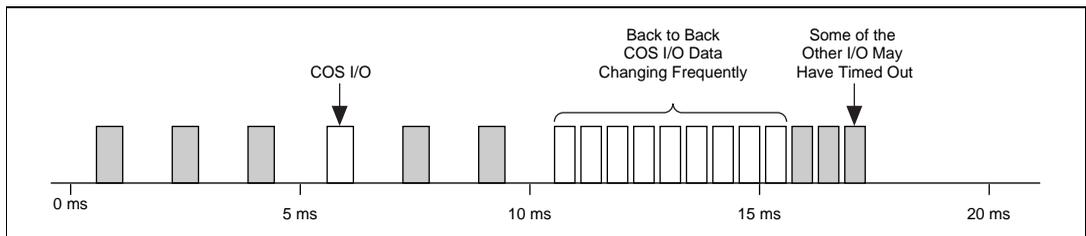

**Figure 3-5.** Congestion Due to Back-to-Back COS I/O

This problem can be prevented by increasing the MAC ID of the frequently changing COS I/O device. If the COS device has a higher MAC ID than other devices, it cannot preclude their I/O messages.

You can also prevent back-to-back COS I/O messages by setting the `InhibitTimer` driver attribute using `ncSetDriverAttr`. After transmitting COS data, the I/O connection must wait `InhibitTimer` before it can transmit COS data again. A reasonable value for `InhibitTimer` would be the smallest `ExpPacketRate` of an I/O connection with a larger MAC ID than the COS I/O device.

## Automatic EPR Feature

For cyclic I/O connections, a valid `ExpPacketRate` (EPR) is required for your call to `ncOpenDnetIO`. For COS I/O connections, a nonzero `ExpPacketRate` is recommended for your call to `ncOpenDnetIO` but can be set to a large value.

For strobed and polled I/O connections, determination of a valid `ExpPacketRate` can be somewhat complex. If you have trouble estimating an `ExpPacketRate` value for strobed/polled I/O, set the `PollMode` parameter of your initial call to `ncOpenDnetIntf` to `Automatic`. When you use this automatic EPR feature, the `ExpPacketRate` parameter of `ncOpenDnetIO` is ignored for strobed/polled I/O (`ConnectionType` of `Strobe` or `Poll`), and NI-DNET calculates a safe EPR value for you. This automatic EPR will be the same for all strobed and polled I/O connections (scanned I/O).

Once you start communication, you can use the `ncGetDriverAttr` function to determine the value calculated for `ExpPacketRate`. From that value, you can then experiment with other `ExpPacketRate` configurations using `PollMode` of `Scanned` or `Individual`.

The following information is used by NI-DNET to calculate a safe EPR:

- NI-DNET assumes that it is the only master in your DeviceNet system.
- The `BaudRate` parameter of `ncOpenDnetIntf` determines the time taken for each message.
- The `InputLength` and `OutputLength` parameters of each `ncOpenDnetIO` determine the time needed for each I/O message.
- NI-DNET assumes that each strobed/polled I/O device can respond to its command within 2 ms.
- NI-DNET sets aside a fixed amount of time for explicit messages. This time depends on the baud rate.

## Using I/O Data in Your Application

---

As was mentioned in Chapter 1, *Introduction*, the data transferred to and from a DeviceNet device on an I/O connection is usually processed by an Assembly Object within the slave device. Input assemblies represent the data received by NI-DNET from a remote device, and output assemblies represent data that NI-DNET transmits to a remote device.

To use a device's I/O data within your application, you need to understand the contents of its input and output assemblies. You can find this information in the following places:

- Printed documentation provided by the device's vendor.
- If the device conforms to a standard device profile, the I/O assemblies are defined within the *DeviceNet Specification*.

- Some device vendors provide comments about I/O assemblies in an Electronic Data Sheet (EDS). The EDS file is a text file whose format is defined by the *DeviceNet Specification*.
- Ask the device's vendor if they have filled out a DeviceNet compliance statement. This form is located at the front of the *DeviceNet Specification*, and it provides information about the device, including its I/O assemblies.

Once you open an NI-DNET I/O Object and start communication, you use the `ncWriteDnetIO` function to write an output assembly for a device and the `ncReadDnetIO` function to read an input assembly received from a remote device. Both of these functions access the entire assembly as an array of bytes.

In most cases, the array of bytes for an input or output assembly contains more than one value. In DeviceNet terminology, an individual data value within an I/O assembly is referred to as a *member*.

Documentation for the members of an input or output assembly includes the position of each member in the assembly (often shown as a table with byte/bit offsets) and a listing of the attribute in the device that each member represents (often shown as class, instance, and attribute identifiers). For standard device profiles, the I/O assemblies are documented in the device profile's specification, and the actual attributes are documented in the individual object specifications. Attribute documentation includes the attribute's DeviceNet data type and a complete explanation of its meaning.

As an example of I/O assembly documentation, consider the standard AC Drive device profile. For this device profile, the *DeviceNet Specification* defines an output assembly called Basic Speed Control Output (Assembly Object instance 20). This output assembly is used to start/stop forward motion at a given speed and to reset faults in the device. The bytes of this output assembly are shown in Figure 3-6, and the attribute mapping is shown in Table 3-1.

Byte	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
0	0	0	0	0	0	Fault Reset	0	Run Fwd
1	0	0	0	0	0	0	0	0
2	Speed Reference (Low Byte)							
3	Speed Reference (High Byte)							

**Figure 3-6.** AC Drive Output Assembly, Instance 20

**Table 3-1.** Attribute Mapping for Basic Speed Control Output Assembly

Member Name	Class Name	Class ID	Instance ID	Attribute Name	Attribute ID
Run Fwd	Control Supervisor	29 hex	1	Run1	3
Fault Reset	Control Supervisor	29 hex	1	FaultRst	12
Speed Reference	AC/DC Drive	2A hex	1	SpeedRef	8

By consulting the specifications for the Control Supervisor object and the AC/DC Drive object, you can determine that the DeviceNet data type for Run Fwd and Fault Reset is BOOL (boolean), and the DeviceNet data type for Speed Reference is INT (16-bit signed integer).

## Accessing I/O Members in LabVIEW

Many fundamental differences exist between the encoding of a DeviceNet data type and its equivalent data type in LabVIEW. For example, for a 32-bit integer, the DeviceNet `DINT` data type uses Intel byte ordering (lowest byte first), and the equivalent LabVIEW `I32` data type uses Motorola byte ordering (highest byte first).

To make it easier for you to avoid these data type issues in your LabVIEW application, NI-DNET provides two functions to convert between LabVIEW data types and DeviceNet data types: `ncConvertForDnetWrite` and `ncConvertFromDnetRead`. These functions are used to access individual members of an I/O assembly using normal LabVIEW controls and indicators.

The following steps show an example of how you can use `ncConvertForDnetWrite` to access the Basic Speed Control Output Assembly described above:

1. Using the NI-DNET palette, place `ncConvertForDnetWrite` into your diagram.
2. Right click on the `DnetData` in terminal and select **Create Constant**, then initialize the first 4 bytes of the array to zero.
3. Right click on the `DnetType` terminal and select **Create Constant**, then select `BOOL` from the enumeration.

4. Right click on the `ByteOffset` terminal and select **Create Constant**, then enter 0 as the byte offset.
5. Right click on the `8[TF]` in terminal and select **Create Control**. In the resulting front panel control, you can use the button at index 0 to control Run Fwd and the button at index 2 to control Fault Reset.
6. Using the NI-DNET palette, place `ncConvertForDnetWrite` into your diagram.
7. Wire the `DnetData out` terminal from the previous `Convert` into the `DnetData in` terminal of this `Convert`.
8. Right click on the `DnetType` terminal and select **Create Constant**, then select `INT` from the enumeration.
9. Right click on the `ByteOffset` terminal and select **Create Constant**, then enter 2 as the byte offset.
10. Right click on the `I32/I16/I8` in terminal and select **Create Control**. You can use the resulting front panel control to change Speed Reference.
11. Using the NI-DNET palette, place `ncWriteDnetIO` into your diagram.
12. Wire the `DnetData out` terminal from the previous `Convert` into the `Data` terminal of `ncWriteDnetIO`.

For more information on the `ncConvertForDnetWrite` and `ncConvertFromDnetRead` functions, refer to Chapter 2, *NI-DNET Functions*, in the *NI-DNET Programmer Reference Manual*. For information on LabVIEW data types and their equivalent DeviceNet data types, refer to Chapter 1, *NI-DNET Data Types*, in the *NI-DNET Programmer Reference Manual*.

## Accessing I/O Members in C

Since DeviceNet data types are very similar to C language data types, individual I/O members can be accessed in a straightforward manner. By using standard C language pointer manipulations, you can easily convert between C language data types and DeviceNet data types.

The following steps show an example of how standard C language can be used to access the Basic Speed Control Output Assembly described above:

1. Declare an array of 4 bytes, such as:
 

```
NCTYPE_UINT8    OutputAsm[4];
```

- Initialize the array to all zero:

```
for (I = 0; I < 4; I++)
    OutputAsm [I] = 0;
```

- Assume you have two boolean variables, `RunFwd` and `ResetFault`, of type `NCTYPE_BOOL`. For LabWindows/CVI, these variables could be accessed from front panel buttons. The following code inserts these boolean variables into `OutputAsm`:

```
if (RunFwd)
    OutputAsm [0] |= 0x01;
if (FaultReset)
    OutputAsm [0] |= 0x04;
```

- Assume you have an integer variable `SpeedRef` of type `NCTYPE_INT16`. For LabWindows/CVI, this variable could be accessed from a front panel control. The following code inserts this integer variable into `OutputAsm`:

```
*(NCTYPE_INT16 *)&( OutputAsm[2]) = SpeedRef;
```

- Write the output assembly to the remote device:

```
status = ncWriteDnetIO(objh, sizeof(OutputAsm),
    OutputAsm);
```

For information on NI-DNET's C language data types and their equivalent DeviceNet data types, refer to Chapter 1, *NI-DNET Data Types*, of the *NI-DNET Programmer Reference Manual*.

## Using Explicit Messaging Services

---

The NI-DNET Explicit Messaging Object represents an explicit messaging connection to a remote DeviceNet device (physical device attached to your interface by a DeviceNet cable). You use the `ncOpenDnetExp1Msg` function to configure and open an NI-DNET Explicit Messaging Object.

The following sections describe how to use the Explicit Messaging Object.

### Get and Set Attributes in a Remote DeviceNet Device

The two most commonly used DeviceNet explicit messages are the *Get Attribute Single* service and the *Set Attribute Single* service. These services are used to get or set the value of an attribute contained in a remote device. The easiest way to execute the Get Attribute Single service on a remote device is to use the NI-DNET `ncGetDnetAttribute` function. The

easiest way to execute the Set Attribute Single service on a remote device is to use the NI-DNET `ncSetDnetAttribute` function.

For a given attribute of a DeviceNet device, you need the following information to use the `ncGetDnetAttribute` or `ncSetDnetAttribute` function:

- The class and instance identifiers for the object in which the attribute is located
- The attribute identifier
- The attribute's DeviceNet data type

You can normally find this information from the object specifications contained in the *DeviceNet Specification*, but many DeviceNet device vendors also provide this information in the device's documentation.

For the C programming language, the attribute's DeviceNet data type determines the corresponding NI-DNET data type you use to declare a variable for the attribute's value. For example, if the attribute's DeviceNet data type is `INT` (16-bit signed integer), you should declare a C language variable of type `NCTYPE_INT16`, then pass the address of that variable as the `Attr` parameter of the `ncGetDnetAttribute` or `ncSetDnetAttribute` function.

For LabVIEW, the attribute's DeviceNet data type determines the corresponding LabVIEW data type to use with the `ncConvertForDnetWrite` or `ncConvertFromDnetRead` functions. The `ncConvertFromDnetRead` function is used to convert a DeviceNet attribute read using `ncGetDnetAttribute` into an appropriate LabVIEW data type. The `ncConvertForDnetWrite` function is used to convert a LabVIEW data type into an appropriate DeviceNet attribute to write using `ncSetDnetAttribute`. For more information on these LabVIEW conversion functions, refer to the previous section, [Using I/O Data in Your Application](#).

## Other Explicit Messaging Services

To execute services other than Get Attribute Single and Set Attribute Single, use the following sequence of function calls: `ncWriteDnetExpMsg`, `ncWaitForState`, `ncReadDnetExpMsg`. The `ncWriteDnetExpMsg` function sends an explicit message request to a remote DeviceNet device. The `ncWaitForState` function waits for the explicit message response, and the `ncReadDnetExpMsg` function reads that response.

Use `ncWriteDnetExplMsg` for such DeviceNet services as Reset, Save, Restore, Get Attributes All, and Set Attributes All. Although the *DeviceNet Specification* defines the overall format of these services, in most cases their meaning and service data are object-specific or vendor-specific. Unless your device requires such services and documents them in detail, you probably do not need them for your application.

You need the following information to use the `ncWriteDnetExplMsg` and `ncReadDnetExplMsg` functions for a given explicit messaging service:

- The class and instance identifiers for the object to which the service will be directed.
- The service code used to identify the service.
- The length and format of service request and response data. Some of data formats are defined by the service's overall specification (such as in Appendix G, *DeviceNet Explicit Services*, in the *DeviceNet Specification*), but many data formats are object-specific or vendor-specific. For example, for the Reset service, Appendix G defines the service's code for use with any object, but its actual data format is defined in the specification for the Identity Object.
- The error codes that can be returned in the service response. Error codes that are common to all services can be found in Appendix H, *DeviceNet Error Codes*, in the *DeviceNet Specification*, but many error codes are specific to the service, object, or vendor.

As with the `ncGetDnetAttribute` and `ncSetDnetAttribute` functions, the service data formats for the request and response are specified in terms of DeviceNet data types. These DeviceNet data types are converted to/from the data types of your programming environment (C or LabVIEW) as discussed in previous sections.

## Handling Multiple Devices

---

This section describes techniques you can use to efficiently implement an application that communicates with a large number of DeviceNet devices. In such an application, there may be only one call to `ncOpenDnetIntf` (only one network), but there are usually multiple calls to `ncOpenDnetIO` (and possibly `ncOpenDnetExplMsg`).

## Configuration

If the configuration parameters used with `ncOpenDnetIO` tend to change over time, you may want to organize them in data structures instead of using constants.

For the C programming language, you can declare a structure typedef to store the parameters of `ncOpenDnetIO`, such as:

```
typedef struct {
    NCTYPE_UINT32      DeviceMacId;
    NCTYPE_CONN_TYPE  ConnectionType;
    NCTYPE_UINT32      InputLength;
    NCTYPE_UINT32      OutputLength;
    NCTYPE_UINT32      ExpPacketRate;
} OpenDnetIO_Struct;
```

For LabVIEW or BridgeVIEW, a cluster containing these parameters is already defined for use with `ncOpenDnetIO`.

Using this structure/cluster, you can declare an array that contains one entry for each call you make to `ncOpenDnetIO`. In LabVIEW, BridgeVIEW, and LabWindows/CVI, you can use front panel controls to index through this array and update configurations as needed.

In your code, write a For loop to index through the array and call `ncOpenDnetIO` once for each array entry. This simplifies your code because it does not contain a long list of sequential open calls, but instead all open calls are combined into a concise loop.

## Object Handles

If you use an array to store configuration parameters for `ncOpenDnetIO`, you can use this same scheme to store the `ObjHandle` returned by `ncOpenDnetIO`. Within the For loop used for `ncOpenDnetIO`, you can store the resulting `ObjHandle` into an array of object handles. Throughout your code, you can index into this array to obtain the appropriate object handle.

Using an array of object handles is particularly useful in the LabVIEW programming environment because it eliminates confusing routing of individual object handle wires.

For applications with just a few object handles, another useful technique for LabVIEW is to store each object handle in an indicator, then create a local

variable for each call that uses the handle. To create the indicator, right-click on the `ObjHandle` out terminal and select **Create Indicator**. To create a local variable, right-click on the indicator, select **Create»Local Variable**, right-click on the local variable, and select **Change To Read Local**. For more information on local variables, refer to the LabVIEW online reference.

## Main Loop

If your application essentially accesses all DeviceNet input/output data as a single image, you would normally wait for read data to become available on one of the input connections (such as a strobed I/O connection), read all input data, execute your application code, then write all output data. The wait is important because it helps to synchronize your application with the overall DeviceNet network traffic.

In single-loop applications such as this, you normally set the `PollMode` parameter of `ncOpenDnetIntf` to `Automatic` or `Scanned` so that all poll command messages are sent out in quick succession.

Within a single-loop application, error handling is often done for the entire application as a whole. In the C programming language, this means that when an error is detected with any NI-DNET object, you display the error and exit the application. In LabVIEW, this means that you wire all error clusters of NI-DNET VIs together.

If your application uses different control code for different DeviceNet devices, you may want to split your application into multiple tasks. You can easily write a multitasking application by creating a notification for the NI-DNET `Read Avail` and `Error` states. This notification occurs when either input data is available (to synchronize your code with each device's I/O messages), or an error occurs. In the C programming language, you create this notification callback using the `ncCreateNotification` function. In LabVIEW, you create this notification callback using the `ncCreateOccurrence` function.

In multiple-loop applications such as this, you normally set the `PollMode` parameter of `ncOpenDnetIntf` to `Individual` so that each poll command message can be sent out at its own individual rate.

Within a multiple-loop application, error handling is done separately for each task. In the C programming language, this means that when an error is detected, you handle it for the appropriate task, but you do not exit the application. In LabVIEW, this means that you only wire the error clusters

of NI-DNET VIs that apply to each task, and thus you write different sub-diagrams that are not wired together in any way.

## SimpleWho Utility

---

To provide valid parameters for the NI-DNET open functions (`ncOpenDnetIntf`, `ncOpenDnetExplMsg`, and `ncDnetOpenIO`), you need to determine some basic information about your DeviceNet devices. This information includes the MAC ID of each device, the I/O connections it supports, and the input/output lengths for those I/O connections.

In most cases, the vendor of each DeviceNet device provides this information, but if not, NI-DNET provides a utility that helps you determine this information. Searching a DeviceNet network to determine information about connected devices is often referred to as a *network who*, and thus the NI-DNET utility is called `SimpleWho`. This utility is not a complete network management or configuration utility. It provides read-only information about the DeviceNet devices connected to your National Instruments DeviceNet interface.

You can run the `SimpleWho` utility in one of the following ways:

- From the NI-DNET program group, by selecting **Start» Programs»NI-DNET Software»SimpleWho**
- By double-clicking on its name within the NI-DNET installation directory, such as `C:\NIDNET\SimpleWho`

When you run the `SimpleWho` utility, a dialog box titled **Setup Online Info** appears. You use this dialog box to provide the configuration information needed to search your DeviceNet network. The **Setup Online Info** dialog box has the following controls:

- **Interface Name:** This name selects the DeviceNet interface to use. If you only have one National Instruments DeviceNet board installed, the default `DNET0` is appropriate.
- **Interface MAC ID:** This selects the DeviceNet MAC ID to use for your National Instruments DeviceNet board (it does not refer to a device). If you do not know of an unused MAC ID in your network, a MAC ID of 0 is often acceptable.
- **Baud Rate:** This selects the baud rate used by your DeviceNet devices, either 125000, 250000, or 500000 bits per second.

Once you enter these values, select **OK**, and `SimpleWho` performs a network who on your DeviceNet network.

For each device found, `SimpleWho` shows you the MAC ID of the device, followed by its Product Name. To see detailed information for each device, double-click on its MAC ID in the main list. The resulting dialog box displays:

- **MAC ID:** Address of the device (decimal)
- **Vendor ID:** Identifier assigned by ODVA to the device's vendor (decimal)
- **Device Type:** Identifies the standard device profile (decimal)
- **Serial Number:** Serial number assigned by the vendor (hexadecimal)
- **Revision:** Major and minor revision of the vendor's firmware
- **Product Name:** Text name for the device, assigned by the vendor
- **Status:** Bit mask for device status (hexadecimal)

The following bits are defined for the DeviceNet status attribute:

- **Owned** (bit 0, hex 0001): A master is communicating with the slave device
- **Configured** (bit 2, hex 0004): Device is configured different than "out of box"
- **Minor Recoverable Fault** (bit 8, hex 0100): Device is still usable
- **Minor Unrecoverable Fault** (bit 9, hex 0200): Device is still usable
- **Major Recoverable Fault** (bit 10, hex 0400): Device is in a fault state
- **Major Unrecoverable Fault** (bit 11, hex 0800): Device is in a fault state
- **I/O Connections:** Provides information for use with `ncOpenDnetIO`

The following fields are provided for each master/slave I/O connection type (strobe, poll, COS, and cyclic):

- **Checkbox:** Indicates whether the slave device supports this connection type.
- **Input Length:** Number to use as the `InputLength` parameter of `ncOpenDnetIO`. From the standpoint of the slave device itself, this length is referred to as the `produced_connection_size`.
- **Output Length:** Number to use as the `OutputLength` parameter of `ncOpenDnetIO`. From the standpoint of the slave device itself, this length is referred to as the `consumed_connection_size`.

When `SimpleWho` is finished searching your network, you can select **Who Again** to perform the network who again (such as when you power on a new device), or **Exit** to exit the utility.

## DeviceNet Network Management

---

Many DeviceNet devices have various internal attributes which must be configured properly prior to integration into your DeviceNet I/O system. One example is a device that does not provide an external switch for its MAC ID, and thus an appropriate MAC ID must be configured. Other examples include minimum/maximum detection distances for a photoelectric sensor, minimum/maximum speed limits for an AC drive, and selecting voltage or current for an analog input.

You can handle these configuration tasks by integrating them into your NI-DNET application. Use the explicit messaging discussed in the previous section to execute `Set Attribute Single` to set a device's configuration attributes.

Another way to handle device configuration is to use a network management utility. A network management utility provides a user interface to set configuration attributes, as well as other features useful in managing a DeviceNet system.

NI-DNET supports Allen-Bradley's WinDnet device driver specification. If you use Allen-Bradley's DeviceNet Manager software to manage your DeviceNet system, you can use your National Instruments board with that software package.

---

# Application Examples

This chapter describes the example applications provided with your NI-DNET software.

The examples in this chapter are designed to illustrate basic NI-DNET programming and specific concepts and techniques that can help you write your own applications. Each example includes an overview, steps used to run the example, a program flowchart for the example's source code, and information on how the example can be extended.

The following example programs are included with your NI-DNET software:

- `SingleDevice` is an example that does I/O communication as a DeviceNet master with a single slave device.
- `GetIdentityAttrs` is an example that uses explicit messaging services to get attributes from a device's Identity Object.

## Example 1. SingleDevice

---

This example does I/O communication as a DeviceNet master with a single slave device. You can use this example with any type of DeviceNet slave device. The example should be a starting point for you to learn to use the NI-DNET software.

The LabVIEW front panel for this example is shown in Figure 4-1. The LabWindows/CVI front panel is similar.

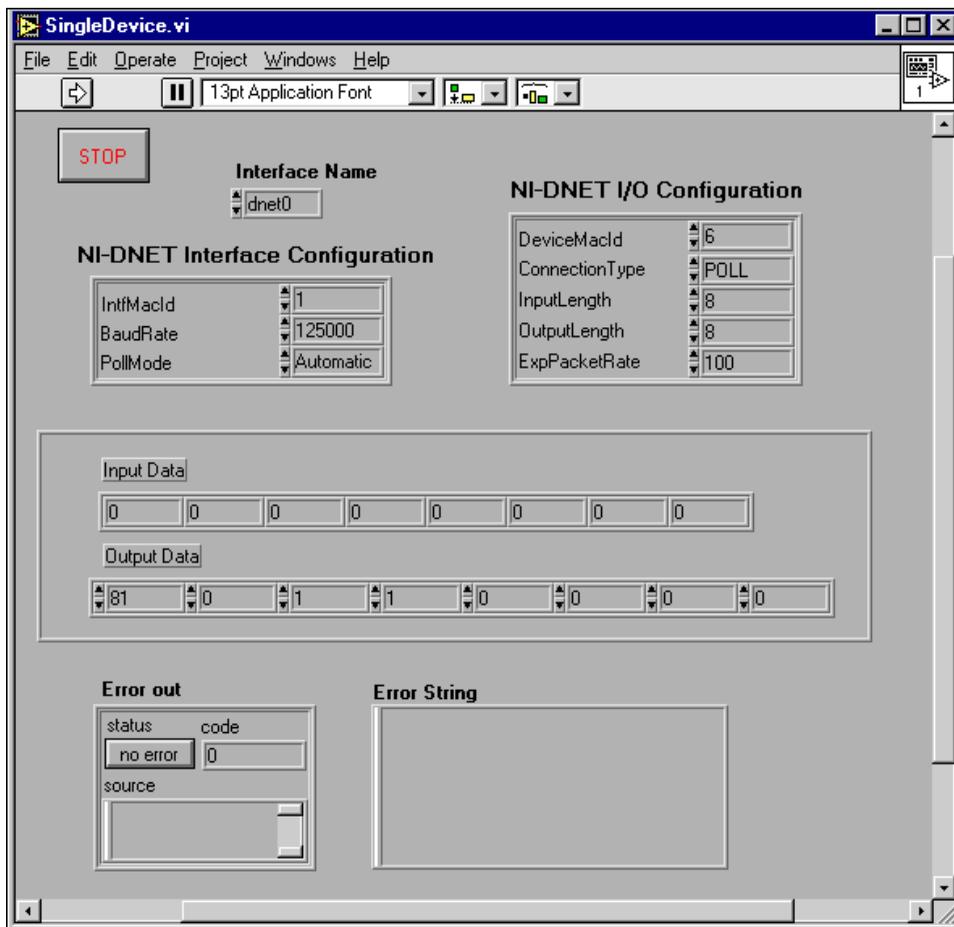


Figure 4-1. SingleDevice Front Panel

## Run the Example

Follow these steps to run the example:

1. Connect a single DeviceNet slave device to your DeviceNet interface. For information on DeviceNet cabling, refer to Appendix B, *Cabling Requirements*, in your getting started manual.
2. Determine the baud rate and MAC ID used by your slave device. Many devices provide external switches for the MAC ID and baud rate. If this is the case, consult the documentation provided by your device's vendor.

If your device does not have baud rate and MAC ID external switches, the baud rate is often fixed at 125,000 (or determined by the device automatically), and the MAC ID is configured using a network management utility. For information on network management utilities, refer to Chapter 3, *NI-DNET Programming Techniques*.

If you know the baud rate of your device but not the MAC ID, NI-DNET provides a utility used to tell you the MAC ID of each connected device (`SimpleWho`). For information on `SimpleWho`, refer to the *SimpleWho Utility* section in Chapter 3, *NI-DNET Programming Techniques*.

3. Determine the type of I/O communication supported by your DeviceNet device. For example, most photoelectric sensors support strobed I/O with an input length of 1 byte. You need to know the I/O connection type (poll, strobe, and so on), number of input bytes, and number of output bytes.

This information should be included in the documentation provided by the device vendor. If not, you can use the `SimpleWho` utility mentioned in Step 2 to find the information.

4. Load `SingleDevice` into your programming environment.
  - LabVIEW or BridgeVIEW: Select **File»Open**, then find `SingleDevice.vi` in the LabVIEW or BridgeVIEW `Examples` directory.
  - LabWindows/CVI: Select **File»Open»Project**, then find `SingleDevice.prj` in the LabWindows/CVI `Samples` directory.
  - For other programming environments, such as Microsoft C/C++, you can open `SingleDevice.c` in the NI-DNET `Examples` directory. Since the steps needed to edit, compile, and run `SingleDevice.c` are specific to your programming environment, the following steps provide information only for LabVIEW, BridgeVIEW, or LabWindows/CVI.
5. Change the front panel controls to match the capabilities of your slave device.

For LabVIEW or BridgeVIEW, you must change the front panel controls prior to running the example.

For LabWindows/CVI, you must first run the example in order to access the front panel controls.

- **Interface Name:** This name selects the DeviceNet interface to use. If you only have one National Instruments DeviceNet board installed, the default `DNET0` is appropriate.

- **Interface MAC ID:** This selects the DeviceNet MAC ID to use for your National Instruments DeviceNet board (it does not refer to a device). If you do not know of an unused MAC ID in your network, a MAC ID of 0 is often acceptable.
- **Baud Rate:** This selects the baud rate used by your DeviceNet device. Enter the value you determined in Step 2.
- **Poll Mode:** Leave this control set to `Automatic`.
- **Device MAC ID:** This selects the MAC ID of your DeviceNet device. Enter the value you determined in Step 2.
- **Connection Type:** This selects the type of I/O connection to use with your DeviceNet device. Enter the value you determined in Step 3.
- **Input Length:** This selects the number of bytes to read from the device's I/O connection. Enter the value you determined in Step 3.
- **Output Length:** This selects the number of bytes to write to the device's I/O connection. Enter the value you determined in Step 3.
- **Exp Packet Rate:** This determines the rate of I/O communication. Since you set **Poll Mode** to `Automatic`, if you specified a **Connection Type** of `Strobe` or `Poll`, then this rate is determined automatically by NI-DNET, and the value in this control is ignored (you can leave it zero). If you specified a **Connection Type** of `COS`, set this control to 10000. If you specified a **Connection Type** of `Cyclic`, set this control to 100.

6. Start I/O communication.

For LabVIEW or BridgeVIEW, select the **Run** button (right arrow) on the LabVIEW/BridgeVIEW menu bar to run the example.

For LabWindows/CVI, select the **Start** button on the example's front panel.

After you start I/O communication, it will take up to six seconds for communication to initialize. After initialization is complete, you can view the slave's input bytes on the front panel **Input Data** indicators, and you can enter new output bytes using the front panel **Output Data** controls. You can use these input and output bytes to test and manipulate the physical capabilities of your slave device.

7. Stop the example.


For LabVIEW or BridgeVIEW: select the **Stop** button on the example's front panel. If needed, you can still view any errors or other information on the front panel.

For LabWindows/CVI: select the **Stop** button on the example's front panel. Although I/O communication has stopped, you can still view any errors or other information on the front panel. Select the **Exit** button to close the front panel and exit back to the LabWindows/CVI environment.

Congratulations on completing your first DeviceNet application! You should now view the source code of the example in order to understand its implementation. Refer to the next section for a program flow chart of the example's source code.

## Program Flow Chart

Figure 4-2 shows the steps for the `SingleDevice` application example. For general information about programming an NI-DNET application, see Chapter 2, *Developing Your Application*.

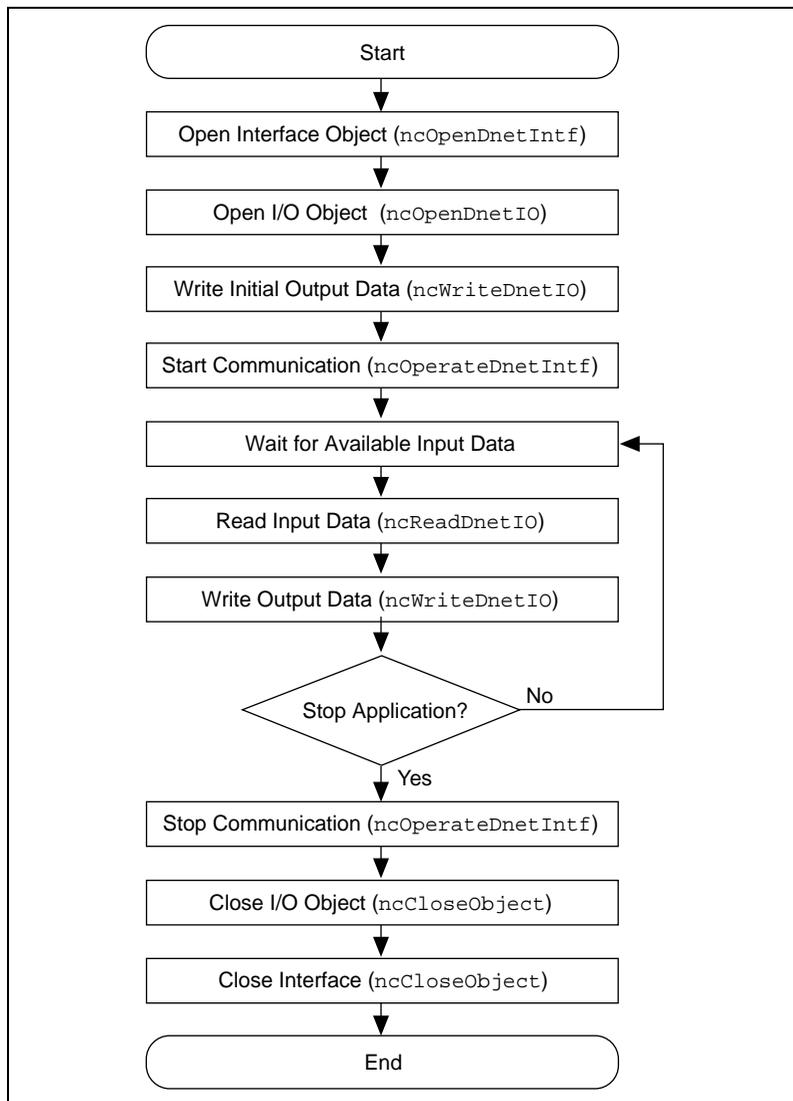

**Figure 4-2.** Programming Steps for SingleDevice Example

## Extending the Example

The following list provides some ideas on how you might extend the SingleDevice example.

- Use your device's specific I/O data. For LabVIEW, BridgeVIEW, and LabWindows/CVI, this often involves use of various controls and indicators for each I/O item (instead of just byte arrays).

For information on using a device's I/O data in your application, refer to the section *Using I/O Data in Your Application* in Chapter 3, *NI-DNET Programming Techniques*.

- Add additional slave devices. This involves duplicating all NI-DNET functions in order to communicate with the additional devices. For information on handling multiple slave devices, refer to the section *Handling Multiple Devices* in Chapter 3, *NI-DNET Programming Techniques*.
- Add explicit messaging support, such as for configuration. For information on explicit messaging, refer to *Using Explicit Messaging Services* section in Chapter 3, *NI-DNET Programming Techniques*, and the next section, *Example 2. GetIdentityAttrs*.
- Implement a control algorithm. This involves reading inputs, executing control code for the physical environment, and writing outputs.
- Communicate as a DeviceNet slave. The master for this slave I/O can be a standalone controller such as a Programmable Logic Controller (PLC), or another National Instruments DeviceNet board. Slave I/O can be used to integrate PC-based operator interface software, data acquisition, motion control, or image acquisition products into your master's control system. To enable slave I/O, set the I/O Object's `DeviceMacId` to the same value as `InterfaceMacId`. The `InputLength` is still used with `ncReadDnetIO`, and `OutputLength` is used with `ncWriteDnetIO`. You must start the `SingleDevice` example for slave I/O before you start the master.

## Example 2. GetIdentityAttrs

This example uses explicit messaging services to get attributes from a remote device's Identity Object. The DeviceNet Identity Object provides attributes which identify the device's vendor, device profile, and product name. The LabVIEW front panel for this example is shown in Figure 4-3. The LabWindows/CVI front panel is similar.

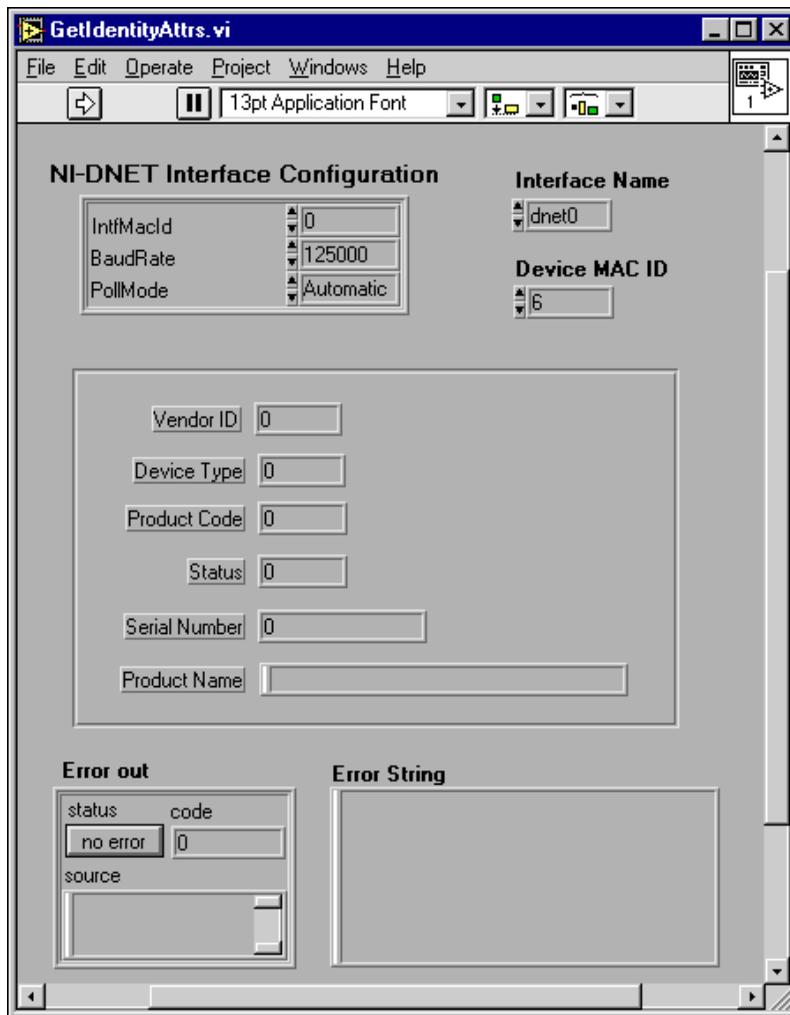


Figure 4-3. GetIdentityAttrs Front Panel

## Run the Example

Follow these steps to run the example:

1. Connect a single DeviceNet slave device to your DeviceNet interface. For information on DeviceNet cabling, refer to Appendix B, *Cabling Requirements*, in your getting started manual.
2. Determine the baud rate and MAC ID used by your slave device.  
Many devices provide external switches for the MAC ID and baud rate. If this is the case, consult the documentation provided by your device's vendor.

If your device does not have baud rate and MAC ID external switches, the baud rate is often fixed at 125,000 (or determined by the device automatically), and the MAC ID is configured using a network management utility. For information on network management utilities, refer to Chapter 3, *NI-DNET Programming Techniques*.

If you know the baud rate of your device but not the MAC ID, NI-DNET provides a simple utility used to tell you the MAC ID of each connected device (`SimpleWho`). For information on `SimpleWho`, refer to the *SimpleWho Utility* section in Chapter 3, *NI-DNET Programming Techniques*.

3. Load `GetIdentityAttrs` into your programming environment.
  - LabVIEW or BridgeVIEW: Select **File»Open**, then find `GetIdentityAttrs.vi` in the LabVIEW or BridgeVIEW Examples directory.
  - LabWindows/CVI: Select **File»Open»Project**, then find `GetIdentityAttrs.prj` in the LabWindows/CVI Samples directory.
  - For other programming environments, such as Microsoft C/C++, you can open `GetIdentityAttrs.c` in the NI-DNET Examples directory. Since the steps needed to edit, compile, and run `GetIdentityAttrs.c` are specific to your programming environment, the following steps provide information only for LabVIEW, BridgeVIEW, or LabWindows/CVI.
4. Change the front panel controls to match the capabilities of your slave device.

For LabVIEW or BridgeVIEW, you must change the front panel controls prior to running the example.

For LabWindows/CVI, you must first run the example in order to access the front panel controls.

- **Interface Name:** This name selects the DeviceNet interface to use. If you only have one National Instruments DeviceNet board installed, the default `DNET0` is appropriate.
- **Interface MAC ID:** This selects the DeviceNet MAC ID to use for your National Instruments DeviceNet board (it does not refer to a device). If you do not know of an unused MAC ID in your network, a MAC ID of 0 is often acceptable.
- **Baud Rate:** This selects the baud rate used by your DeviceNet device. Enter the value you determined in Step 2.
- **Poll Mode:** Leave this control set to `Automatic`.
- **Device MAC ID:** This selects the MAC ID of your DeviceNet device. Enter the value you determined in Step 2.

5. Get the identity attributes.

For LabVIEW or BridgeVIEW, select the **Run** button (right arrow) on the LabVIEW/BridgeVIEW menu bar to run the example.

For LabWindows/CVI, select the **Start** button on the example's front panel.


When you run the example, it calls `ncGetDnetAttribute` to get each Identity Object attribute, displays those attributes on the front panel, then stops.

For LabWindows/CVI, select the **Exit** button to close the front panel and exit back to the LabWindows/CVI environment.

You should now view the source code of the example in order to understand its implementation. Refer to the next section for a program flow chart of the example's source code.

## Program Flow Chart

Figure 4-4 shows the steps for the `GetIdentityAttrs` application example. For general information about programming an NI-DNET application, see Chapter 2, [Developing Your Application](#).

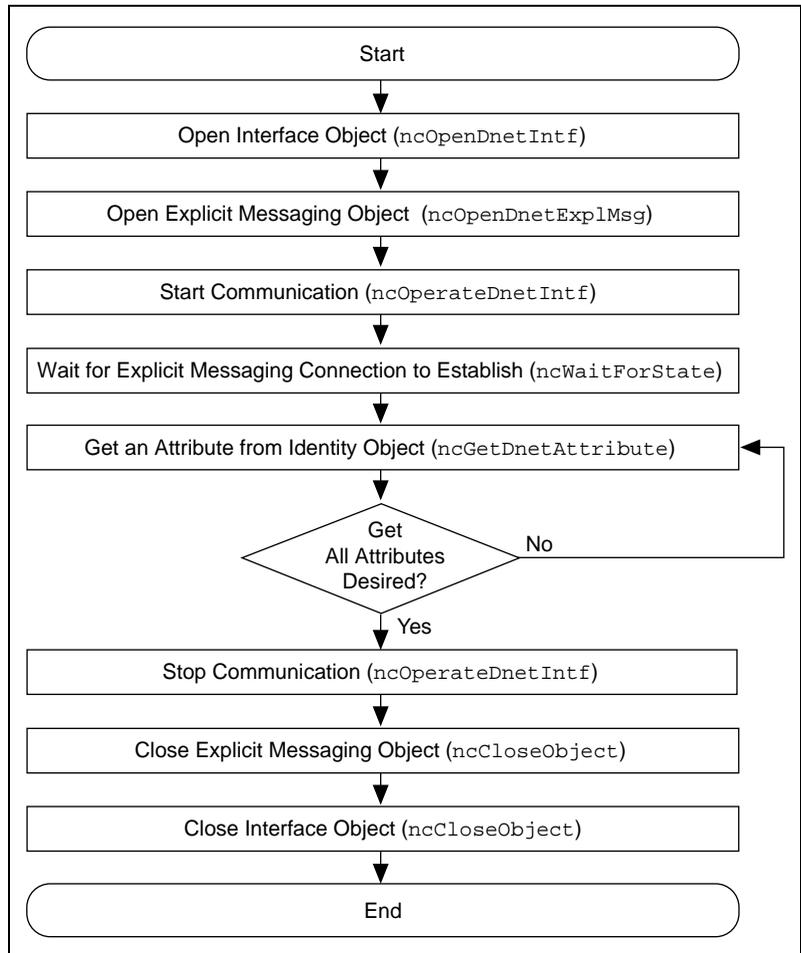

**Figure 4-4.** Programming Steps for GetIdentityAttrs Example

## Extending the Example

- Get attributes from other objects in the device. This involves changing the class ID, instance ID, and attribute ID used in `ncGetDnetAttribute`.
- Use the DeviceNet Set Attribute Single service to support device configuration. The NI-DNET `ncSetDnetAttribute` function is used to set an attribute in a remote DeviceNet device.
- Add additional slave devices. This involves duplicating all NI-DNET functions in order to communicate with the additional devices. For information on handling multiple slave devices, refer to the section

*Handling Multiple Devices* in Chapter 3, *NI-DNET Programming Techniques*.

- Use explicit messaging services other than Get Attribute Single and Set Attribute Single. NI-DNET provides an example which can be used to execute any explicit messaging service. This example is called `ExpMsgWriteRead` and is found in the same directory as `GetIdentityAttrs`.



---

# Customer Communication

For your convenience, this appendix contains forms to help you gather the information necessary to help us solve your technical problems and a form you can use to comment on the product documentation. When you contact us, we need the information on the Technical Support Form and the configuration form, if your manual contains one, about your system configuration to answer your questions as quickly as possible.

National Instruments has technical assistance through electronic, fax, and telephone systems to quickly provide the information you need. Our electronic services include a bulletin board service, an FTP site, a fax-on-demand system, and e-mail support. If you have a hardware or software problem, first try the electronic support systems. If the information available on these systems does not answer your questions, we offer fax and telephone support through our technical support centers, which are staffed by applications engineers.

## Electronic Services

### Bulletin Board Support

National Instruments has BBS and FTP sites dedicated for 24-hour support with a collection of files and documents to answer most common customer questions. From these sites, you can also download the latest instrument drivers, updates, and example programs. For recorded instructions on how to use the bulletin board and FTP services and for BBS automated information, call 512 795 6990. You can access these services at:

United States: 512 794 5422

Up to 14,400 baud, 8 data bits, 1 stop bit, no parity

United Kingdom: 01635 551422

Up to 9,600 baud, 8 data bits, 1 stop bit, no parity

France: 01 48 65 15 59

Up to 9,600 baud, 8 data bits, 1 stop bit, no parity

### FTP Support

To access our FTP site, log on to our Internet host, `ftp.natinst.com`, as anonymous and use your Internet address, such as `joesmith@anywhere.com`, as your password. The support files and documents are located in the `/support` directories.

## Fax-on-Demand Support

Fax-on-Demand is a 24-hour information retrieval system containing a library of documents on a wide range of technical information. You can access Fax-on-Demand from a touch-tone telephone at 512 418 1111.

## E-Mail Support (Currently USA Only)

You can submit technical support questions to the applications engineering team through e-mail at the Internet address listed below. Remember to include your name, address, and phone number so we can contact you with solutions and suggestions.

[support@natinst.com](mailto:support@natinst.com)

## Telephone and Fax Support

National Instruments has branch offices all over the world. Use the list below to find the technical support number for your country. If there is no National Instruments office in your country, contact the source from which you purchased your software to obtain support.

<b>Country</b>	<b>Telephone</b>	<b>Fax</b>
Australia	03 9879 5166	03 9879 6277
Austria	0662 45 79 90 0	0662 45 79 90 19
Belgium	02 757 00 20	02 757 03 11
Brazil	011 288 3336	011 288 8528
Canada (Ontario)	905 785 0085	905 785 0086
Canada (Quebec)	514 694 8521	514 694 4399
Denmark	45 76 26 00	45 76 26 02
Finland	09 725 725 11	09 725 725 55
France	01 48 14 24 24	01 48 14 24 14
Germany	089 741 31 30	089 714 60 35
Hong Kong	2645 3186	2686 8505
Israel	03 6120092	03 6120095
Italy	02 413091	02 41309215
Japan	03 5472 2970	03 5472 2977
Korea	02 596 7456	02 596 7455
Mexico	5 520 2635	5 520 3282
Netherlands	0348 433466	0348 430673
Norway	32 84 84 00	32 84 86 00
Singapore	2265886	2265887
Spain	91 640 0085	91 640 0533
Sweden	08 730 49 70	08 730 43 70
Switzerland	056 200 51 51	056 200 51 55
Taiwan	02 377 1200	02 737 4644
United Kingdom	01635 523545	01635 523154
United States	512 795 8248	512 794 5678

# Technical Support Form

Photocopy this form and update it each time you make changes to your software or hardware, and use the completed copy of this form as a reference for your current configuration. Completing this form accurately before contacting National Instruments for technical support helps our applications engineers answer your questions more efficiently.

If you are using any National Instruments hardware or software products related to this problem, include the configuration forms from their user manuals. Include additional pages if necessary.

Name \_\_\_\_\_

Company \_\_\_\_\_

Address \_\_\_\_\_

\_\_\_\_\_

Fax ( \_\_\_\_ ) \_\_\_\_\_ Phone ( \_\_\_\_ ) \_\_\_\_\_

Computer brand \_\_\_\_\_ Model \_\_\_\_\_ Processor \_\_\_\_\_

Operating system (include version number) \_\_\_\_\_

Clock speed \_\_\_\_\_ MHz RAM \_\_\_\_\_ MB Display adapter \_\_\_\_\_

Mouse \_\_\_\_ yes \_\_\_\_ no Other adapters installed \_\_\_\_\_

Hard disk capacity \_\_\_\_\_ MB Brand \_\_\_\_\_

Instruments used \_\_\_\_\_

\_\_\_\_\_

National Instruments hardware product model \_\_\_\_\_ Revision \_\_\_\_\_

Configuration \_\_\_\_\_

National Instruments software product \_\_\_\_\_ Version \_\_\_\_\_

Configuration \_\_\_\_\_

The problem is: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

List any error messages: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

The following steps reproduce the problem: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

# Documentation Comment Form

National Instruments encourages you to comment on the documentation supplied with our products. This information helps us provide quality products to meet your needs.

**Title:** *NI-DNET™ User Manual*

**Edition Date:** April 1998

**Part Number:** 321862A-01

Please comment on the completeness, clarity, and organization of the manual.

---

---

---

---

---

---

---

---

If you find errors in the manual, please record the page numbers and describe the errors.

---

---

---

---

---

---

---

---

Thank you for your help.

Name \_\_\_\_\_

Title \_\_\_\_\_

Company \_\_\_\_\_

Address \_\_\_\_\_

E-Mail Address \_\_\_\_\_

Phone ( \_\_\_ ) \_\_\_\_\_ Fax ( \_\_\_ ) \_\_\_\_\_

**Mail to:** Technical Publications  
National Instruments Corporation  
6504 Bridge Point Parkway  
Austin, Texas 78730-5039

**Fax to:** Technical Publications  
National Instruments Corporation  
512 794 5678

# Glossary

---

Prefix	Meanings	Value
m-	milli-	$10^{-3}$
k-	kilo-	$10^3$
M-	mega-	$10^6$

## A

A amperes

AC alternating current

actuator A device that uses electrical, mechanical, or other signals to change the value of an external, real-world variable. In the context of device networks, actuators are devices that receive their primary data value from over the network; examples include valves and motor starters. Also known as *final control element*.

ANSI American National Standards Institute

Application Programming Interface (API) A collection of functions used by a user application to access hardware. Within NI-DNET, you use API functions to make calls into the NI-DNET driver.

ASCII American Standard Code for Information Exchange

Assembly Object Objects in DeviceNet devices which route I/O message contents to/from individual attributes in the device.

attribute The externally visible qualities of an object; for example, an instance square of class Geometric Shapes could have the attributes length of sides and color, with the values 4 in. and blue.

automatic polling A polled I/O mode in which NI-DNET automatically determines an appropriate *scanned polling* rate for your DeviceNet system.

## B

b	Bits
background polling	A polled I/O communication scheme in which all polled slaves are grouped into two different communication rates: a foreground rate and a slower background rate.
bit strobed I/O	Master/slave I/O connection in which the master broadcasts a single strobe command to all strobed slaves then receives a strobe response from each strobed slave.

## C

CAN	Controller Area Network
change-of-state I/O	Master/slave I/O connection which is similar to cyclic I/O but data can be sent when a change in the data is detected.
class	A classification of things with similar qualities.
client	In explicit messaging connections, the client is the device requesting execution of the service.
common services	Services defined by the DeviceNet specification such that they are largely interoperable.
connection	An association between two or more devices on a network that describes when and how data is transferred.
controller	A device that receives data from sensors and sends data to actuators in order to hold one or more external, real-world variables at a certain level or condition. A thermostat is a simple example of a controller.
COS I/O	<i>See</i> change-of-state I/O.
cyclic I/O	Master/slave I/O connection in which the slave (or master) sends data at a fixed interval.

**D**

DC	direct current
device	A physical assembly, linked to a communication line (cable), capable of communicating across the network according to a protocol specification.
device network	Multi-drop digital communication network for sensors, actuators, and controllers.
device profiles	DeviceNet specifications which provide interoperability for devices of the same type.
direct entry	Microsoft Win 32 functions used to directly access the functions of a Dynamic Link Library (DLL).
DLL	Dynamic Link Library
driver attributes	Attributes of the NI-DNET driver software.

**E**

EDS	Electronic Data Sheet. Text file that describes DeviceNet device features electronically.
expected packet rate	The rate (in milliseconds) at which a DeviceNet connection is expected to transfer its data.
Explicit messaging connection	General-purpose connection used for executing services on a particular object in a DeviceNet device.

**F**

FCC	Federal Communications Commission
ft	feet
FTP	File transfer protocol

## H

hex Hexadecimal

Hz Hertz

## I

in. inches

individual polling A polled I/O communication scheme in which each polled slave communicates at its own individual rate.

instance A specific instance of a given class. For example, a blue square of 4 inches per side would be one instance of the class Squares.

I/O connection Connection used for exchange of physical input/output (sensor/activator) data, as well as other control-oriented data.

ISO International Standards Organization

## K

KB Kilobytes of memory

## L

LabVIEW Laboratory Virtual Instrument Engineering Workbench

LED light-emitting diode

local Within NI-DNET, anything that exists on the same host (personal computer) as the NI-DNET driver.

## M

m meter

MAC ID Media access control layer identifier. In DeviceNet, a device's MAC ID represents its address on the DeviceNet network.

master/slave	DeviceNet communication scheme in which a master device allocates connections to one or more slave devices, and those slave devices can only communicate with the master and not one another.
MB	Megabytes of memory
member	Individual data value within a DeviceNet I/O Assembly.
method	<i>See</i> service.
multi-drop	A physical connection in which multiple devices communicate with one another along a single cable.

## N

network interface	A device's physical connection onto a network.
network management utility	Utility used to manage configuration of DeviceNet devices.
network who	A search of a DeviceNet network to determine information about its devices.
NI-DNET driver	Device driver and/or firmware that implement all the specifics of a National Instruments DeviceNet interface.
notification	Within NI-DNET, an operating system mechanism that the NI-DNET driver uses to communicate events to your application. You can think of a notification of as an API function, but in the opposite direction.

## O

object	<i>See</i> instance.
object-oriented	A software design methodology in which classes, instances, attributes, and methods are used to hide all of the details of a software entity that do not contribute to its essential characteristics.
ODVA	Open DeviceNet Vendor's Association

## P

PC	personal computer
peer-to-peer	DeviceNet communication scheme in which each device communicates as a peer and connections are established among devices as needed.
PLC	Programmable Logic Controller
polled I/O	Master/slave I/O connection in which the master sends a poll command to a slave, then receives a poll response from that slave.
protocol	A formal set of conventions or rules for the exchange of information among devices of a given network.

## R

RAM	Random-access memory
remote	Within NI-DNET, anything that exists in another device of the device network (not on the same host as the NI-DNET driver).
resource	Hardware settings used by National Instruments DeviceNet hardware, including an interrupt request level (IRQ) and an 8 KB physical memory range (such as D0000 to D1FFF hex).

## S

s	seconds
scanned polling	A polled I/O communication scheme in which all poll commands are sent out at the same rate, in quick succession.
sensor	A device that measures electrical, mechanical, or other signals from an external, real-world variable; in the context of device networks, sensors are devices that send their primary data value onto the network; examples include temperature sensors and presence sensors. Also known as <i>transmitter</i> .
server	In explicit messaging connections, the server is the device to which the service is directed.

service An action performed on an instance to affect its behavior; the externally visible code of an object. Within NI-DNET, you use NI-DNET functions to execute services for objects. Also known as *method* and *operation*.

strobed I/O See bit strobed I/O.

## V

V volts

VI Virtual Instrument

VxD Virtual device driver

# Index

---

## A

- accessing I/O members
  - in C languages, 3-11 to 3-12
  - in LabVIEW, 3-10 to 3-11
- Allen-Bradley (company), 1-1
- application development. *See also* application examples.
  - accessing NI-DNET software, 2-1 to 2-5
    - direct entry access, 2-3 to 2-5
    - LabVIEW or BridgeVIEW (G), 2-1
    - LabWindows/CVI, 2-1 to 2-2
    - Microsoft C/C++ or Borland C/C++, 2-2 to 2-3
  - configuring I/O connections, 3-1 to 3-8
    - automatic EPR feature, 3-7 to 3-8
    - change-of-status I/O, 3-7
    - cyclic I/O, 3-6
    - expected packet rate, 3-1 to 3-2
    - polled I/O, 3-3 to 3-6
    - strobed I/O, 3-2
  - DeviceNet network management, 3-19
  - explicit messaging services, 3-12 to 3-14
    - Get and Set attributes in remote DeviceNet device, 3-12 to 3-13
    - services other than Get and Set attributes, 3-13 to 3-14
  - handling multiple devices, 3-14 to 3-17
    - configuration, 3-15
    - main loop, 3-16 to 3-17
    - object handles, 3-15 to 3-16
  - I/O data, 3-8 to 3-12
    - AC drive output assembly, instance 20 (figure), 3-9
    - accessing I/O members
      - in C languages, 3-11 to 3-12
      - in LabVIEW, 3-10 to 3-11
    - attribute mapping for basic speed control output assembly (table), 3-10
    - information sources for input and output assemblies, 3-8 to 3-9
    - programming model, 2-5 to 2-8
      - general programming steps (figure), 2-6
      - step 1. opening objects, 2-6
      - step 2. starting communication, 2-7
      - step 3. running DeviceNet application, 2-7 to 2-8
      - step 4. stopping communication, 2-8
      - step 5. closing objects, 2-8
    - SimpleWho utility, 3-17 to 3-19
    - status handling, 2-8 to 2-13
      - C languages, 2-11 to 2-13
      - G language (LabVIEW/BridgeVIEW), 2-8 to 2-11
  - application examples, 4-1 to 4-12
    - GetIdentityAttrs, 4-8 to 4-12
      - extending the example, 4-11 to 4-12
      - front panel (figure), 4-8
      - program flow chart (figure), 4-11
      - running the example, 4-9 to 4-10
    - SingleDevice, 4-1 to 4-7
      - extending the example, 4-6 to 4-7
      - front panel (figure), 4-2
      - program flow chart (figure), 4-6
      - running, 4-2 to 4-5
  - Application Objects, 1-4 to 1-5
  - Assembly Objects, 1-11 to 1-13
    - input and output assemblies (figure), 1-12
    - input assembly for photoeye or limit switch (figure), 1-12
  - attributes, definition, 1-3

**B**

background polling, 3-4 to 3-5  
 baud rates, DeviceNet (table), 1-2  
 bit-strobed I/O connection  
   example (figure), 1-9  
   purpose and use, 1-8 to 1-9  
 Borland C/C++. *See* C/C++ languages  
   (Borland and Microsoft).  
 BridgeVIEW software. *See* LabVIEW/  
   BridgeVIEW software.  
 bulletin board support, A-1

**C**

cable length, DeviceNet (table), 1-2  
 CAN (Controller Area Network), 1-1  
 C/C++ languages (Borland and Microsoft)  
   accessing I/O members, 3-11 to 3-12  
   interface files, 1-18  
   status handling, 2-11 to 2-13  
     checking status, 2-11  
     code bits, 2-13  
     error/warning indicators  
       (severity), 2-12 to 2-13  
     qualifier bits, 2-13  
     status format, 2-12 to 2-13  
 change-of-state I/O connections, 1-9 to 1-11  
   example (figure), 1-11  
   expected packet rate, 1-9, 3-7  
   purpose and use, 1-9 to 1-11  
 class ID, explicit message request (table), 1-6  
 classes  
   definition, 1-2  
   geometric shapes (figure), 1-3  
 client, definition, 1-5  
 closing objects, 2-8  
 code bits, status handling, 2-13  
 code field, status handling, 2-10  
 communication  
   starting, 2-7

  stopping, 2-8  
 configuring  
   I/O connections, 3-1 to 3-8  
     automatic EPR feature, 3-7 to 3-8  
     change-of-status I/O, 3-7  
     cyclic I/O, 3-6  
     expected packet rate, 3-1 to 3-2  
     polled I/O, 3-3 to 3-6  
     strobed I/O, 3-2  
   multiple devices, 3-15  
 Connection Object, 1-4  
 Controller Area Network (CAN), 1-1  
 customer communication, *xi*, A-1 to A-2  
 cyclic I/O connections, 1-9 to 1-11  
   example (figure), 1-11  
   expected packet rate, 1-9, 3-6  
   purpose and use, 1-9 to 1-11

**D**

developing applications. *See* application  
   development.  
 device profiles, 1-13  
 DeviceNet. *See also* NI-DNET software.  
   Assembly Objects, 1-11 to 1-13  
     input and output assemblies  
       (figure), 1-12  
     input assembly for photoeye or limit  
       switch (figure), 1-12  
   device profiles, 1-13  
   explicit messaging connections, 1-5 to 1-7  
     explicit message request (table), 1-6  
     explicit message response (table), 1-6  
   history, 1-1  
   I/O connections, 1-7 to 1-13  
     bit strobed I/O, 1-8 to 1-9  
     change-of-state and cyclic  
       I/O, 1-9 to 1-11  
     polled I/O, 1-8  
   network management, 3-19

- object modeling
  - general concepts, 1-2 to 1-3
  - used in NI-DNET
    - specification, 1-3 to 1-4
- Open DeviceNet Vendors Association (ODVA), 1-13
- physical characteristics, 1-2
- direct entry access to NI-DNET
  - software, 2-3 to 2-5
- dltd DeviceNet Error Handler function, 2-9
- dltd Open DeviceNet Vendors Association (ODVA), 1-13
- documentation
  - conventions used in manual, *x-xi*
  - how to use manual set, *ix*
  - organization of manual, *x*
  - related documentation, *xi*

## E

- electronic support services, A-1 to A-2
- e-mail support, A-2
- EPR. *See* expected packet rate (EPR).
- error handling. *See* status handling.
- error/warning indicators (severity), 2-12
- examples. *See* application examples.
- expected packet rate (EPR), 3-1 to 3-2
  - automatic EPR feature, 3-7 to 3-8
  - change-of-status I/O connections, 3-7
  - cyclic I/O connections, 3-6
  - definition, 1-9
  - polled I/O connections, 3-2 to 3-6
    - background polling, 3-4 to 3-5
    - individual polling, 3-5 to 3-6
    - scanned polling, 3-2 to 3-4
  - strobed I/O connections, 3-2
- explicit messaging connections, 1-5 to 1-7
  - definition, 1-5
  - explicit message request (table), 1-6
  - explicit message response (table), 1-6

- programming techniques, 3-12 to 3-14
  - Get and Set attributes in remote DeviceNet device
    - 3-12 to 3-13
  - services other than Get and Set attributes, 3-13 to 3-14
- Explicit Messaging object, 1-15

## F

- fax and telephone support numbers, A-2
- Fax-on-Demand support, A-2
- firmware image files, 1-18
- FTP support, A-1

## G

- G languages. *See* LabVIEW/BridgeVIEW software; LabWindows/CVI software.
- Get Attribute Single service
  - programming techniques, 3-12 to 3-13
  - purpose and use, 1-7
  - in remote DeviceNet device, 3-12 to 3-13
- GetIdentityAttrs example, 4-8 to 4-12
  - extending the example, 4-11 to 4-12
  - front panel (figure), 4-8
  - program flow chart (figure), 4-11
  - running the example, 4-9 to 4-10

## H

- handling multiple devices, 3-14 to 3-17
  - configuration, 3-15
  - main loop, 3-16 to 3-17
  - object handles, 3-15 to 3-16

## I

- Identity Object, 1-4
- individual polling, 3-5 to 3-6

instance, definition, 1-2

instance ID, explicit message request  
(table), 1-6

interface files for programming  
languages, 1-18

Interface Object, 1-14

I/O connections, 1-7 to 1-13

- bit strobed I/O, 1-8 to 1-9
- change-of-state and cyclic I/O, 1-9 to 1-11
- configuring, 3-1 to 3-8
  - automatic EPR feature, 3-7 to 3-8
  - change-of-status I/O, 3-7
  - cyclic I/O, 3-6
  - expected packet rate, 3-1 to 3-2
  - polled I/O, 3-3 to 3-6
  - strobed I/O, 3-2
- definition, 1-7
- finding with SimpleWho
  - utility, 3-17 to 3-18
- master/slave, 1-7 to 1-8
- peer-to-peer, 1-7 to 1-8
- polled I/O, 1-8

I/O data, using in applications, 3-8 to 3-12

- AC drive output assembly, instance 20  
(figure), 3-9
- accessing I/O members
  - in C languages, 3-11 to 3-12
  - in LabVIEW, 3-10 to 3-11
- attribute mapping for basic speed control  
output assembly (table), 3-10
- information sources for input and output  
assemblies, 3-8 to 3-9

I/O members, accessing

- in C languages, 3-11 to 3-12
- in LabVIEW, 3-10 to 3-11

I/O object, 1-15

## L

LabVIEW/BridgeVIEW software

- accessing I/O members, 3-10 to 3-11
- accessing NI-DNET, 2-1
- adding functions and
  - controls to palettes, 2-1
- interface files, 1-18
- status handling, 2-8 to 2-11
  - checking status, 2-8 to 2-9
  - code field, 2-10
  - DeviceNet Error Handler
    - function, 2-8 to 2-9
  - error cluster code field (figure), 2-10
  - NI-DNET error cluster example  
(figure), 2-9
  - source field, 2-10 to 2-11
  - status (Boolean) field, 2-10
  - status format, 2-9 to 2-10
  - wiring Error in and Error out terminals  
together, 2-8 to 2-9
  - wiring Error out and Error String out-  
put terminals, 2-8 to 2-9

LabWindows/CVI software

- accessing NI-DNET, 2-1 to 2-2
- interface files, 1-18

language interface files, 1-18

loops, in applications, 3-16

## M

MAC IDs

- definition, 1-5
- finding with SimpleWho
  - utility, 3-17 to 3-18

main loop applications, 3-16 to 3-17

manual, See documentation

master/slave I/O connections, 1-8. *See also*  
SingleDevice example.

methods, definition, 1-3

Microsoft C/C++. *See* C/C++ languages (Borland and Microsoft).  
 multiple devices, handling, 3-14 to 3-17  
   configuration, 3-15  
   main loop, 3-16 to 3-17  
   object handles, 3-15 to 3-16  
 multiple loop applications, 3-16 to 3-17

## N

NI-DNET software, 1-13 to 1-19  
   accessing, 2-1 to 2-5  
     direct entry access, 2-3 to 2-5  
     LabVIEW or BridgeVIEW (G), 2-1  
     LabWindows/CVI, 2-1 to 2-2  
     Microsoft C/C++ or Borland C/C++, 2-2 to 2-3  
   compared with DeviceNet Specification, 1-5, 1-14  
   components, 1-16 to 1-19  
     application examples, 1-18  
     driver and utilities, 1-17 to 1-18  
     firmware image files, 1-18  
     language interface files, 1-18  
     structure of NI-DNET system (figure), 1-17  
     WinDnet support files, 1-19  
   device driver, 1-17  
   objects, 1-14 to 1-16  
     example, 1-16  
     Explicit Messaging object, 1-15  
     Interface object, 1-14  
     I/O object, 1-15  
     overview, 1-14  
   utilities, 1-17

## O

object handles, 3-15 to 3-16  
 object modeling  
   Application Objects, 1-4 to 1-5

classes of geometric shapes (figure), 1-3  
 Connection Object, 1-4  
 in DeviceNet specification, 1-3 to 1-5  
 differences in NI-DNET software, 1-5  
 general concepts, 1-2 to 1-3  
 Identify Object, 1-4  
 object model (figure), 1-4

## objects

  closing, 2-8  
   definition, 1-2 to 1-3  
   opening, 2-6  
 ODVA (Open DeviceNet Vendors Association), 1-1, 1-13  
 opening objects, 2-6

## P

peer-to-peer I/O connections, 1-7 to 1-8  
 physical characteristics, DeviceNet, 1-2  
 polled I/O connections, 3-2 to 3-6  
   background polling, 3-4 to 3-5  
   example (figure), 1-8  
   individual polling, 3-5 to 3-6  
   overview, 1-8  
   scanned polling, 3-2 to 3-4  
 Presence Sensing object, 1-12  
 programming. *See* application development.

## Q

qualifier bits, status handling, 2-13

## S

scanned polling, 3-2 to 3-4  
 server, definition, 1-5  
 service code  
   explicit message request (table), 1-6  
   explicit message response (table), 1-6

- service data
    - explicit message request (table), 1-6
    - explicit message response (table), 1-6
  - services, definition, 1-3
  - Set Attribute Single service
    - programming techniques, 3-12 to 3-13
    - purpose and use, 1-7
    - in remote DeviceNet device, 3-12 to 3-13
  - severity of status (table), 2-12
  - SimpleWho utility, 3-17 to 3-19
  - single loop applications, 3-16 to 3-17
  - SingleDevice example, 4-1 to 4-7
    - extending the example, 4-6 to 4-7
    - front panel (figure), 4-2
    - program flow chart (figure), 4-6
    - running, 4-2 to 4-5
  - slave I/O connections, 1-8. *See also*
    - SingleDevice example.
  - source field, status handling, 2-10 to 2-11
  - status field, status handling, 2-10
  - status handling
    - Borland C/C++ and Microsoft C/C++, 2-11 to 2-13
      - checking status, 2-11
      - code bits, 2-13
      - error/warning indicators
        - (severity), 2-12 to 2-13
      - qualifier bits, 2-13
      - status format, 2-12 to 2-13
    - LabVIEW/BridgeVIEW
      - software, 2-8 to 2-11
      - checking status, 2-8 to 2-9
      - code field, 2-10
    - DeviceNet Error Handler
      - function, 2-8 to 2-9
    - error cluster code field (figure), 2-10
    - NI-DNET error cluster example
      - (figure), 2-9
    - source field, 2-10 to 2-11
    - status field, 2-10
    - status format, 2-9 to 2-10
    - wiring Error in and Error out terminals together, 2-8 to 2-9
    - wiring Error out and Error String output terminals, 2-8 to 2-9
  - strobed I/O connections, 3-2
- ## T
- technical support, A-1 to A-2
  - telephone and fax support numbers, A-2
  - trunk length, DeviceNet (table), 1-2
- ## W
- WinDnet support files, 1-19